

STATE OF MISSOURI
DEPARTMENT OF NATURAL RESOURCES

MISSOURI CLEAN WATER COMMISSION



MISSOURI STATE OPERATING PERMIT

In compliance with the Missouri Clean Water Law, (Chapter 644 R.S. Mo. as amended, hereinafter, the Law), and the Federal Water Pollution Control Act (Public Law 92-500, 92nd Congress) as amended,

Permit No. MO-0098990

Owner: City of Wheatland
Address: P.O. Box 187, Wheatland, MO 65779

Continuing Authority: Same as above
Address: Same as above

Facility Name: Wheatland WWTF Class D Operator needed
Facility Address: County Road 160, Wheatland, MO 65779

Legal Description: See Page 2
UTM Coordinates: See Page 2

Receiving Stream: See Page 2
First Classified Stream and ID: See Page 2
USGS Basin & Sub-watershed No.: See Page 2

is authorized to discharge from the facility described herein, in accordance with the effluent limitations and monitoring requirements as set forth herein:

FACILITY DESCRIPTION

See Page 2

This permit authorizes only wastewater discharges under the Missouri Clean Water Law and the National Pollutant Discharge Elimination System; it does not apply to other regulated areas. This permit may be appealed in accordance with Section 644.051.6 of the Law.

February 28, 2014 March 4, 2015
Effective Date Revised Date

Sara Parker Pauley, Director, Department of Natural Resources

February 28, 2017
Expiration Date

John Madras, Director, Water Protection Program

FACILITY DESCRIPTION (continued)

Permitted Feature #001 – POTW – SIC #4952

The use or operation of this facility shall be by or under the supervision of a Certified D Operator.

Four cell storage lagoon/wastewater irrigation/sludge is retained in lagoon.

Design population equivalent is 559.

Design flow is 94,677 gallons per day (1-in-10 year design including net rainfall minus evaporation).

Average design flow is 80,000 gallons per day (dry weather flows).

Actual flow is 34,450 gallons per day.

Design sludge production is 2.2 dry tons per year.

Legal Description: NE¼, NW¼, NW¼, Sec. 24, T37N, R23W, Hickory County
UTM Coordinates: X=463441, Y=4200765
Receiving Stream: Tributary to Little Pomme de Terre River (U) (losing)
First Classified Stream and ID: Little Pomme De Terre River (C) (01247) (losing)
USGS Basin & Sub-watershed No.: (10290107-0403)

Receiving Stream Watershed: Little Pomme De Terre River Watershed

Facility Type:

No-discharge Storage and Irrigation System for annual flows into an unnamed Tributary to Little Pomme De Terre River.

Design Basis:

| | <u>Avg Annual</u> |
|--------------------------------|-------------------|
| Design dry weather flows | <u>80,000</u> gpd |
| Design with 1-in-10 year flows | <u>94,677</u> gpd |
| Design PE <u>559</u> | |

Storage Basin/Tank:

Cell #1

Freeboard for basin: 2 feet

Storage volume (minimum to maximum water levels) 3,008,429 gallons

Cell #2

Freeboard for basin: 2 feet

Storage volume (minimum to maximum water levels) 731,688 gallons

Cell #3

Freeboard for basin: 2 feet

Storage volume (minimum to maximum water levels) 492,274 gallons

Cell #4 for Fixed Head Sprinklers Option

Freeboard for basin: 2 feet

Storage volume (minimum to maximum water levels) 8,878,365 gallons

Cell #4 for Center Pivot Option

Freeboard for basin: 2 feet

Storage volume (minimum to maximum water levels) 7,248,332 gallons

Storage Capacity (in Days):

Design for Dry weather Flows: 80,000 gpd

Design with 1-in 10 year flows: 94,677 gpd

Land Application:

Fixed Head Sprinklers Option:

Irrigation Volume/year: 34,556,965 gallons at design loading (including 1-in-10 year flows)
Irrigation areas: 46 acres at design loading (74 acres total available)
Application rates: _____ inch/hour; _____ inch/day; _____ inches/week; 24 inches/year
Field slopes: less than 5 percent
Equipment type: Fixed Head Sprinklers
Vegetation: Hay
Application rate is based on: Hydraulic loading rate

Center Pivot Option:


Irrigation Volume/year: 34,556,965 gallons at design loading (including 1-in-10 year flows)
Irrigation areas: 46 acres at design loading (74 acres total available)
Application rates: _____ inch/hour; _____ inch/day; _____ inches/week; 24 inches/year
Field slopes: less than 5 percent
Equipment type: Center Pivot
Vegetation: Hay
Application rate is based on: Hydraulic loading rate

Permitted Feature #002 –Center Pivot Land Application Field

| | |
|---------------------------------|---|
| Legal Description: | NW¼, Sec. 24, T37N, R23W, Hickory County |
| UTM Coordinates: | (estimated) X= 463824, Y= 4200434 |
| Receiving Stream: | Tributary to Little Pomme de Terre River (U) (losing) |
| First Classified Stream and ID: | Little Pomme De Terre River (C) (01247) (losing) |
| USGS Basin & Sub-watershed No.: | (10290107-0403) |

STORAGE BASIN PROFILE

Fixed Head Sprinklers Cell #4

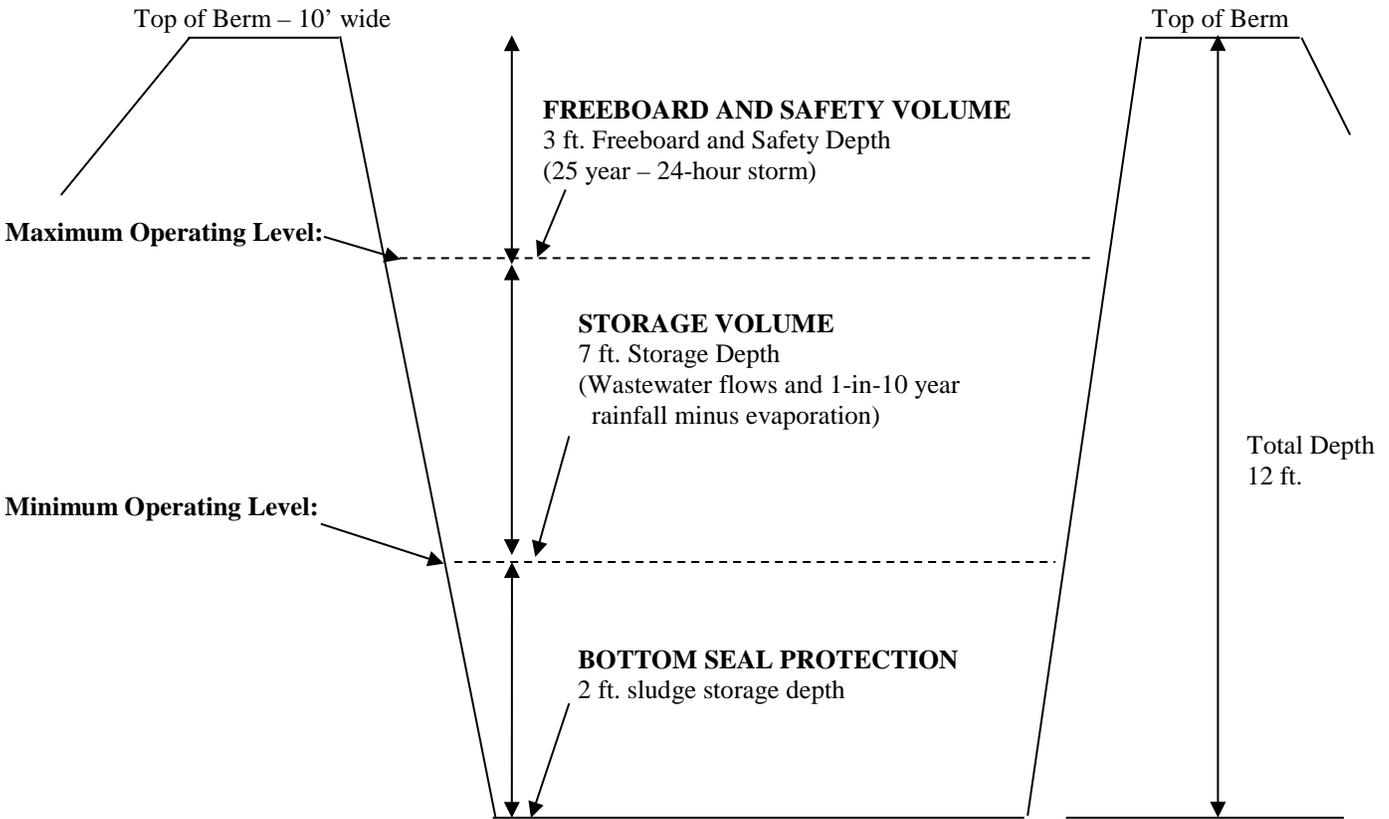


Storage Basin Dimensions:

| | <u>Surface Area</u> | <u>Depth from Bottom</u> | <u>Pump down depth (from berm)</u> |
|--|----------------------------|---------------------------------|---|
| Center Line Top Berm: | _____ sq. ft. | by <u>12</u> feet depth | |
| Inside Top Berm: | <u>155,760</u> sq. ft. | by <u>12</u> feet depth | |
| Freeboard & Safety Vol: | <u>143,750</u> sq. ft. | by <u>10</u> feet depth | <u>3</u> feet |
| Maximum operating level: | | <u>10.0</u> feet depth | <u>2</u> feet |
| Minimum operating level: | | <u>2.0</u> feet depth | <u>10</u> feet |
| Aerobic BOD design basis: | | <u>2.0</u> feet depth | <u>10</u> feet |
| Storage volume (minimum to maximum water levels): <u>8,878,365</u> gallons | | | |
| Berm top width: <u>10</u> feet | | | |

STORAGE BASIN PROFILE

Center Pivot Cell #4

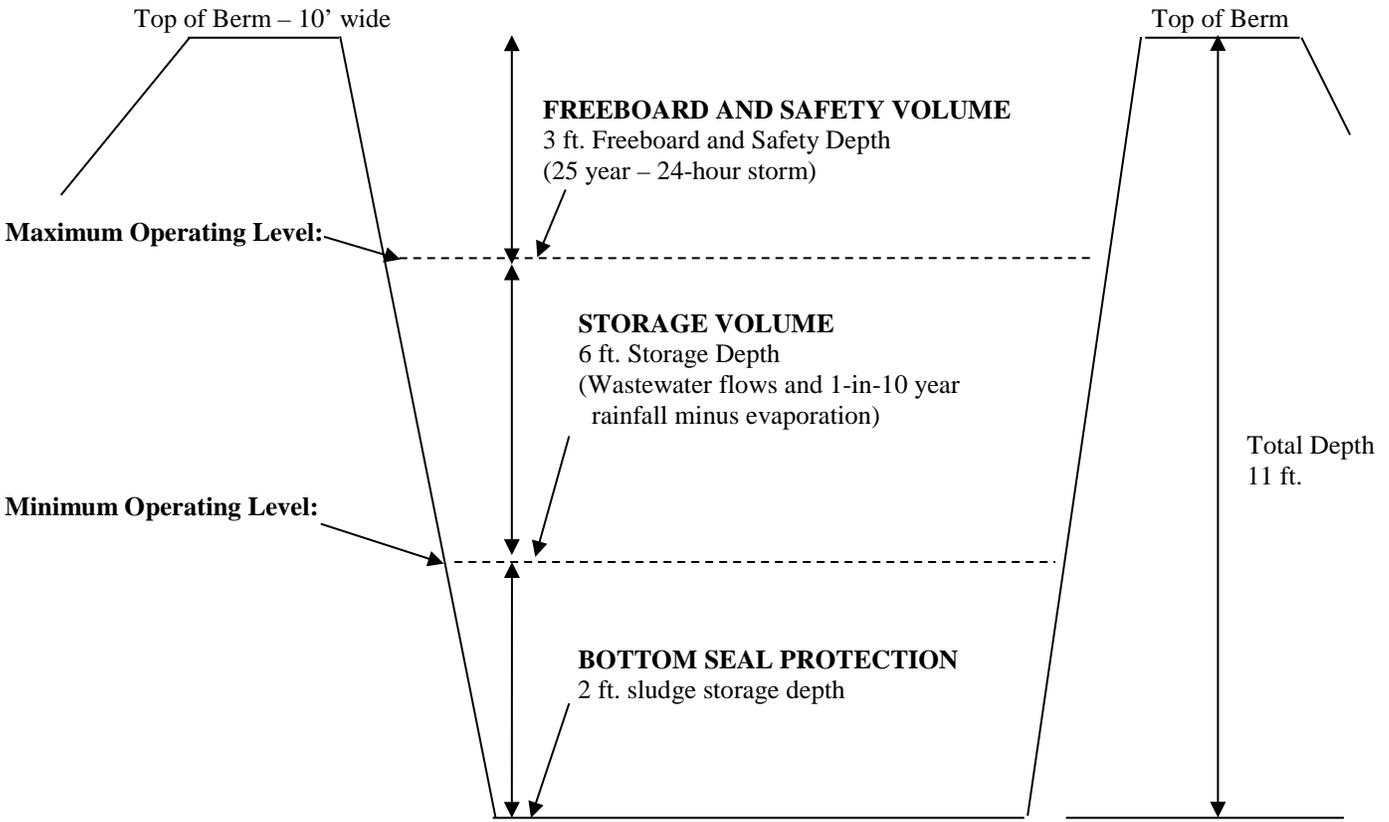

Storage Basin Dimensions:

| | <u>Surface Area</u> | <u>Depth from Bottom</u> | <u>Pump down depth (from berm)</u> |
|---|----------------------------|---------------------------------|---|
| Center Line Top Berm: | _____ sq. ft. | by <u>11</u> feet depth | |
| Inside Top Berm: | <u>137,836</u> sq. ft. | by <u>11</u> feet depth | |
| Freeboard & Safety Vol: | <u>127,569</u> sq. ft. | by <u>7</u> feet depth | <u>3</u> feet |
| Maximum operating level: | | <u>9.0</u> feet depth | <u>2</u> feet |
| Minimum operating level: | | <u>2.0</u> feet depth | <u>9</u> feet |
| Aerobic BOD design basis: | | <u>2.0</u> feet depth | <u>9</u> feet |
| Storage volume (minimum to maximum water levels): <u>7,248,332</u> gallons | | | |
| Berm top width: <u>10</u> feet Berm runoff area (Centerline to 2 ft freeboard and safety volume): <u>3,840</u> sq. ft. | | | |
| 1-in-10 year annual storm water flows into storage basin (R-E): <u>17,411</u> cu. ft. (130,234 gallons) | | | |

| PERMITTED FEATURE #001 | TABLE A-1. IRRIGATION SYSTEM LIMITATIONS AND MONITORING REQUIREMENTS | | | | PAGE NUMBER 6 of 10 | |
|---|---|-------------------|----------------|-----------------|--------------------------|-------------|
| | | | | | PERMIT NUMBER MO-0098900 | |
| The permittee is authorized to conduct land application of wastewater as specified in the application for this permit. The final limitations shall become effective upon issuance and remain in effect until expiration of the permit. The land application of wastewater shall be controlled, limited and monitored by the permittee as specified below: | | | | | | |
| EFFLUENT PARAMETER(S) | UNITS | FINAL LIMITATIONS | | | MONITORING REQUIREMENTS | |
| | | DAILY MAXIMUM | WEEKLY AVERAGE | MONTHLY AVERAGE | MEASUREMENT FREQUENCY | SAMPLE TYPE |
| Storage Basin Operational Monitoring (Notes 1 & 2) | | | | | | |
| Storage Basin Freeboard (Note 3) | feet | * | | | once/month | measured |
| Precipitation | inches | * | | | daily | total |
| MONITORING REPORTS SHALL BE SUBMITTED <u>ANNUALLY</u> ; THE FIRST REPORT IS DUE <u>JANUARY 28, 2016</u> . | | | | | | |

| PERMITTED FEATURE #002 | TABLE A-2. IRRIGATION SYSTEM LIMITATIONS AND MONITORING REQUIREMENTS | | | | | |
|---|---|-------------------|----------------|-----------------|-------------------------|-------------|
| | The permittee is authorized to conduct land application of wastewater as specified in the application for this permit. The final limitations shall become effective upon issuance and remain in effect until expiration of the permit. The land application of wastewater shall be controlled, limited and monitored by the permittee as specified below: | | | | | |
| EFFLUENT PARAMETER(S) | UNITS | FINAL LIMITATIONS | | | MONITORING REQUIREMENTS | |
| | | DAILY MAXIMUM | WEEKLY AVERAGE | MONTHLY AVERAGE | MEASUREMENT FREQUENCY | SAMPLE TYPE |
| Land Application Operational Monitoring (Note 2) | | | | | | |
| Irrigation Period | hours | * | | | daily | total |
| Volume Irrigated | gallons | * | | | daily | total |
| Application Area | acres | * | | | daily | total |
| Application Rate | inches | * | | | daily | total |
| MONITORING REPORTS SHALL BE SUBMITTED <u>ANNUALLY</u> ; THE FIRST REPORT IS DUE <u>JANUARY 28, 2016</u> . | | | | | | |
| Irrigated Wastewater (Notes 2 & 4) | | | | | | |
| Total Kjeldahl Nitrogen as N (Note 5) | mg/L | * | | | once/month | grab |
| Nitrate Nitrogen as N (Note 5) | mg/L | * | | | once/month | grab |
| MONITORING REPORTS SHALL BE SUBMITTED <u>ANNUALLY</u> ; THE FIRST REPORT IS DUE <u>JANUARY 28, 2016</u> . | | | | | | |

* Monitoring requirement only.

Note 1 - **No-discharge facility requirements.** Wastewater shall be stored and land applied during suitable conditions so that there is no discharge from the storage basin(s) or irrigation site. An emergency discharge may occur when excess wastewater has accumulated above feasible irrigation rates due to precipitation exceeding the 1-in-10-year, 365-day rainfall or the 25-year, 24-hour storm event.

Note 2 - Records shall be maintained and summarized into an annual operating report, which shall be submitted by January 28th of each year for the previous calendar year period using report forms approved by the Department. The summarized annual report is in addition to the reporting requirements listed in Table A. The summarized annual report shall include the following:

- a. Record of maintenance and repairs performed during the year, average number of times per month the facility is checked to see if it is operating properly, and description of any unusual operating conditions encountered during the year;
- b. The number of days the storage basin(s) has discharged during the year, the discharge flow, the reasons discharge occurred and effluent analysis performed; and
- c. A summary of the irrigation operations including freeboard at the start and end of the irrigation season, the number of days of irrigation for each month, the total gallons irrigated, the total acres used, crops grown, crop yields per acre, the application rate in inches/acre per day and for the year, the monthly and annual precipitation received at the facility, a summary of testing results for wastewater and soils, and calculations for nitrogen applied and crop removal of nitrogen.

Note 3 - Storage Basin freeboard shall be reported as Storage Basin water level in feet below the overflow level. See Special Conditions for Wastewater Irrigation System requirements.

Note 4 - Wastewater that is irrigated shall be sampled at the irrigation pump or wet well. If irrigation did not occur during the report period, report as "No Irrigation".

Note 5 - Monitor once per month during the months of March through November. Wastewater irrigation rates shall not exceed a nitrogen application rate of 150 pounds total nitrogen per acre per year, and the applied wastewater shall not exceed ten (10) mg/l of nitrate nitrogen as N. If the nitrogen application exceeds a rate of 150 pounds total nitrogen per acre per year, and/or the applied wastewater exceeds ten (10) mg/l of nitrate nitrogen as N, see Special Condition #18 (j) for additional requirements.

C. STANDARD CONDITIONS

In addition to specified conditions stated herein, this permit is subject to the attached Parts I, II, & III standard conditions dated October 1, 1980, May 1, 2013, and August 15, 1994, and hereby incorporated as though fully set forth herein.

D. SPECIAL CONDITIONS

1. **Emergency Discharge.** An emergency discharge from wastewater storage structures may only occur if rainfall exceeds the 1 in 10 year (Data taken from the Missouri Climate Atlas) or the 24 hour, 25 year (Data taken from NRCS Urban Hydrology for Small Watersheds) rainfall events. **Discharge for any other reason shall constitute a permit violation and shall be reported in accordance with Standard Conditions, Part 1, Section B.2.b.** Monitoring shall take place once per day while discharging. Test results are due on the 28th day of the month after the cessation of the discharge. Permittee shall monitor for the following constituents:

| Constituent | Units |
|--|---------|
| Flow | MGD |
| Biochemical Oxygen Demand ₅ | mg/L |
| Total Suspended Solids | mg/l |
| Ammonia as N | mg/L |
| pH – Units | SU |
| Oil & Grease | mg/L |
| E. coli | #/100mL |

2. This permit may be reopened and modified, or alternatively revoked and reissued, to:
 - (a) Comply with any applicable effluent standard or limitation issued or approved under Sections 301(b)(2)(C) and (D), 304(b)(2), and 307(a) (2) of the Clean Water Act, if the effluent standard or limitation so issued or approved:
 - (1) contains different conditions or is otherwise more stringent than any effluent limitation in the permit; or
 - (2) controls any pollutant not limited in the permit.
 - (b) Incorporate new or modified effluent limitations or other conditions, if the result of a waste load allocation study, toxicity test or other information indicates changes are necessary to assure compliance with Missouri’s Water Quality Standards.
 - (c) Incorporate new or modified effluent limitations or other conditions if, as the result of a watershed analysis, a Total Maximum Daily Load (TMDL) limitation is developed for the receiving waters which are currently included in Missouri’s list of waters of the state not fully achieving the state’s water quality standards, also called the 303(d) list.
 - (d) Incorporate the requirement to develop a pretreatment program pursuant to 40 CFR 403.8(a) when the Director of the Water Protection Program determines that a pretreatment program is necessary due to any new introduction of pollutants into the Publically Owned Treatment Works or any substantial change in the volume or character of pollutants being introduced.

The permit as modified or reissued under this paragraph shall also contain any other requirements of the Clean Water Act then applicable.

3. All permitted features must be clearly marked in the field. The permitted features and land application fields shall also be marked on the aerial or topographic site map included with the Operation and Maintenance manual.
4. Permittee will cease discharge by connection to a facility with an area-wide management plan per 10 CSR 20-6.010(3)(B) within 90 days of notice of its availability.
5. **Water Quality Standards**
 - (a) To the extent required by law, discharges to waters of the state shall not cause a violation of water quality standards rule under 10 CSR 20-7.031, including both specific and general criteria.
 - (b) **General Criteria.** The following general water quality criteria shall be applicable to all waters of the state at all times including mixing zones. No water contaminant, by itself or in combination with other substances, shall prevent the waters of the state from meeting the following conditions:
 - (1) Waters shall be free from substances in sufficient amounts to cause the formation of putrescent, unsightly or harmful bottom deposits or prevent full maintenance of beneficial uses;
 - (2) Waters shall be free from oil, scum and floating debris in sufficient amounts to be unsightly or prevent full maintenance of beneficial uses;
 - (3) Waters shall be free from substances in sufficient amounts to cause unsightly color or turbidity, offensive odor or prevent full maintenance of beneficial uses;
 - (4) Waters shall be free from substances or conditions in sufficient amounts to result in toxicity to human, animal or aquatic life;
 - (5) There shall be no significant human health hazard from incidental contact with the water;
 - (6) There shall be no acute toxicity to livestock or wildlife watering;
 - (7) Waters shall be free from physical, chemical or hydrologic changes that would impair the natural biological community;

D. SPECIAL CONDITIONS (continued)

- (8) Waters shall be free from used tires, car bodies, appliances, demolition debris, used vehicles or equipment and solid waste as defined in Missouri's Solid Waste Law, section 260.200, RSMo, except as the use of such materials is specifically permitted pursuant to section 260.200-260.247.

6. Changes in Discharges of Toxic Substances

The permittee shall notify the Director as soon as it knows or has reason to believe:

- (a) That any activity has occurred or will occur which would result in the discharge of any toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following "notification levels:"
- (1) One hundred micrograms per liter (100 µg/L);
 - (2) Two hundred micrograms per liter (200 µg/L) for acrolein and acrylonitrile; five hundred micrograms per liter (500 µg/L) for 2,5 dinitrophenol and for 2-methyl-4, 6-dinitrophenol; and one milligram per liter (1 mg/L) for antimony;
 - (3) Five (5) times the maximum concentration value reported for the pollutant in the permit application;
 - (4) The level established in Part A of the permit by the Director.
- (b) That they have begun or expect to begin to use or manufacture as an intermediate or final product or byproduct any toxic pollutant, which was not reported in the permit application.

7. Report as no-discharge when a discharge does not occur during the report period.

8. It is a violation of the Missouri Clean Water Law to fail to pay fees associated with this permit (644.055 RSMo).

9. The permittee shall comply with any applicable requirements listed in 10 CSR 20-9, unless the facility has received written notification that the Department has approved a modification to the requirements. The monitoring frequencies contained in this permit shall not be construed by the permittee as a modification of the monitoring frequencies listed in 10 CSR 20-9. If a modification of the monitoring frequencies listed in 10 CSR 20-9 is needed, the permittee shall submit a written request to the department for review and, if deemed necessary, approval.

10. The permittee shall develop and implement a program for maintenance and repair of the collection system. The permittee shall submit a report annually in January to the Southwest Regional Office with the Discharge and Monitoring reports which address measures taken to locate and eliminate sources of infiltration and inflow into the collection system serving the facility for the previous year.

11. Bypasses are not authorized at this facility and are subject to 40 CFR 122.41(m). If a bypass occurs, the permittee shall report in accordance to 40 CFR 122.41(m)(3)(i), and with Standard Condition Part I, Section B, subsection 2.b. Bypasses are to be reported to the Southwest Regional Office.

12. The facility must be sufficiently secured to restrict entry by children, livestock and unauthorized persons as well as to protect the facility from vandalism.

13. A least one gate must be provided to access the wastewater treatment facility and provide for maintenance and mowing. The gate shall remain locked except when opened by the permittee to perform operational monitoring, sampling, maintenance, mowing, or for inspections by the Department.

14. At least one (1) warning sign shall be placed on each side of the facility enclosure in such positions as to be clearly visible from all directions of approach. There shall also be one (1) sign placed for every five hundred feet (500') (150 m) of the perimeter fence. A sign shall also be placed on each gate. Minimum wording shall be SEWAGE TREATMENT FACILITY—KEEP OUT. Signs shall be made of durable materials with characters at least two inches (2") high and shall be securely fastened to the fence, equipment or other suitable locations.

15. The permittee shall develop, maintain and implement an Operation and Maintenance (O&M) Manual that includes all necessary items to ensure the operation and integrity of the waste handling and land application systems, including key operating procedures, an aerial or topographic site map with the permitted features, land application fields, and irrigation buffer zones marked, and a brief summary of the operation of the facility. The O & M manual shall be made available to the operator. A copy of the O&M Manual shall be submitted to the Southwest Regional Office for review and approval by May 5, 2015. Copies of subsequent revisions shall be submitted to the Southwest Regional Office within 30 days of revision. The O&M Manual shall be reviewed and updated at least every five years.

D. SPECIAL CONDITIONS (continued)

16. An all-weather access road shall be provided to the treatment facility.
17. The berms of the storage basin(s) shall be mowed and kept free of any deep-rooted vegetation, animal dens, or other potential sources of damage to the berms.
18. The facility shall ensure that adequate provisions are provided to prevent surface water intrusion into the storage basin(s) and to divert stormwater runoff around the storage basin(s) and protect embankments from erosion.
19. Wastewater Irrigation System.
 - (a) Discharge Reporting. Any unauthorized discharge from the storage basin(s) or irrigation system shall be reported to the department as soon as possible but always within 24 hours. Discharge is allowed only as described in the Facility Description and Effluent Limitations sections of this permit.
 - (b) Storage Basin Operating Levels - No-discharge Systems. The minimum and maximum operating water levels for the storage basin(s) shall be clearly marked. Each storage basin shall be operated so that the maximum water elevation does not exceed one foot below the Emergency Spillway except due to exceedances of the 1-in-10 year, 365-day or 25-year, 24-hour storm events according to National Weather Service data. Wastewater shall be land applied whenever feasible based on soil and weather conditions and permit requirements. Storage basin(s) shall be lowered to the minimum operating level prior to each winter by November 30.
 - (c) Emergency Spillway. Lagoons and earthen storage basins should have an emergency spillway to protect the structural integrity of earthen structures during operation at near full water levels and in the event of overflow conditions. The spillway shall be at least one foot below top of berm.
 - (d) General Irrigation Requirements. The wastewater irrigation system shall be operated so as to provide uniform distribution of irrigated wastewater over the entire irrigation site. A complete ground cover of vegetation shall be maintained on the irrigation site unless the system is approved for row crop irrigation. Wastewater shall be land applied only during daylight hours. The wastewater irrigation system shall be capable of irrigating the annual design flow during an application period of less than 100 days or 800 hours per year.
 - (e) Saturated/Frozen Conditions. There shall be no irrigation during ground frost, frozen, snow covered, or saturated soil conditions, or when precipitation is imminent or occurring.
 - (f) Buffer Zones. There shall be no irrigation within 300 feet of any down gradient pond, lake, sinkhole, losing stream or water supply withdrawal; 100 feet of gaining streams or tributaries; 150 feet of dwelling or public use areas; or 50 feet of the property line.
 - (g) Public Access Restrictions. Public access shall not be allowed to public use area irrigation sites when application is occurring.
 - (h) Irrigated Wastewater Disinfection. Wastewater shall be disinfected prior to land application (not storage) to public use areas.
 - (j) Nitrogen Loading Rates. Wastewater irrigation rates shall not exceed a nitrogen application rate of 150 pounds total nitrogen per acre per year, and the applied wastewater shall not exceed ten (10) mg/l of nitrate nitrogen as N. Hydraulic application rates exceeding 60 inches per acre per year shall calculate nitrogen loading rates and include results in the annual report. The calculation procedures are as follows: $(\text{Total N}) \times (0.226) \times (\text{inches per acre irrigated}) = \text{pounds total N per acre}$. Where $\text{Total N} = [\text{Total Kjeldahl Nitrogen (TKN) as N}] + [\text{Nitrate Nitrogen as N}]$. If the applied wastewater exceeds 150 pounds total nitrogen per acre/year, the permittee must reduce the application rates or submit a revised permit application to request use of the Plant Available Nitrogen (PAN) method based on crop nitrogen requirements for harvested crops, along with calculations to show the amount of plant-available nitrogen provided and the amount of nitrogen that will be utilized by the vegetation to be grown. PAN availability factors for surface application are: $[\text{Ammonia N} \times 0.6] + [\text{Nitrate N} \times 0.9] + [\text{Organic N} \times 0.6] = \text{PAN}$. If the applied wastewater exceeds ten (10) mg/l of nitrate nitrogen as N, then the facility shall submit a revised permit application to request use of the Plant Available Nitrogen (PAN) method based on crop nitrogen requirements for harvested crops, along with calculations to show the amount of plant-available nitrogen provided and the amount of nitrogen that will be utilized by the vegetation to be grown.
 - (k) Equipment Checks during Irrigation. The irrigation system and application site shall be visually inspected at least once/day during wastewater irrigation to check for equipment malfunctions and runoff from the irrigation site.
20. Land Application Sites. To add additional land application sites or convert any of the land to public use areas, a construction permit and permit modification may be required. The facility shall contact the Department for a written determination. Additionally, the O&M Manual shall be updated to include the additional land application site(s) and a copy of the updated sections of the O&M Manual shall be submitted to the Northeast Regional Office in accordance with Special Condition #14.

**MISSOURI DEPARTMENT OF NATURAL RESOURCES
 FACT SHEET
 FOR THE PURPOSE OF UPGRADE/EXPANSION
 OF
 MO-0098990
 WHEATLAND WWTF**

The Federal Water Pollution Control Act ("Clean Water Act" Section 402 Public Law 92-500 as amended) established the National Pollution Discharge Elimination System (NPDES) permit program. This program regulates the discharge of pollutants from point sources into the waters of the United States, and the release of storm water from certain point sources. All such discharges are unlawful without a permit (Section 301 of the "Clean Water Act"). After a permit is obtained, a discharge not in compliance with all permit terms and conditions is unlawful. Missouri State Operating Permits (MSOPs) are issued by the Director of the Missouri Department of Natural Resources (Department) under an approved program, operating in accordance with federal and state laws (Federal "Clean Water Act" and "Missouri Clean Water Law" Section 644 as amended). MSOPs are issued for a period of five (5) years unless otherwise specified.

As per [40 CFR Part 124.8(a)] and [10 CSR 20-6.020(1)2.] a Factsheet shall be prepared to give pertinent information regarding the applicable regulations, rationale for the development of effluent limitations and conditions, and the public participation process for the Missouri State Operating Permit (operating permit) listed below.

A Factsheet is not an enforceable part of an operating permit.

This Factsheet is for a Minor facility.

Part I – Facility Information

Facility Type: POTW - SIC #4952

Facility Description:

Currently there is a 3-cell facultative lagoon system. This permit is drafted to include an upgrade to a land application system requiring the construction of a 4th storage cell near the application field and either a fixed head sprinkler or center pivot wastewater application wastewater system.

Have any changes occurred at this facility or in the receiving water body that effects effluent limit derivation?

- Yes; They have converted to a no discharge system so WET testing, influent monitoring, and the schedule of compliance are no longer needed.

- No.

Application Date: 08/08/2012

Expiration Date: 02/28/2017

PERMITTED FEATURE(S) TABLE:

| PERMITTED FEATURE | DESIGN FLOW (CFS) | TREATMENT LEVEL | EFFLUENT TYPE | DISTANCE TO CLASSIFIED SEGMENT (MI) |
|-------------------|-------------------|------------------|----------------|-------------------------------------|
| #002 | 0.124 | Land Application | Domestic Waste | 7.0 |

Receiving Water Body's Water Quality & Facility Performance History:

This facility was last inspected on June 19, 2012. The inspection showed there were three SSO's in 2011, BOD effluent limit violation November 2011, laboratory procedure issues, and the need for collection system repair.

Comments:

The City will replace the gravity sewers identified in the 2012 smoke testing, replace or repair existing manholes as needed, and rebuild the South Lift Station as well as converting the wastewater treatment to land application.

Part II – Operator Certification Requirements

Applicable ; This facility is required to have a certified operator.

As per [10 CSR 20-6.010(8) Terms and Conditions of a Permit], permittees shall operate and maintain facilities to comply with the Missouri Clean Water Law and applicable permit conditions and regulations. Operators or supervisors of operations at regulated wastewater treatment facilities shall be certified in accordance with [10 CSR 20-9.020(2)] and any other applicable state law or regulation. As per [10 CSR 20-9.020(2)(A)], requirements for operation by certified personnel shall apply to all wastewater treatment systems, if applicable, as listed below:

Check boxes below that are applicable to the facility;

- Owned or operated by or for:
 - Municipalities
 - Public Sewer District:
 - County
 - Public Water Supply Districts:
 - Private sewer company regulated by the Public Service Commission:
 - State or Federal agencies:

Each of the above entities are only applicable if they have a Population Equivalent greater than two hundred (200) and/or fifty (50) or more service connections.

- Department required:
The Department requires this facility to retain the services of a certified operator due to: POTW

This facility currently requires an operator with a D Certification Level operator. Please see **Appendix - Classification Worksheet** Modifications made to the wastewater treatment facility may cause the classification to be modified.

Operator's Name: Kevin Nelson
Certification Number: 10596
Certification Level: D

The listing of the operator above only signifies that staff drafting this operating permit have reviewed appropriate Department records and determined that the name listed on the operating permit application has the correct and applicable Certification Level.

Part III– Operational Monitoring

As per [10 CSR 20-9.010(4)], the facility is not required to conduct operational monitoring.

Part IV – Receiving Stream Information

10 CSR 20-7.031 Missouri Water Quality Standards, the Department defines the Clean Water Commission water quality objectives in terms of "water uses to be maintained and the criteria to protect those uses." The receiving stream and/or 1st classified receiving stream's beneficial water uses to be maintained are located in the Receiving Stream Table located below in accordance with [10 CSR 20-7.031(3)].

RECEIVING STREAM(S) TABLE:

| WATER-BODY NAME | CLASS | WBID | DESIGNATED USES* | 12-DIGIT HUC | EDU** |
|--|-------|-------|-----------------------------------|--------------|-------------|
| Tributary to Little Pomme De Terre River | U | | General Criteria | 10290107 | Ozark/Osage |
| Little Pomme De Terre River | C | 01247 | General Criteria, LWW, AQL, WBC-B | | |

* - Irrigation (IRR), Livestock & Wildlife Watering (LWW), Protection of Warm Water Aquatic Life and Human Health-Fish Consumption (AQL), Cool Water Fishery (CLF), Cold Water Fishery (CDF), Whole Body Contact Recreation (WBC), Secondary Contact Recreation (SCR), Drinking Water Supply (DWS), Industrial (IND), Groundwater (GRW).

** - Ecological Drainage Unit

RECEIVING STREAM MONITORING REQUIREMENTS:

No receiving water monitoring requirements recommended at this time.

Part IV – Rationale and Derivation of Effluent Limitations & Permit Conditions

ALTERNATIVE EVALUATIONS FOR NEW FACILITIES:

As per [10 CSR 20-7.015(4)(A)], discharges to losing streams shall be permitted only after other alternatives including land application, discharges to a gaining stream and connection to a regional wastewater treatment facility have been evaluated and determined to be unacceptable for environmental and/or economic reasons.

Applicable ; This facility discharges to a Losing Stream, as defined by [10 CSR 20-2.010(36)] & [10 CSR 20-7.031(1)(N)], and has submitted an alternative evaluation. Land application is the chosen alternative.

ANTI-BACKSLIDING:

A provision in the Federal Regulations [CWA §303(d)(4); CWA §402(c); 40 CFR Part 122.44(I)] that requires a reissued permit to be as stringent as the previous permit with some exceptions.

- All limits in this operating permit are at least as protective as those previously established; therefore, backsliding does not apply.

ANTIDegradation:

In accordance with Missouri’s Water Quality Standard [10 CSR 20-7.031(2)], the Department is to document by means of Antidegradation Review that the use of a water body’s available assimilative capacity is justified. Degradation is justified by documenting the socio-economic importance of a discharging activity after determining the necessity of the discharge.

- No degradation proposed and no further review necessary. Facility did not apply for authorization to increase pollutant loading or to add additional pollutants to their discharge.

AREA-WIDE WASTE TREATMENT MANAGEMENT & CONTINUING AUTHORITY:

As per [10 CSR 20-6.010(3)(B)], ...An applicant may utilize a lower preference continuing authority by submitting, as part of the application, a statement waiving preferential status from each existing higher preference authority, providing the waiver does not conflict with any area-wide management plan approved under section 208 of the Federal Clean Water Act or any other regional sewage service and treatment plan approved for higher preference authority by the Department.

BIOSOLIDS & SEWAGE SLUDGE:

Biosolids are solid materials resulting from domestic wastewater treatment that meet federal and state criteria for beneficial uses (i.e. fertilizer). Sewage sludge is solids, semi-solids, or liquid residue generated during the treatment of domestic sewage in a treatment works; including but not limited to, domestic septage; scum or solids removed in primary, secondary, or advanced wastewater treatment process; and a material derived from sewage sludge. Sewage sludge does not include ash generated during the firing of sewage sludge in a sewage sludge incinerator or grit and screening generated during preliminary treatment of domestic sewage in a treatment works. Additional information regarding biosolids and sludge is located at the following web address: <http://dnr.mo.gov/env/wpp/pub/index.html>, items WQ422 through WQ449.

- Permittee is not authorized to land apply biosolids. Sludge/biosolids are removed by contract hauler, incinerated, stored in the lagoon, etc.

The permittee must submit a sludge management plan for approval that details removal and disposal plans when sludge is to be removed from lagoons.

COMPLIANCE AND ENFORCEMENT:

Enforcement is the action taken by the Water Protection Program (WPP) to bring an entity into compliance with the Missouri Clean Water Law, its implementing regulations, and/or any terms and conditions of an operating permit. The primary purpose of the enforcement activity in the WPP is to resolve violations and return the entity to compliance.

Not Applicable ; The permittee/facility is not currently under Water Protection Program enforcement action.

PRETREATMENT PROGRAM:

The reduction of the amount of pollutants, the elimination of pollutants, or the alteration of the nature of pollutant properties in wastewater prior to or in lieu of discharging or otherwise introducing such pollutants into a Publicly Owned Treatment Works [40 CFR Part 403.3(q)].

Pretreatment programs are required at any POTW (or combination of POTW operated by the same authority) and/or municipality with a total design flow greater than 5.0 MGD and receiving industrial wastes that interfere with or pass through the treatment works or are otherwise subject to the pretreatment standards. Pretreatment programs can also be required at POTWs/municipals with a design flow less than 5.0 MGD if needed to prevent interference with operations or pass through.

Several special conditions pertaining to the permittee's pretreatment program may be included in the permit, and are as follows:

- Implementation and enforcement of the program,
- Annual pretreatment report submittal,
- Submittal of list of industrial users,
- Technical evaluation of need to establish local limitations, and
- Submittal of the results of the evaluation

Not Applicable ; The permittee, at this time, is not required to have a Pretreatment Program or does not have an approved pretreatment program.

REASONABLE POTENTIAL ANALYSIS (RPA):

Federal regulation [40 CFR Part 122.44(d)(1)(i)] requires effluent limitations for all pollutants that are or may be discharged at a level that will cause or have the reasonable potential to cause or contribute to an in-stream excursion above narrative or numeric water quality standard.

Not Applicable ; A RPA was not conducted for this facility.

REMOVAL EFFICIENCY:

Removal efficiency is a method by which the Federal Regulations define Secondary Treatment and Equivalent to Secondary Treatment, which applies to Biochemical Oxygen Demand 5-day (BOD₅) and Total Suspended Solids (TSS) for Publicly Owned Treatment Works (POTWs)/municipals.

Not Applicable ; Influent monitoring is not being required as facility has no discharge, therefore percent removal is not applicable.

SANITARY SEWER OVERFLOWS (SSO) AND INFLOW AND INFILTRATION (I&I):

Sanitary Sewer Overflows (SSOs) are defined as an untreated or partially treated sewage release are considered bypassing under state regulation [10 CSR 20-2.010(11)] and should not be confused with the federal definition of bypass. SSO's have a variety of causes including blockages, line breaks, and sewer defects that allow excess storm water and ground water to (1) enter and overload the collection system, and (2) overload the treatment facility. Additionally, SSO's can be also be caused by lapses in sewer system operation and maintenance, inadequate sewer design and construction, power failures, and vandalism. SSOs also include overflows out of manholes and onto city streets, sidewalks, and other terrestrial locations.

Additionally, Missouri RSMo §644.026.1 mandates that the Department require proper maintenance and operation of treatment facilities and sewer systems and proper disposal of residual waste from all such facilities.

- In accordance with Missouri RSMo §644.026.1.(15) and 40 CFR Part 122.41(e), the permittee is required to develop and/or implement a program for maintenance and repair of the collection system and shall be required in this operating permit by either means of a Special Condition or Schedule of Compliance. In addition, the Department considers the development of this program as an implementation of this condition. Additionally, 40 CFR Part 403.3(o) defines a POTW to include any device and systems used in the storage, treatment, recycling and reclamation of municipal sewage or industrial wastes of liquid nature. It also includes sewers, pipes, and other conveyances only if they convey wastewater to a POTW Treatment Plant.

At this time, the Department recommends the US EPA's Guide for Evaluating Capacity, Management, Operation and Maintenance (CMOM) Programs At Sanitary Sewer Collection Systems (Document # EPA 305-B-05-002). The CMOM identifies some of the criteria used by the EPA to evaluate a collection system's management, operation, and maintenance and was intended for use by the EPA, state, regulated community, and/or third party entities. The CMOM is applicable to small, medium, and large systems; both public and privately owned; and both regional and satellite collection systems. The CMOM does not substitute for the Clean Water Act, the Missouri Clean Water Law, and both federal and state regulations, as it is not a regulation.

SCHEDULE OF COMPLIANCE (SOC):

A schedule of remedial measures included in a permit, including an enforceable sequence of interim requirements (actions, operations, or milestone events) leading to compliance with the Missouri Clean Water Law, its implementing regulations, and/or the terms and conditions of an operating permit.

Not Applicable ; This permit does not contain a SOC.

STORM WATER POLLUTION PREVENTION PLAN (SWPPP):

In accordance with 40 CFR 122.44(k) *Best Management Practices (BMPs)* to control or abate the discharge of pollutants when:
(1) Authorized under section 304(e) of the Clean Water Act (CWA) for the control of toxic pollutants and hazardous substances from ancillary industrial activities; (2) Authorized under section 402(p) of the CWA for the control of storm water discharges; (3) Numeric effluent limitations are infeasible; or (4) the practices are reasonably necessary to achieve effluent limitations and standards or to carry out the purposes and intent of the CWA.

In accordance with the EPA's *Developing Your Stormwater Pollution Prevention Plan, A Guide for Industrial Operators*, (Document number EPA 833-B-09-002) [published by the United States Environmental Protection Agency (USEPA) in February 2009], BMPs are measures or practices used to reduce the amount of pollution entering (regarding this operating permit) waters of the state. BMPs may take the form of a process, activity, or physical structure.

Additionally in accordance with the Storm Water Management, a SWPPP is a series of steps and activities to (1) identify sources of pollution or contamination, and (2) select and carry out actions which prevent or control the pollution of storm water discharges.

Not Applicable ; At this time, the permittee is not required to develop and implement a SWPPP.

VARIANCE:

As per the Missouri Clean Water Law § 644.061.4, variances shall be granted for such period of time and under such terms and conditions as shall be specified by the commission in its order. The variance may be extended by affirmative action of the commission. In no event shall the variance be granted for a period of time greater than is reasonably necessary for complying with the Missouri Clean Water Law §§644.006 to 644.141 or any standard, rule or regulation promulgated pursuant to Missouri Clean Water Law §§644.006 to 644.141.

Not Applicable ; This operating permit is not drafted under premises of a petition for variance.

WASTELOAD ALLOCATIONS (WLA) FOR LIMITS:

As per [10 CSR 20-2.010(78)], the amount of pollutant each discharger is allowed by the Department to release into a given stream after the Department has determined total amount of pollutant that may be discharged into that stream without endangering its water quality.

Not Applicable ; Wasteload allocations were not calculated.

WLA MODELING:

There are two general types of effluent limitations, technology-based effluent limits (TBELs) and water quality based effluent limits (WQBELs). If TBELs do not provide adequate protection for the receiving waters, then WQBEL must be used.

Not Applicable ; A WLA study was either not submitted or determined not applicable by Department staff.

WATER QUALITY STANDARDS:

Per [10 CSR 20-7.031(3)], General Criteria shall be applicable to all waters of the state at all times including mixing zones. Additionally, [40 CFR 122.44(d)(1)] directs the Department to establish in each NPDES permit to include conditions to achieve water quality established under Section 303 of the Clean Water Act, including State narrative criteria for water quality.

WHOLE EFFLUENT TOXICITY (WET) TEST:

A WET test is a quantifiable method of determining if a discharge from a facility may be causing toxicity to aquatic life by itself, in combination with or through synergistic responses when mixed with receiving stream water.

Not Applicable ; At this time, the permittee is not required to conduct WET test for this facility. This facility is a no-discharge Land Application treatment system.

40 CFR 122.41(M) - BYPASSES:

The federal Clean Water Act (CWA), Section 402 prohibits wastewater dischargers from "bypassing" untreated or partially treated sewage (wastewater) beyond the headworks. A bypass is defined as an intentional diversion of waste streams from any portion of a treatment facility, [40 CFR 122.41(m)(1)(i)]. Additionally, Missouri regulation 10 CSR 20-2.010(11) defines a bypass as the diversion of wastewater from any portion of wastewater treatment facility or sewer system to waters of the state. Only under exceptional and specified limitations do the federal regulations allow for a facility to bypass some or all of the flow from its treatment process. Bypasses are prohibited by the CWA unless a permittee can meet all of the criteria listed in 40 CFR 122.41(m)(4)(i)(A), (B), & (C). Any bypasses from this facility are subject to the reporting required in 40 CFR 122.41(l)(6) and per Missouri's Standard Conditions I, Section B, part 2.b. Additionally, Anticipated Bypasses include bypasses from peak flow basins or similar devices designed for peak wet weather flows.

Not Applicable ; This facility does not anticipate bypassing.

303(d) LIST & TOTAL MAXIMUM DAILY LOAD (TMDL):

Section 303(d) of the federal Clean Water Act requires that each state identify waters that are not meeting water quality standards and for which adequate water pollution controls have not been required. Water quality standards protect such beneficial uses of water as whole body contact (such as swimming), maintaining fish and other aquatic life, and providing drinking water for people, livestock and wildlife. The 303(d) list helps state and federal agencies keep track of waters that are impaired but not addressed by normal water pollution control programs.

A TMDL is a calculation of the maximum amount of a given pollutant that a body of water can absorb before its water quality is affected. If a water body is determined to be impaired as listed on the 303(d) list, then a watershed management plan will be developed that shall include the TMDL calculation

Not Applicable ; This facility does not discharge to a 303(d) listed stream.

Part V – Permit Limits Determination

APPLICABLE DESIGNATIONS OF WATERS OF THE STATE:

As per Missouri’s Effluent Regulations [10 CSR 20-7.015], the waters of the state are divided into the below listed seven (7) categories. Each category lists effluent limitations for specific parameters, which are presented in each permitted feature’s Effluent Limitation Table and further discussed in the Derivation & Discussion of Limits section.

- Missouri or Mississippi River [10 CSR 20-7.015(2)]:
- Lake or Reservoir [10 CSR 20-7.015(3)]:
- Losing [10 CSR 20-7.015(4)]:
- Metropolitan No-Discharge [10 CSR 20-7.015(5)]:
- Special Stream [10 CSR 20-7.015(6)]:
- Subsurface Water [10 CSR 20-7.015(7)]:
- All Other Waters [10 CSR 20-7.015(8)]:

Permitted Feature #001 – Emergency Discharge

There are no effluent limits associated with Permitted Feature #001 for the no-discharge facility. However, the following is required for an emergency discharge.

EMERGENCY DISCHARGE TABLE:

| PARAMETER | UNIT | BASIS FOR LIMITS | DAILY MAXIMUM | WEEKLY AVERAGE | MONTHLY AVERAGE | MODIFIED | PREVIOUS PERMIT LIMITATIONS |
|--|--|------------------|---------------|----------------|-----------------|----------|-----------------------------|
| Flow | MGD | 9 | * | | | NO | * |
| Biochemical Oxygen Demand ₅ | mg/L | 9 | * | | | YES | 15/10 |
| Total Suspended Solids | mg/L | 9 | * | | | YES | 20/15 |
| Ammonia as N | mg/L | 9 | * | | | YES | 4.6/1.3 11.7/2.6 |
| pH | SU | 9 | * | | | YES | ≥ 6.5 |
| E.coli | ** | 9 | * | | | YES | 126 |
| Nitrate | mg/L | 9 | * | | | YES | *** |
| Oil and Grease | mg/L | 9 | * | | | YES | 15/10 |
| Monitoring Frequency | Please see Minimum Sampling and Reporting Frequency Requirements in the Derivation and Discussion Section below. | | | | | | |

* - Monitoring requirement only
 ** - # of colonies/100mL; the Monthly Average for Fecal Coliform is a geometric mean.
 *** - Parameter not previously established in previous state operating permit.

Basis for Limitations Codes:

- | | |
|--|------------------------------------|
| 1. State or Federal Regulation/Law | 7. Antidegradation Policy |
| 2. Water Quality Standard (includes RPA) | 8. Water Quality Model |
| 3. Water Quality Based Effluent Limits | 9. Best Professional Judgment |
| 4. Lagoon Policy | 10. TMDL or Permit in lieu of TMDL |
| 5. Ammonia Policy | 11. WET test Policy |
| 6. Dissolved Oxygen Policy | |

• **Minimum Sampling and Reporting Frequency Requirements.**

| PARAMETER | SAMPLING FREQUENCY | REPORTING FREQUENCY |
|--|----------------------------|--|
| Flow | once/day while discharging | Test results are due on the 28 th day of the month after the cessation of the discharge |
| Biochemical Oxygen Demand ₅ | once/day while discharging | |
| Total Suspended Solids | once/day while discharging | |
| Ammonia as N | once/day while discharging | |
| pH | once/day while discharging | |
| E.coli | once/day while discharging | |
| Oil and Grease | once/day while discharging | |

PERMITTED FEATURE #001 – STORAGE BASIN

IRRIGATION LIMITATIONS TABLE:

| PARAMETER | UNIT | BASIS FOR LIMITS | DAILY MAXIMUM | WEEKLY AVERAGE | MONTHLY AVERAGE | MODIFIED | PREVIOUS PERMIT LIMITATIONS |
|----------------------|--|------------------|---------------|----------------|-----------------|----------|-----------------------------|
| Freeboard | feet | 1 | * | | | YES | ** |
| Precipitation | inches | 1 | * | | | YES | ** |
| Monitoring Frequency | Please see Minimum Sampling and Reporting Frequency Requirements in the Derivation and Discussion Section below. | | | | | | |

* - Monitoring requirement only.

** - Parameter not previously established in previous state operating permit.

Basis for Limitations Codes:

- | | |
|--|------------------------------------|
| 1. State or Federal Regulation/Law | 7. Antidegradation Policy |
| 2. Water Quality Standard (includes RPA) | 8. Water Quality Model |
| 3. Water Quality Based Effluent Limits | 9. Best Professional Judgment |
| 4. Lagoon Policy | 10. TMDL or Permit in lieu of TMDL |
| 5. Ammonia Policy | 11. WET Test Policy |
| 6. Antidegradation Review | |

PERMITTED FEATURE #001 – DERIVATION AND DISCUSSION OF LIMITS:

- **Freeboard.** Monitoring requirement only.
- **Precipitation.** Monitoring requirement only.

Minimum Sampling and Reporting Frequency Requirements.

| PARAMETER | SAMPLING FREQUENCY | REPORTING FREQUENCY |
|---------------|--------------------|---------------------|
| Freeboard | once/month | once/year |
| Precipitation | once/day | once/year |

PERMITTED FEATURE #002 – IRRIGATION FIELD

| PARAMETER | UNIT | BASIS FOR LIMITS | DAILY MAXIMUM | WEEKLY AVERAGE | MONTHLY AVERAGE | MODIFIED | PREVIOUS PERMIT LIMITATIONS |
|-------------------------|--|------------------|---------------|----------------|-----------------|----------|-----------------------------|
| Irrigation Period | hours | 1 | * | | | YES | ** |
| Volume Irrigated | gallons | 1 | * | | | YES | ** |
| Application Area | acres | 1 | * | | | YES | ** |
| Application Rate | inches | 1 | * | | | YES | ** |
| Total Kjeldahl Nitrogen | mg/L | 1 | * | | | YES | ** |
| Nitrate Nitrogen as N | mg/L | 1 | * | | | YES | ** |
| Monitoring Frequency | Please see Minimum Sampling and Reporting Frequency Requirements in the Derivation and Discussion Section below. | | | | | | |

* - Monitoring requirement only.

** - Parameter not previously established in previous state operating permit.

*** - # of colonies/100mL; the Monthly Average for Fecal Coliform is a geometric mean.

Basis for Limitations Codes:

- | | |
|--|------------------------------------|
| 1. State or Federal Regulation/Law | 7. Antidegradation Policy |
| 2. Water Quality Standard (includes RPA) | 8. Water Quality Model |
| 3. Water Quality Based Effluent Limits | 9. Best Professional Judgment |
| 4. Lagoon Policy | 10. TMDL or Permit in lieu of TMDL |
| 5. Ammonia Policy | 11. WET Test Policy |
| 6. Antidegradation Review | |

- **Irrigation Period.** Monitoring requirement only. Monitoring for the Irrigation Period is included to determine if proper application is occurring on the land application fields.
- **Volume Irrigated.** Monitoring requirement only. Monitoring for the Volume Irrigated is included to determine if proper application is occurring on the land application fields.
- **Application Area.** Monitoring requirement only. Monitoring for the Application Area is included to determine if proper application is occurring on the land application fields.
- **Application Rate.** Monitoring requirement only. Monitoring for the Application Rate is included to determine if proper application is occurring on the land application fields.
- **Total Kjeldahl Nitrogen.** Monitoring requirement only. Monitoring for Total Kjeldahl Nitrogen as N is included to determine nutrient loading rates on the land application fields. [10 CSR 20-8.020(15)(F)7.]
- **Nitrate Nitrogen as N.** Monitoring requirement only. Monitoring for Nitrate Nitrogen as N is included to determine nutrient loading rates on the land application fields. [10 CSR 20-8.020(15)(F)7.]

Minimum Sampling and Reporting Frequency Requirements.

| PARAMETER | SAMPLING FREQUENCY | REPORTING FREQUENCY |
|-------------------------|--------------------|---------------------|
| Irrigation Period | once/day | once/year |
| Volume Irrigated | once/day | once/year |
| Application Area | once/day | once/year |
| Application Rate | once/day | once/year |
| Total Kjeldahl Nitrogen | once/month | once/year |
| Nitrate Nitrogen as N | once/month | once/year |

Sampling Frequency Justification:

This facility is a new facility. Monthly sampling is required to determine if the facility will be in compliance with the operating permit in accordance with Appendix U of Missouri’s Water Pollution Control Permit Manual.

Sampling Type Justification

Due to the discharge being from irrigation, grab sample is more appropriate.

Part VI – Finding of Affordability

Pursuant to Section 644.145, RSMo., the Department is required to determine whether a permit or decision is affordable and makes a finding of affordability for certain permitting and enforcement decisions. This requirement applies to discharges from combined or separate sanitary sewer systems or publically-owned treatment works.

Applicable; The Department is required to determine findings of affordability because the permit applies to a **combined or separate sanitary sewer system for a publically-owned treatment works.**

Finding of affordability - The department has made a reasonable search for empirical data indicating the permit is affordable. The search consisted of a review of department records that might contain economic data on the community, a review of information provided by the applicant as part of the application, and public comments received in response to public notices of this draft permit. If the empirical cost data was used by the permit writer, this data may consist of median household income, any other ongoing projects that the Department has knowledge, and other demographic financial information that the community provided as contemplated by Section 644. 145.3. See **Appendix – Affordability Analysis**

Part VII – Administrative Requirements

On the basis of preliminary staff review and the application of applicable standards and regulations, the Department, as administrative agent for the Missouri Clean Water Commission, proposes to issue a permit(s) subject to certain effluent limitations, schedules, and special conditions contained herein and within the operating permit. The proposed determinations are tentative pending public comment.

PERMIT SYNCHRONIZATION:

The Department of Natural Resources is currently undergoing a synchronization process for operating permits. Permits are normally issued on a five-year term, but to achieve synchronization many permits will need to be issued for less than the full five years allowed by regulation. The intent is that all permits within a watershed will move through the Watershed Based Management (WBM) cycle together will all expire in the same fiscal year. This will allow further streamlining by placing multiple permits within a smaller geographic area on public notice simultaneously, thereby reducing repeated administrative efforts. This will also allow the department to explore a watershed based permitting effort at some point in the future.

PUBLIC NOTICE:

The Department shall give public notice that a draft permit has been prepared and its issuance is pending. Additionally, public notice will be issued if a public hearing is to be held because of a significant degree of interest in and water quality concerns related to a draft permit. No public notice is required when a request for a permit modification or termination is denied; however, the requester and permittee must be notified of the denial in writing.

The Department must issue public notice of a pending operating permit or of a new or reissued statewide general permit. The public comment period is the length of time not less than 30 days following the date of the public notice which interested persons may submit written comments about the proposed permit.

For persons wanting to submit comments regarding this proposed operating permit, then please refer to the Public Notice page located at the front of this draft operating permit. The Public Notice page gives direction on how and where to submit appropriate comments.

The Public Notice period for this operating permit was from December 28, 2012 through January 28, 2013. No responses received or responses to the Public Notice of this operating permit do not warrant the modification of effluent limits and/or the terms and conditions of this permit.

DATE OF FACT SHEET: NOVEMBER 6, 2012

REVISED: FEBRUARY 20, 2015

COMPLETED BY:

CINDY LE PAGE, P.E., ENVIRONMENTAL ENGINEER III
MISSOURI DEPARTMENT OF NATURAL RESOURCES
WATER PROTECTION PROGRAM
ENGINEERING SECTION
(573) 751-6618
cindy.lepage@dnr.mo.gov

Appendices

APPENDIX - CLASSIFICATION WORKSHEET:

| ITEM | POINTS POSSIBLE | POINTS ASSIGNED |
|---|--|-----------------|
| Maximum Population Equivalent (P.E.) served (Max 10 pts.) | 1 pt./10,000 PE or major fraction thereof. | 1 |
| Maximum: 10 pt Design Flow (avg. day) or peak month; use greater (Max 10 pts.) | 1 pt. / MGD or major fraction thereof. | 1 |
| EFFLUENT DISCHARGE RECEIVING WATER SENSITIVITY: | | |
| Missouri or Mississippi River | 0 | |
| All other stream discharges except to losing streams and stream reaches supporting whole body contact | 1 | |
| Discharge to lake or reservoir outside of designated whole body contact recreational area | 2 | |
| Discharge to losing stream, or stream, lake or reservoir area supporting whole body contact recreation | 3 | |
| PRELIMINARY TREATMENT - Headworks | | |
| Screening and/or comminution | 3 | |
| Grit removal | 3 | |
| Plant pumping of main flow (lift station at the headworks) | 3 | |
| PRIMARY TREATMENT | | |
| Primary clarifiers | 5 | |
| Combined sedimentation/digestion | 5 | |
| Chemical addition (except chlorine, enzymes) | 4 | |
| REQUIRED LABORATORY CONTROL – performed by plant personnel (highest level only) | | |
| Push – button or visual methods for simple test such as pH, Settleable solids | 3 | |
| Additional procedures such as DO, COD, BOD, titrations, solids, volatile content | 5 | |
| More advanced determinations such as BOD seeding procedures, fecal coliform, nutrients, total oils, phenols, etc. | 7 | |
| Highly sophisticated instrumentation, such as atomic absorption and gas chromatograph | 10 | |
| ALTERNATIVE FATE OF EFFLUENT | | |
| Direct reuse or recycle of effluent | 6 | |
| Land Disposal – low rate | 3 | 3 |
| High rate | 5 | |
| Overland flow | 4 | |
| Total from page ONE (1) | ---- | 5 |

APPENDIX - CLASSIFICATION WORKSHEET (CONTINUED):

| ITEM | POINTS POSSIBLE | POINTS ASSIGNED |
|--|-----------------|-----------------|
| VARIATION IN RAW WASTE (highest level only) (DMR exceedances and Design Flow exceedances) | | |
| Variation do not exceed those normally or typically expected | 0 | |
| Recurring deviations or excessive variations of 100 to 200 % in strength and/or flow | 2 | |
| Recurring deviations or excessive variations of more than 200 % in strength and/or flow | 4 | |
| Raw wastes subject to toxic waste discharge | 6 | |
| SECONDARY TREATMENT | | |
| Trickling filter and other fixed film media with secondary clarifiers | 10 | |
| Activated sludge with secondary clarifiers (including extended aeration and oxidation ditches) | 15 | |
| Stabilization ponds without aeration | 5 | 5 |
| Aerated lagoon | 8 | |
| Advanced Waste Treatment Polishing Pond | 2 | |
| Chemical/physical – without secondary | 15 | |
| Chemical/physical – following secondary | 10 | |
| Biological or chemical/biological | 12 | |
| Carbon regeneration | 4 | |
| DISINFECTION | | |
| Chlorination or comparable | 5 | |
| Dechlorination | 2 | |
| On-site generation of disinfectant (except UV light) | 5 | |
| UV light | 4 | |
| SOLIDS HANDLING - SLUDGE | | |
| Solids Handling Thickening | 5 | |
| Anaerobic digestion | 10 | |
| Aerobic digestion | 6 | |
| Evaporative sludge drying | 2 | |
| Mechanical dewatering | 8 | |
| Solids reduction (incineration, wet oxidation) | 12 | |
| Land application | 6 | |
| Total from page TWO (2) | ---- | 5 |
| Total from page ONE (1) | --- | 5 |
| Grand Total | --- | 10 |

- A: 71 points and greater
- B: 51 points – 70 points
- C: 26 points – 50 points
- D: 0 points – 25 points

APPENDIX – AFFORDABILITY ANALYSIS:

Missouri Department of Natural Resources
Water Protection Program
Affordability Determination and Finding
(In accordance with RSMo 644.145)

Modification due to Construction/Upgrade
City of Wheatland WWTF
MO-0098990

Section 644.145 RSMo requires the Missouri Department of Natural Resources to make a “finding of affordability” when “issuing permits under” or “enforcing provisions of” state or federal clean water laws “pertaining to any portion of a combined or separate sanitary sewer system or publicly-owned treatment works.”

Description:

The facility is converting from a three cell lagoon system that discharges to waters of the state, to a non-discharging land application system in anticipation of future ammonia limits.

New Permit Requirements or Requirements Now Being Enforced:

The facility is converting from a discharging system to a non-discharging land application system in anticipation of future ammonia limits.

Range of Anticipated Costs Associated with Complying with Requirements:

The facility is converting from a discharging system to a non-discharging system. The testing, monitoring and reporting requirements for a land application permit represents sharply reduced costs to the permittee when compared to the requirements for a discharging system.

(1) A community’s financial capability and ability to raise or secure necessary funding:

Wheatland has secured \$564,000 loan money and \$440,000 grant money from the United States Department of Agriculture Rural Development (RD) to complete this project. The loan has an interest rate of 3.375% for 33 years.¹

(2) Affordability of pollution control options for the individuals or households of the community:

| | |
|--|---------------|
| Estimated Resulting User Rate and/or Cost per Household ² : | <u>33.92</u> |
| Median Household Income ² : | <u>17,500</u> |
| Rate and/or Cost per Household as a Percent of Median Household Income ² : | <u>2.33%</u> |

Wheatland has secured loan and grant money from RD to complete this project. By the obligation of funds, RD has established Wheatland is financially capable to complete this project.

(3) An evaluation of the overall costs and environmental benefits of the control technologies:

Land application of municipal wastewater does not have a discharge to water of the State and therefore testing, monitoring and reporting requirements are significantly reduced.

¹ Provided in an email dated October 30, 2012 from Tim Rickabaugh, Missouri-USDA Rural Development.

(4) An inclusion of ways to reduce economic impacts on distressed populations in the community, including but not limited to, low and fixed income populations. This requirement includes but is not limited to:

(a) Allowing adequate time in implementation schedules to mitigate potential adverse impacts on distressed populations resulting from the costs of the improvements and taking into consideration local community economic considerations; and

(b) Allowing for reasonable accommodations for regulated entities when inflexible standards and fines would impose a disproportionate financial hardship in light of the environmental benefits to be gained.

Opportunity for cost savings or cost avoidance:

None Noted.

Opportunity for changes to implementation/compliance schedule, new technology, site specific criteria, use attainability analysis:

None Noted.

(5) An assessment of other community investments relating to environmental improvements:

None Noted

(6) An assessment of factors set forth in the United States Environmental Protection Agency's guidance, including but not limited to the "Combined Sewer Overflow Guidance for Financial Capability Assessment and Schedule Development" that may ease the cost burdens of implementing wet weather control plans, including but not limited to, small system considerations, the attainability of water quality standards, and the development of wet weather standards:

See Section (2) of this analysis for the residential indicator as outlined in the above-referenced EPA guidance.

Wheatland has secured loan and grant money from RD to complete this project. By the obligation of funds, RD has established Wheatland is financially capable to complete this project.

(7) An assessment of any other relevant local community economic condition.

A significant change has occurred that will affect the future water and wastewater needs of Wheatland. The Lucas Oil Company purchased an existing small scale race track on the southeast corner of the city and has developed this facility into a major race track which will not only generate high demands on the existing facilities, but will encourage peripheral growth around the City in the form of lodging and restaurant facilities.³

Conclusion and Finding

The facility is converting from a discharging system to a non-discharging system. Due to decreases in testing, monitoring and reporting requirements this permit represents sharply reduced operational costs to the permittee. And by the obligation of funds, RD has established Wheatland is financially capable of completing this project.

As a result of reviewing the above criteria, the Department hereby finds that the action described above will result in a low burden with regard to the community's overall financial capability and a high financial impact for most individual customers/households.

² City of Wheatland Wastewater System Improvements Proposed Financial Budget submitted by Meco Engineering Co., Inc. on October 20, 2009 to the Missouri Water and Wastewater Review Committee.

³ City of Wheatland, Missouri Wastewater Facilities Design Engineering Report dated September 7, 2011 submitted by Meco Engineering Company, Inc., p.2.

**STANDARD CONDITIONS FOR NPDES PERMITS
ISSUED BY
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION**

**Revised
October 1, 1980**

**PART I - GENERAL CONDITIONS
SECTION A - MONITORING AND REPORTING**

1. **Representative Sampling**
 - a. Samples and measurements taken as required herein shall be representative of the nature and volume, respectively, of the monitored discharge. All samples shall be taken at the outfall(s), and unless specified, before the effluent joins or is diluted by any other body of water or substance.
 - b. Monitoring results shall be recorded and reported on forms provided by the Department, postmarked no later than the 28th day of the month following the completed reporting period. Signed copies of these, and all other reports required herein, shall be submitted to the respective Department Regional Office, the Regional Office address is indicated in the cover letter transmitting the permit.
2. **Schedule of Compliance**

No later than fourteen (14) calendar days following each date identified in the "Schedule of Compliance", the permittee shall submit to the respective Department Regional Office as required therein, either a report of progress or, in the case of specific actions being required by identified dates, a written notice of compliance or noncompliance. In the latter case, the notice shall include the cause of noncompliance, any remedial actions taken, and the probability of meeting the next scheduled requirements, or if there are no more scheduled requirements, when such noncompliance will be corrected. The Regional Office address is indicated in the cover letter transmitting the permit.
3. **Definitions**

Definitions as set forth in the Missouri Clean Water Law and Missouri Clean Water Commission Definition Regulation 10 CSR 20-2.010 shall apply to terms used herein.
4. **Test Procedures**

Test procedures for the analysis of pollutant shall be in accordance with the Missouri Clean Water Commission Effluent Regulation 10 CSR 20-7015.
5. **Recording of Results**
 - a. For each measurement or sample taken pursuant to the requirements of this permit, the permittee shall record the following information:
 - (i) the date, exact place, and time of sampling or measurements;
 - (ii) the individual(s) who performed the sampling or measurements;
 - (iii) the date(s) analyses were performed;
 - (iv) the individual(s) who performed the analyses;
 - (v) the analytical techniques or methods used; and
 - (vi) the results of such analyses.
 - b. The Federal Clean Water Act provides that any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under this permit shall, upon conviction, be punished by a fine of not more than \$10,000 per violation, or by imprisonment for not more than six (6) months per violation, or both.
 - c. Calculations for all limitations which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified by the Director in the permit.
6. **Additional Monitoring by Permittee**

If the permittee monitors any pollutant at the location(s) designated herein more frequently than required by this permit, using approved analytical methods as specified above, the results of such monitoring shall be included in the calculation and reporting of the values required in the Monitoring Report Form. Such increased frequency shall also be indicated.

7. **Records Retention**

The permittee shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recording for continuous monitoring instrumentation, copies of all reports required by this permit, and records of all data used to complete the application for this permit, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Department at any time.

SECTION B - MANAGEMENT REQUIREMENTS

1. **Change in Discharge**
 - a. All discharges authorized herein shall be consistent with the terms and conditions of this permit. The discharge of any pollutant not authorized by this permit or any pollutant identified in this permit more frequently than or at a level in excess of that authorized shall constitute a violation of the permit.
 - b. Any facility expansions, production increases, or process modifications which will result in new, different, or increased discharges of pollutants shall be reported by submission of a new NPDES application at least sixty (60) days before each such change, or, if they will not violate the effluent limitations specified in the permit, by notice to the Department at least thirty (30) days before such changes.
2. **Noncompliance Notification**
 - a. If, for any reason, the permittee does not comply with or will be unable to comply with any daily maximum effluent limitation specified in this permit, the permittee shall provide the Department with the following information, in writing within five (5) days of becoming aware of such conditions:
 - (i) a description of the discharge and cause of noncompliance, and
 - (ii) the period of noncompliance, including exact dates and times or, if not corrected, the anticipated time the noncompliance is expected to continue, and steps being taken to reduce, eliminate and prevent recurrence of the noncomplying discharge.
 - b. Twenty-four hour reporting. The permittee shall report any noncompliance which may endanger health or the environment. Any information shall be provided orally with 24 hours from the time the permittee becomes aware of the circumstances. A written submission shall also be provided with five (5) days of the time the permittee becomes aware of the circumstances. The Department may waive the written report on a case-by-case basis if the oral report has been received within 24 hours.
3. **Facilities Operation**

Permittees shall operate and maintain facilities to comply with the Missouri Clean Water Law and applicable permit conditions. Operators or supervisors of operations at publicly owned or publicly regulated wastewater treatment facilities shall be certified in accordance with 10 CSR 209.020(2) and any other applicable law or regulation. Operators of other wastewater treatment facilities, water contaminant source or point sources, shall, upon request by the Department, demonstrate that wastewater treatment equipment and facilities are effectively operated and maintained by competent personnel.
4. **Adverse Impact**

The permittee shall take all necessary steps to minimize any adverse impact to waters of the state resulting from noncompliance with any effluent limitations specified in this permit or set forth in the Missouri Clean Water Law and Regulations (hereinafter the Law and Regulations), including such accelerated or additional monitoring as necessary to determine the nature and impact of the noncomplying discharge.

- a. Any bypass or shut down of a wastewater treatment facility and tributary sewer system or any part of such a facility and sewer system that results in a violation of permit limits or conditions is prohibited except:
 - (i) where unavoidable to prevent loss of life, personal injury, or severe property damages; and
 - (ii) where unavoidable excessive storm drainage or runoff would catastrophically damage any facilities or processes necessary for compliance with the effluent limitations and conditions of this permit;
 - (iii) where maintenance is necessary to ensure efficient operation and alternative measures have been taken to maintain effluent quality during the period of maintenance.
 - b. The permittee shall notify the Department in writing of all bypasses or shut down that result in a violation of permit limits or conditions. This section does not excuse any person from liability, unless such relief is otherwise provided by the statute.
6. **Removed Substances**
Solids, sludges, filter backwash, or any other pollutants removed in the course of treatment or control of wastewaters shall be disposed of in a manner such as to prevent any pollutants from entering waters of the state unless permitted by the Law, and a permanent record of the date and time, volume and methods of removal and disposal of such substances shall be maintained by the permittee.
 7. **Power Failures**
In order to maintain compliance with the effluent limitations and other provisions of this permit, the permittee shall either:
 - a. in accordance with the "Schedule of Compliance", provide an alternative power source sufficient to operate the wastewater control facilities; or,
 - b. if such alternative power source is not in existence, and no date for its implementation appears in the Compliance Schedule, halt or otherwise control production and all discharges upon the reduction, loss, or failure of the primary source of power to the wastewater control facilities.
 8. **Right of Entry**
For the purpose of inspecting, monitoring, or sampling the point source, water contaminant source, or wastewater treatment facility for compliance with the Clean Water Law and these regulations, authorized representatives of the Department, shall be allowed by the permittee, upon presentation of credentials and at reasonable times;
 - a. to enter upon permittee's premises in which a point source, water contaminant source, or wastewater treatment facility is located or in which any records are required to be kept under terms and conditions of the permit;
 - b. to have access to, or copy, any records required to be kept under terms and conditions of the permit;
 - c. to inspect any monitoring equipment or method required in the permit;
 - d. to inspect any collection, treatment, or discharge facility covered under the permit; and
 - e. to sample any wastewater at any point in the collection system or treatment process.
 9. **Permits Transferable**
 - a. Subject to Section (3) of 10 CSR 20-6.010 an operating permit may be transferred upon submission to the Department of an application to transfer signed by a new owner. Until such time as the permit is officially transferred, the original permittee remains responsible for complying with the terms and conditions of the existing permit.
 - b. The Department, within thirty (30) days of receipt of the application shall notify the new permittee of its intent to revoke and reissue or transfer the permit.
 10. **Availability of Reports**
Except for data determined to be confidential under Section 308 of the Act, and the Law and Missouri Clean Water Commission Regulation for Public Participation, Hearings and Notice to Governmental Agencies 10 CSR 20-6.020, all reports prepared in accordance with the terms of this permit shall be available for public inspection at the offices of the Department. As required by statute, effluent data shall not be considered confidential. Knowingly making any false statement on any such report shall be subject to the imposition of criminal penalties as provided in Section 204.076 of the Law.
 - a. Subject to compliance with statutory requirements of the Law and Regulations and applicable Court Order, this permit may be modified, suspended, or revoked in whole or in part during its term for cause including, but not limited to, the following:
 - (i) violation of any terms or conditions of this permit or the Law;
 - (ii) having obtained this permit by misrepresentation or failure to disclose fully any relevant facts;
 - (iii) a change in any circumstances or conditions that requires either a temporary or permanent reduction or elimination of the authorized discharge, or
 - (iv) any reason set forth in the Law and Regulations.
 - b. The filing of a request by the permittee for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance, does not stay any permit condition.
12. **Permit Modification - Less Stringent Requirements**
If any permit provisions are based on legal requirements which are lessened or removed, and should no other basis exist for such permit provisions, the permit shall be modified after notice and opportunity for a hearing.
 13. **Civil and Criminal Liability**
Except as authorized by statute and provided in permit conditions on "Bypassing" (Standard Condition B-5) and "Power Failures" (Standard Condition B-7) nothing in this permit shall be construed to relieve the permittee from civil or criminal penalties for noncompliance.
 14. **Oil and Hazardous Substance Liability**
Nothing in this permit shall be construed to preclude the institution of any legal action or relieve the permittee from any responsibilities, liabilities, or penalties to which the permittee is or may be subject under Section 311 of the Act, and the Law and Regulations. Oil and hazardous materials discharges must be reported in compliance with the requirements of the Federal Clean Water Act.
 15. **State Laws**
Nothing in this permit shall be construed to preclude the institution of any legal action or relieve the permittee from any responsibilities, liabilities, or penalties established pursuant to any applicable state statute or regulations.
 16. **Property Rights**
The issuance of this permit does not convey any property rights in either real or personal property, or any exclusive privileges, nor does it authorize any injury to private property or any invasion of personal rights, nor any infringement of or violation of federal, state or local laws or regulations.
 17. **Duty to Reapply**
If the permittee wishes to continue an activity regulated by this permit after the expiration date of this permit, the permittee must apply for a new permit 180 days prior to expiration of this permit.
 18. **Toxic Pollutants**
If a toxic effluent standard, prohibition, or schedule of compliance is established, under Section 307(a) of the Federal Clean Water Act for a toxic pollutant in the discharge of permittee's facility and such standard is more stringent than the limitations in the permit, then the more stringent standard, prohibition, or schedule shall be incorporated into the permit as one of its conditions, upon notice to the permittee.
 19. **Signatory Requirement**
All reports, or information submitted to the Director shall be signed (see 40 CFR-122.6).
 20. **Rights Not Affected**
Nothing in this permit shall affect the permittee's right to appeal or seek a variance from applicable laws or regulations as allowed by law.
 21. **Severability**
The provisions of this permit are severable, and if any provisions of this permit, or the application of any provision of this permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.



STANDARD CONDITIONS FOR NPDES PERMITS
ISSUED BY
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION
REVISED
MAY 1, 2013

PART II - SPECIAL CONDITIONS – PUBLICLY OWNED
TREATMENT WORKS
SECTION A – INDUSTRIAL USERS

1. Definitions

Definitions as set forth in the Missouri Clean Water Laws and approved by the Missouri Clean Water Commission shall apply to terms used herein.

Significant Industrial User (SIU). Except as provided in the *General Pretreatment Regulation* 10 CSR 20-6.100, the term Significant Industrial User means:

1. All Industrial Users subject to Categorical Pretreatment Standards; and
2. Any other Industrial User that: discharges an average of 25,000 gallons per day or more of process wastewater to the Publicly-Owned Treatment Works (POTW) (excluding sanitary, noncontact cooling and boiler blowdown wastewater); contributes a process wastestream which makes up 5 percent or more of the average dry weather hydraulic or organic capacity of the POTW treatment plant; or is designated as such by the Control Authority on the basis that the Industrial User has a reasonable potential for adversely affecting the POTW's or for violating any Pretreatment Standard or requirement.

Clean Water Act (CWA) is the the federal Clean Water Act of 1972, 33 U.S.C. § 1251 et seq. (2002).

2. Identification of Industrial Discharges

Pursuant to 40 CFR 122.44(j)(1), all POTWs shall identify, in terms of character and volume of pollutants, any Significant Industrial Users discharging to the POTW subject to Pretreatment Standards under section 307(b) of the CWA and 40 CFR 403.

3. Application Information

Applications for renewal or modification of this permit must contain the information about industrial discharges to the POTW pursuant to 40 CFR 122.21(j)(6)

4. Notice to the Department

Pursuant to 40 CFR 122.42(b), all POTWs must provide adequate notice of the following:

1. Any new introduction of pollutants into the POTW from an indirect discharger which would be subject to section 301 or 306 of CWA if it were directly discharging these pollutants; and
2. Any substantial change into the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of issuance of the permit.
3. For purposes of this paragraph, adequate notice shall include information on:
 - i. the quality and quantity of effluent introduced into the POTW, and
 - ii. any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW.

For POTWs without an approved pretreatment program, the notice of industrial discharges which was not included in the permit application shall be made as soon as practicable. For POTWs with an approved pretreatment program, notice is to be included in the annual pretreatment report required in the special conditions of this permit. Notice may be sent to:

Missouri Department of Natural Resources
Water Protection Program
Attn: Pretreatment Coordinator
P.O. Box 176
Jefferson City, MO 65102

**STANDARD CONDITIONS FOR NPDES PERMITS
ISSUED BY
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION
AUGUST 15, 1994**

PART III – SLUDGE & BIOSOLIDS FROM DOMESTIC WASTEWATER TREATMENT FACILITIES

SECTION A – GENERAL REQUIREMENTS

1. This permit pertains to sludge requirements under the Missouri Clean Water Law and regulation and incorporates applicable federal sludge disposal requirements under 40 CFR 503. The Environmental Protection Agency (EPA) has principal authority for permitting and enforcement of the federal sludge regulations under 40 CFS 503 until such time as Missouri is delegated the new EPA sludge program. EPA has reviewed and accepted these standard sludge conditions. EPA may choose to issue a separate sludge addendum to this permit or a separate federal sludge permit at their discretion to further address federal requirements.
2. These PART III Standard Conditions apply only to sludge and biosolids generated at domestic wastewater treatment facilities, including public owned treatment works (POTW) and privately owned facilities.
3. Sludge and Biosolids Use and Disposal Practices.
 - a. Permittee is authorized to operate the sludge and biosolids treatment, storage, use, and disposal facilities listed in the facility description of this permit.
 - b. Permittee shall not exceed the design sludge volume listed in the facility description and shall not use sludge disposal methods that are not listed in the facility description, without prior approval of the permitting authority.
 - c. Permittee is authorized to operate the storage, treatment or generating sites listed in the Facility Description section of this permit.
 - d. A separate operating permit is required for each operating location where sludge or biosolids are generated, stored, treated, or disposed, unless specifically exempted in this permit or in 10 CSR 20, Chapter 6 regulations. For land application, see section H, subsection 3 of these standard conditions.
4. Sludge Received From Other Facilities
 - a. Permittees may accept domestic wastewater sludge from other facilities including septic tank pumpings from residential sources as long as the design sludge volume is not exceeded and the treatment facility performance is not impaired.
 - b. The permittee shall obtain a signed statement from the sludge generator or hauler that certifies the type and source of the sludge.
 - c. Sludge received from out-of-state generators shall receive prior approval of the permitting authority and shall be listed in the facility description or special conditions section of the permit.
5. These permit requirements do not supersede nor remove liability for compliance with county and other local ordinances.
6. These permit requirements do not supersede nor remove liability for compliance with other environmental regulations such as odor emissions under the Missouri Air Pollution Control Law and regulations.
7. This permit may (after du process) be modified, or alternatively revoked and reissued, to comply with any applicable sludge disposal standard or limitation issued or approved under Section 405(d) of the Clean Water Act or under Chapter 644 RsMo.
8. In addition to the STANDARD CONDITIONS, the department may include sludge limitations in the special conditions portion or other sections of this permit.
9. Alternate Limits in Site Specific Permit.

Where deemed appropriate, the department may require an individual site specific permit in order to authorize alternate limitations:

 - a. An individual permit must be obtained for each operating location, including application sites.
 - b. To request a site specific permit, an individual permit application, permit fees, and supporting documents shall be submitted for each operating location. This shall include a detailed sludge/biosolids management plan or engineering report.
10. Exceptions to these Standard Conditions may be authorized on a case-by-case basis by the department, as follows:
 - a. The department will prepare a permit modification and follow permit public notice provisions as applicable under 10 CSR 20-6.020, 40 CFR 124.10, and 40 CFR 501.15(a)(2)(ix)(E). This includes notification of the owners of property located adjacent to each land application site, where appropriate.
 - b. Exceptions cannot be granted where prohibited by the federal sludge regulations under 40 CFR 503.
11. Compliance Period
Compliance shall be achieved as expeditiously as possible but no later than the compliance dates under 40 CFR 503.2.

SECTION B – DEFINITIONS

1. Biosolids means an organic fertilizer or soil amendment produced by the treatment of domestic wastewater sludge. Untreated sludge or sludge that does not conform to the pollutants and pathogen treatment requirements in this permit is not considered biosolids.
2. Biosolids land application facility is a facility where biosolids are spread onto the land at agronomic rates for production of food or fiber. The facility includes any structures necessary to store the biosolids until soil, weather, and crop conditions are favorable for land application.
3. Class A biosolids means a material that has met the Class A pathogen reduction requirements or equivalent treatment by a Process to Further Reduce Pathogens (PFRP) in accordance with 40 CFR 503.
4. Class B biosolids means a material that has met the Class B pathogen reduction requirements or equivalent treatment by a Process to Significantly Reduce Pathogens (PFRP) in accordance with 40 CFR 503.
5. Domestic wastewater means wastewater originating from the sanitary conveniences of residences, commercial buildings, factories and institutions; or co-mingled sanitary and industrial wastewater processed by a public owned treatment works (POTW) or privately owned facility.
6. Mechanical treatment plants are wastewater treatment facilities that use mechanical devices to treat wastewater, including septic tanks, extended aeration, activated sludge, contact stabilization, trickling filters, rotating biological discs, and other similar facilities. It does not include unaerated wastewater treatment lagoons and constructed wetlands for wastewater treatment.
7. Operating location as defined in 10 CSR 20-2.010 is all contiguous lands owned, operated or controlled by one (1) person or by two (2) or more persons jointly or as tenants in common.
8. Plant Available Nitrogen (PAN) is the nitrogen that will be available to plants during the next growing season after biosolids application.
9. Sinkhole is a depression in the land surface into which surface water flows to join an underground drainage system.
10. Site Specific Permit is a permit that has alternate limits developed to address specific site conditions for each land application site or storage site.
11. Sludge is the solid, semisolid, or liquid residue removed during the treatment of wastewater. Sludge includes septage removed from septic tanks.
12. Sludge lagoon is an earthen basin that receives sludge that has been removed from a wastewater treatment facility. It does not include a wastewater treatment lagoon or sludge treatment units that are not a part of a mechanical wastewater treatment facility.
13. Wetlands are those areas that are inundated or saturated by surface or groundwater at a frequency and duration sufficient to support, and that under normal circumstances do support, a prevalence of vegetation typically adapted for life in saturated soil conditions. Wetlands generally include swamp, marshes, bogs, and similar areas. Wetlands do not include constructed wetlands used for wastewater treatment.

SECTION C – MECHANICAL WASTEWATER TREATMENT FACILITIES

1. Sludge shall be routinely removed from the wastewater treatment facilities and handled according to the permit facility description and sludge conditions in this permit.
2. The permittee shall operate the facility so that there is no sludge loss into the discharged effluent in excess of permit limits, no sludge bypassing, and no discharge of sludge to waters of the state.
3. Mechanical treatment plants shall have separate sludge storage compartments in accordance with 10 CSR 20, Chapter 8. Failure to remove sludge from these storage compartments on the required design schedule is a violation of this permit.

SECTION D – SLUDGE DISPOSED AT OTHER TREATMENT FACILITY OR CONTRACT HAULER

1. This section applies to permittees that haul sludge to another treatment facility for disposal or use contract haulers to remove and dispose of sludge.
2. Permittees that use contract haulers are responsible for compliance with all the terms of this permit including final disposal, unless the hauler has a separate permit for sludge or biosolids disposal issued by the department; or the hauler transports the sludge to another permitted treatment facility.
3. The permittee shall require documentation from the contractor of the disposal methods used and permits obtained by the contractor.
4. Testing of sludge, other than total solids content, is not required if sludge is hauled to a municipal wastewater treatment facility or other permitted wastewater treatment facility.

SECTION E – WASTEWATER TREATMENT LAGOONS AND STORMWATER RETENTION BASINS

1. Sludge that is retained within a wastewater treatment lagoon is subject to sludge disposal requirements when the sludge is removed from the lagoon or when the lagoon ceases to receive and treat wastewater.
2. If sludge is removed during the year, an annual sludge report must be submitted.
3. Storm water retention basins or other earthen basins, which have been used as sludge storage for a mechanical treatment system is considered a sludge lagoon and must comply with Section G of this permit.

SECTION F – INCINERATION OF SLUDGE

1. Sludge incineration facilities shall comply with the requirements of 40 CFR 503 Subpart E; air pollution control regulations under 10 CSR 10; and solid waste management regulations under 10 CSR 80.
2. Permittee may be authorized under the facility description of this permit to store incineration ash in lagoons or ash ponds. This permit does not authorize the disposal of incineration ash. Incineration ash shall be disposed in accordance with 10 CSR 80; or if the ash is determined to be hazardous waste, shall be disposed in accordance with 10 CSR 25.
3. In addition to normal sludge monitoring, incineration facilities shall report the following as part of the annual report, quantity of sludge incinerated, quantity of ash generated, quantity of ash stored; and ash use or disposal method, quantity, and location. Permittee shall also provide the name of the disposal facility and the applicable permit number.
4. Additional limitations, monitoring, and reporting requirements may be addressed in the Special Conditions sections of this permit.

SECTION G – SURFACE DISPOSAL SITES AND SLUDGE LAGOONS

1. Surface disposal sites shall comply with the requirements in 40 CFR 503 Subpart C, and solid waste disposal regulations under 10 CSR 80.
2. Additional limitations, monitoring, and reporting requirements may be addressed in the Special Conditions section of this permit.
3. Effective February 19, 1995, a sludge lagoon that has been in use for more than two years without removal of accumulated sludge, or that has not been properly closed shall comply with one of the following options:
 - a. Permittee shall obtain a site specific permit to address surface disposal requirements under 40 CFR 503, ground water quality regulations under 10 CSR 20, Chapter 7 and 8, and solid waste management regulations under 10 CSR 80;
 - b. Permittee shall clean out the sludge lagoon to remove any sludge over two years old and shall continue to remove accumulated sludge at least every two years or an alternate schedule approved under 40 CFR 503.20(b). In order to avoid damage to the lagoon seal during cleaning, the permittee may leave a layer of sludge on the bottom of the lagoon, upon prior approval of the department; or
 - c. Permittee shall close the lagoon in accordance with Section 1.

SECTION H – LAND APPLICATION

1. The permittee shall not land apply sludge or biosolids unless land application is authorized in the Facility Description or special conditions section of the permit.
2. This permit replaces and terminates all previous sludge management plan approvals by the department for land application of sludge or biosolids.
3. Land application sites within a 20 mile radius of the wastewater treatment facility are authorized under this permit when biosolids are applied for beneficial use in accordance with these standard conditions unless a site specific permit is required under Section A, Subsection 9.
4. Biosolids shall not be applied unless authorized in this permit or exempted under 10 CSR 20, Chapter 6.
 - a. This permit does not authorize the land application of sludge except when sludge meets the definition of biosolids.
 - b. This permit authorizes “Class A or B” biosolids derived from domestic wastewater sludges to be land applied onto grass land, crop land, timber land or other similar agricultural or silviculture lands at rates suitable for beneficial use as organic fertilizer and soil conditioner.
5. Public Contact Sites.
Permittees who wish to apply Class A biosolids to public contact sites must obtain approval from the department. Applications for approval shall be in the form of an engineering report and shall address priority pollutants and dioxin concentrations. Authorization for land applications must be provided in the special conditions section of this permit or in a separate site-specific permit.

6. Agricultural and Silvicultural Sites.

In addition to specified conditions herein, this permit is subject to the attached Water Quality Guides numbers WQ 422 through 426 published by the University of Missouri, and hereby incorporated as though fully set forth herein. The guide topics are as follows:

| | |
|--------|---|
| WQ 422 | Land Application of Septage |
| WQ 423 | Monitoring Requirements for Biosolids Land Application |
| WQ 424 | Biosolids Standards for Pathogens and Vectors |
| WQ 425 | Biosolids Standards for Metals and Other Trace Substances |
| WQ 426 | Best Management Practices for Biosolids Land Applications |

SECTION I – CLOSURE REQUIREMENTS

1. This section applies to all wastewater treatment facilities (mechanical and lagoons) and sludge or biosolids storage and treatment facilities and incineration ash ponds. It does not apply to land application sites.
2. Permittees who plan to cease operation must obtain department approval of a closure plan which addresses proper removal and disposal of all residues, including sludge, biosolids, and ash. Permittee must maintain this permit until the facility is properly closed per 10 CSR 20-6.010 and 10 CSR 20-6.015.
3. Residuals that are left in place during closure of a lagoon or earthen structure shall not exceed the agricultural loading rates as follows:
 - a. Residuals shall meet the monitoring and land application limits for agricultural rates as referenced in Section H of these standard conditions.
 - b. If a wastewater treatment lagoon has been in operation for 15 years or more, the sludge in the lagoon qualifies for Class B with respect to pathogens (see WQ 424, Table 3), and testing for fecal coliform is not required. For other lagoons, testing for fecal coliform is required to show compliance with Class B limitations. See WQ 423 and 424.
 - c. The allowable nitrogen loading that may be left in the lagoon shall be based on the plant available nitrogen (PAN) loading. See WQ 426 for calculation procedures. For a grass cover crop, the allowable PAN is 300 pounds/acre.
4. When closing a wastewater treatment lagoon with a design treatment capacity equal or less than 150 persons, the residuals are considered “septage” under the similar treatment works” definition. See WQ 422. Under the septage category, residuals may be left in place as follows:
 - a. Testing for metals or fecal coliform is not required.
 - b. If the wastewater treatment lagoon has been in use for less than 15 years, mix lime with the sludge at the rate of 50 pounds of hydrated lime per 1000 gallons (134 cubic feet) of sludge.
 - c. The amount of sludge that may be left in the lagoon shall be based on the plant available nitrogen (PAN) loading. 100 dry tons/acre of sludge may be left in the basin without testing for nitrogen. If more than 100 dry tons/acre will be left in the lagoon, test for nitrogen and determine the PAN in accordance with WQ 426. Allowable PAN loading is 300 pounds/acre.
5. Residuals left within the lagoon shall be mixed with soil on at least a 1 to 1 ratio, the lagoon berms shall be demolished, and the site shall be graded and vegetated so as to avoid ponding of storm water and provide adequate surface water drainage without creating erosion.
6. Lagoon closure activities shall obtain a storm water permit for land disturbance activities that equal or exceed five acres in accordance with 10 CSR 20-6.200.
7. If sludge exceeds agricultural loading rates under Section H or I, a landfill permit or solid waste disposal permit shall be obtained to authorize on-site sludge disposal under the Missouri Solid Waste Management Law and regulations per 10 CSR 80, and the permittee must comply with the surface disposal requirements under 40 CFR 503, Subpart C.

SECTION J – MONITORING FREQUENCY

1. At a minimum, sludge or biosolids shall be tested for volume and percent total solids on a frequency that will accurately represent sludge quantities produced and disposed.
2. Testing for land application is listed under Section H, Subsection 6 of these standard conditions (see WQ 423). Once per year is the minimum test frequency. Additional testing shall be performed for each 100 dry tons of sludge generated or stored during the year.
3. Additional testing may be required in the special conditions or other sections of the permit. Permittees receiving industrial wastewater may be required to conduct additional testing upon request from the department.
4. Monitoring requirements shall be performed in accordance with, “POTW Sludge Sampling and Analysis Guidance Document”, United States Environmental Protection Agency, August 1989, and subsequent revisions.

SECTION K – RECORD KEEPING AND REPORTING REQUIREMENTS


1. The permittee shall maintain records on file at the facility for at least five years for the items listed in these Standard Conditions and any additional items in the Special Conditions section of this permit. This shall include dates when the sludge facility is checked for proper operation, records of maintenance and repairs and other relevant information.
2. Reporting Period
 - a. By January 28th of each year, an annual report shall be submitted for the previous calendar year period for all mechanical wastewater treatment facilities, sludge lagoons, and sludge or biosolids disposal facilities.
 - b. Permittees with wastewater treatment lagoons shall submit the above annual report only when sludge or biosolids are removed from the lagoon during the report period or when the lagoon is closed.
3. Report Forms. The annual report shall be submitted on report forms provided by the department or equivalent forms approved by the department.
4. Report shall be submitted as follows:
Major facilities (those serving 10,000 persons or 1 million gallons per day) shall report to both the department and EPA. Other facilities need to report only to the department. Reports shall be submitted to the addresses listed as follows:

DNR regional office listed in your permit
(See cover letter of permit)

EPA Region VII
Water Compliance Branch (WACM)
Sludge Coordinator
901 N 5th Street
Kansas City, KS 66101

5. Annual Report Contents. The annual report shall include the following:
 - a. Sludge/biosolids testing performed. Include a copy or summary of all test results, even if not required by this permit.
 - b. Sludge or Biosolids quantity shall be reported as dry tons for quantity generated by the wastewater treatment facility, the quantity stored on site at end of year, and the quantity used or disposed.
 - c. Gallons and % solids data used to calculate the dry ton amounts.
 - d. Description of any unusual operating conditions.
 - e. Final disposal method, dates, and location, and person responsible for hauling and disposal.
 - (1) This must include the name, address and permit number for the hauler and the sludge facility. If hauled to a municipal wastewater treatment facility, sanitary landfill, or other approved treatment facility, give the name and permit number of that facility.
 - (2) Include a description of the type of hauling equipment used and the capacity in tons, gallons, or cubic feet.
 - f. Contract Hauler Activities.
If contract hauler, provide a copy of a signed contract or billing receipts from the contractor. Permittee shall require the contractor to supply information required under this permit for which the contractor is responsible. The permittee shall submit a signed statement from the contractor that he has complied with the standards contained in this permit, unless the contract hauler has a separate sludge disposal or biosolids use permit.
 - g. Land Application Sites.
 - (1) Report the location of each application site, the annual and cumulative dry tons/acre for each site, and the landowners name and address. The location for each spreading site shall be given as legal description for nearest ¼, ¼, Section, Township, Range, and County, or as latitude and longitude.
 - (2) If biosolids application exceeds 2 dry tons/acre/year, report biosolids nitrogen results. Plant Available Nitrogen (PAN) in pounds/acre, crop nitrogen requirement, available nitrogen in the soil prior to biosolids application, and PAN calculations for each site.
 - (3) If the “Low Metals” criteria is exceeded, report the annual and cumulative pollutant loading rates in pounds per acre for each applicable pollutant, and report the percent of cumulative loading which has been reached at each site.
 - (4) Report the method used for compliance with pathogen and vector attraction requirements.
 - (5) Report soil test results for pH, CEC, and phosphorus. If none was tested during the year, report the last date when tested and results.

CP000372



MISSOURI DEPARTMENT OF NATURAL RESOURCES
WATER PROTECTION PROGRAM
FORM B: APPLICATION FOR AN OPERATING PERMIT FOR DOMESTIC OR
MUNICIPAL WASTEWATER (≤100,000 gallons per day)

| FOR AGENCY USE ONLY | |
|---------------------|---------------|
| CHECK NUMBER | |
| DATE RECEIVED | FEE SUBMITTED |
| 05/15/08 | 2300.00 |

PLEASE READ THE ACCOMPANYING INSTRUCTIONS BEFORE COMPLETING THIS FORM

1. THIS APPLICATION IS FOR:

An operating permit for a new (including antidegradation review) or unpermitted facility. Construction Permit # CP0001372

An operating permit renewal: Permit #MO- _____ Expiration Date _____

An operating permit modification: Permit #MO- 0098990 Reason: Authorize use of new facilities

1.1 Is the appropriate fee included with the application (see instructions for appropriate fee)? YES NO

1.2 Is a facility description included with this application (see 7.1)? YES NO

2. FACILITY

| | | | |
|--|-------------------|---------------------------------|-------------------|
| NAME Wheatland Wastewater Treatment Facility | | TELEPHONE NUMBER WITH AREA CODE | |
| ADDRESS (PHYSICAL) West County Road 160 | CITY Wheatland | STATE MO | ZIP CODE 65779 |
| OUTFALL NUMBER For multiple outfalls, this is number _____ of No Discharge System _____ | | | |
| Estimated (actual) flow: _____ gpd, Design Average Flow: 80,000 gpd, Design Peak Hourly Flow: _____ gph | | | |
| 2.1 Legal description: <u>¼, NE ¼, NW ¼, Sec. 38, T 93, R 25</u> County <u>Hickory</u> | | | |
| 2.2 UTM Coordinates Easting (X): <u>463411</u> Northing (Y): <u>4200765</u> <i>For Universal Transverse Mercator (UTM), Zone 15 North referenced to North American Datum 1983 (NAD83)</i> | | | |
| 2.3 Name of receiving stream: <u>Tributary to Little Pomme de Terre River</u> | | | |

3. OWNER

| | | | |
|--|-------------------|---|---|
| NAME City of Wheatland | | E-MAIL ADDRESS city of wheatland @abmissouri.com | TELEPHONE NUMBER WITH AREA CODE (417) 282-6552 |
| ADDRESS PO Box 187 | CITY Wheatland | STATE MO | ZIP CODE 65779 |
| 3.1 Request review of draft permit prior to public notice? <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO | | | |

4. CONTINUING AUTHORITY: Permanent organization that will serve as the continuing authority for the operation, maintenance and modernization of the facility.

| | | | |
|---------------------------|-------------------|----------------|---|
| NAME City of Wheatland | | E-MAIL ADDRESS | TELEPHONE NUMBER WITH AREA CODE (417) 282-6552 |
| ADDRESS PO Box 187 | CITY Wheatland | STATE MO | ZIP CODE 65779 |

5. OPERATOR

| | | |
|----------------------|---|-----------------------------|
| NAME Kevin Nelson | | CERTIFICATE NUMBER 10596 |
| E-MAIL ADDRESS | TELEPHONE NUMBER WITH AREA CODE (417) 224-2987 | |

6. FACILITY CONTACT

| | | |
|----------------------|---|-------------------|
| NAME Kevin Nelson | | TITLE Operator |
| E-MAIL ADDRESS | TELEPHONE NUMBER WITH AREA CODE 417-224-2987 | |

7. DESCRIPTION OF FACILITY

7.1 Describe the facility (attach additional sheet if required) and attach a flow chart showing the influents, treatment facilities and outfalls.
See Attached

7.2 Attach an aerial photograph or USGS topographic map showing the location of the facility and outfall.

7.3 Design flow for this outfall: _____ Total design flow for the facility: 0.08 Actual flow for this outfall: _____

7.4 Number of people presently connected or population equivalent (P.E.): 436 Design P.E.: 559

7.5 Does the facility accept or process leachate from landfills? Yes No

8. ADDITIONAL FACILITY INFORMATION

8.1 Facility SIC code: 4952; Discharge SIC code: 4952.

8.2 Milestone dates:

Date of completion of construction of facility: _____

Dates of any construction modifications to the facility (along with description of modification): 12/29/2014

See Attached

8.3 Connections to the facility:

Number of units presently connected: Homes 257 Trailers _____ Apartments _____

Other (including industrial) _____ (If industrial, see instructions 8.1)

Number of commercial establishments: _____

Daily number of employees working (total estimate): _____ Daily number of customers/guests (total estimate): _____

8.4 Length of pipe in the sewer collection system? 26,800 feet or _____ miles (either unit is appropriate.)

8.5 Does any bypassing occur in the collection system or at the treatment facility? Yes No (If yes, explain.)

8.6 Does significant infiltration occur in the collection system? Yes No (If yes, explain and attach proposed repair.)

The sewer system is composed of clay pipe which is beyond its useful life. The City does not have the funds at this time to do any major rehabilitation work on the sewers.

9. DISCHARGE INFORMATION

9.1 Will the discharge be continuous throughout the year? Yes No

9.2 Discharge will occur during the following months: NA

9.3 How many days of the week will the discharge occur? NA

9.4 Is wastewater land-applied? Yes No (If yes, attach Form I.)

9.5 Will chlorine be added to the effluent? Yes No

If chlorine is added, what is the resulting residual? _____ µg/l (micrograms per liter)

9.6 Does this facility discharge to a losing stream or sinkhole? Yes No

9.7 Has a waste load allocation study been completed for this facility? Yes No

10. List all permit violations, including effluent limit exceedances, in the last five years. Attach a separate sheet if necessary. If none, write none.

10/2012 BOD Exceedence

11/2011 BOD Exceedence

11. SLUDGE HANDLING, USE AND DISPOSAL

11.1 Is the sludge a hazardous waste as defined by 10 CSR 25? Yes No
 Sludge production, including sludge received from others: _____ Design Dry Tons/Year _____ Actual Dry Tons/Year

11.3 Capacity of sludge holding structures:
 Sludge storage provided: _____ cubic feet; _____ days of storage; _____ average percent solids of sludge;
 No sludge storage is provided.

- Type of Storage: Holding tank Building
 Basin Other (Please describe) _____
 Concrete Pad
- Sludge Treatment:
 Anaerobic Digester Lagoon Composting
 Storage Tank Aerobic Digester Other (Attach description)
 Lime Stabilization Air or Heat Drying
- Sludge Use or Disposal:
 Land Application Surface Disposal (Sludge Disposal Lagoon, Sludge held for more than two years)
 Contract Hauler Incineration
 Hauled to Another Sludge Retained in Wastewater treatment lagoon
 Treatment Facility Other _____ Attach explanation sheet.
 Solid Waste Landfill
- Person responsible for hauling sludge to disposal facility
 By Applicant By Others (complete below)

| | |
|------|----------------|
| NAME | E-MAIL ADDRESS |
|------|----------------|

| | | | |
|---------|------|-------|----------|
| ADDRESS | CITY | STATE | ZIP CODE |
|---------|------|-------|----------|

| | | |
|----------------|---------------------------------|----------------|
| CONTACT PERSON | TELEPHONE NUMBER WITH AREA CODE | PERMIT NO. MO- |
|----------------|---------------------------------|----------------|

Sludge use or disposal facility
 By applicant By others (Please complete below.)

| | |
|------|----------------|
| NAME | E-MAIL ADDRESS |
|------|----------------|

| | | | |
|---------|------|-------|----------|
| ADDRESS | CITY | STATE | ZIP CODE |
|---------|------|-------|----------|

| | | |
|----------------|---------------------------------|----------------|
| CONTACT PERSON | TELEPHONE NUMBER WITH AREA CODE | PERMIT NO. MO- |
|----------------|---------------------------------|----------------|

Does the sludge or biosolids disposal comply with federal sludge regulations under 40 CFR 503?
 Yes No (Please explain)


12. DOWNSTREAM LANDOWNERS - ATTACH ADDITIONAL SHEETS AS NECESSARY. SEE INSTRUCTIONS.

NAME
 See Attached

| | | | |
|---------|------|-------|----------|
| ADDRESS | CITY | STATE | ZIP CODE |
|---------|------|-------|----------|

13. CERTIFICATION

I certify that I am familiar with the information contained in the application, that to the best of my knowledge and belief such information is true, complete and accurate, and if granted this permit, I agree to abide by the Missouri Clean Water Law and all rules, regulations, orders and decisions, subject to any legitimate appeal available to applicant under the Missouri Clean Water Law.

| | |
|--|--|
| NAME AND OFFICIAL TITLE (TYPE OR PRINT) <i>Cary Decker Mayor</i> | TELEPHONE NUMBER WITH AREA CODE <i>417-282-6552</i> |
| SIGNATURE  | DATE SIGNED <i>1-26-15</i> |