

STATE OF MISSOURI
DEPARTMENT OF NATURAL RESOURCES

MISSOURI CLEAN WATER COMMISSION



MISSOURI STATE OPERATING PERMIT

In compliance with the Missouri Clean Water Law, (Chapter 644 R.S. Mo. as amended, hereinafter, the Law), and the Federal Water Pollution Control Act (Public Law 92-500, 92nd Congress) as amended,

Permit No. MO-0121151

Owner: Benton County R-9 School District
Address: P.O. Box 248, Warsaw, MO 65355

Continuing Authority: Same as above
Address: Same as above

Facility Name: Warsaw R-9 South Elementary
Facility Address: 23395 Highway 7, Warsaw, MO 65355

Legal Description: NE ¼, SW ¼, Sec. 6, T39N, R21W, Benton County
UTM Coordinates: X = 476138.282, Y = 4224872.419

Receiving Stream: P D Creek (U)
First Classified Stream and ID: P D Creek (C) (03715)
USGS Basin & Sub-watershed No.: (10290109-0102)

is authorized to discharge from the facility described herein, in accordance with the effluent limitations and monitoring requirements as set forth herein:

FACILITY DESCRIPTION

Outfall #001 – School – SIC #8211/#4952

No Certified Operator Required

Two septic tanks with effluent filter / recirculating sand filter / septage disposed by contract hauler
Design population equivalent is 52
Design flow is 5,250 gallons per day.
Actual flow is 3,375 gallons per day.
Design sludge production is 8.65 dry tons/year.

This permit authorizes only wastewater discharges under the Missouri Clean Water Law and the National Pollutant Discharge Elimination System; it does not apply to other regulated areas. This permit may be appealed in accordance with Section 644.051.6 of the Law.

December 1, 2011
Effective Date

Sara Parker Pauley, Director, Department of Natural Resources

November 30, 2016
Expiration Date

Dorothy Franklin, Director, Kansas City Regional Office

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS					PAGE NUMBER 2 of 4	
					PERMIT NUMBER MO-0121151	
The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The interim effluent limitations shall become effective upon issuance and remain in effect through <u>November 30, 2014</u> . Such discharges shall be controlled, limited and monitored by the permittee as specified below:						
OUTFALL NUMBER AND EFFLUENT PARAMETER(S)	UNITS	INTERIM EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
<u>Outfall #001</u>						
Flow	MGD	*		*	once/quarter**	24 hr. estimate
Biochemical Oxygen Demand ₅	mg/L		45	30	once/quarter**	composite***
Total Suspended Solids	mg/L		45	30	once/quarter**	composite***
pH – Units	SU	****		****	once/quarter**	grab
Ammonia as N	mg/L	*		*	once/quarter**	grab
Temperature (effluent)	°C	*		*	once/quarter**	grab
Oil & Grease	mg/L	15		10	once/quarter**	grab
MONITORING REPORTS SHALL BE SUBMITTED <u>QUARTERLY</u> ; THE FIRST REPORT IS DUE <u>APRIL 28, 2012</u> . THERE SHALL BE NO DISCHARGE OF FLOATING SOLIDS OR VISIBLE FOAM IN OTHER THAN TRACE AMOUNTS.						
The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The final effluent limitations shall become effective <u>December 1, 2014</u> , and remain in effect until expiration of the permit. Such discharges shall be controlled, limited and monitored by the permittee as specified below:						
OUTFALL NUMBER AND EFFLUENT PARAMETER(S)	UNITS	FINAL EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
<u>Outfall #001</u>						
Flow	MGD	*		*	once/quarter**	24 hr. estimate
Biochemical Oxygen Demand ₅	mg/L		45	30	once/quarter**	composite***
Total Suspended Solids	mg/L		45	30	once/quarter**	composite***
pH – Units	SU	****		****	once/quarter**	grab
Ammonia as N	mg/L				once/quarter**	grab
(April 1 – Sept. 30)		3.6		1.4		
(Oct. 1 – March 31)		7.5		2.9		
Temperature (effluent)	°C	*		*	once/quarter**	grab
Oil & Grease	mg/L	15		10	once/quarter**	grab
MONITORING REPORTS SHALL BE SUBMITTED <u>QUARTERLY</u> ; THE FIRST REPORT IS DUE <u>APRIL 28, 2015</u> . THERE SHALL BE NO DISCHARGE OF FLOATING SOLIDS OR VISIBLE FOAM IN OTHER THAN TRACE AMOUNTS.						
B. STANDARD CONDITIONS						
IN ADDITION TO SPECIFIED CONDITIONS STATED HEREIN, THIS PERMIT IS SUBJECT TO THE ATTACHED <u>PARTS I & III</u> STANDARD CONDITIONS DATED <u>October 1, 1980</u> and <u>August 15, 1994</u> , AND HEREBY INCORPORATED AS THOUGH FULLY SET FORTH HEREIN.						

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS (continued)

- * Monitoring requirement only.
- ** See table at the top of page 3 for quarterly sampling.
- *** A composite sample made up from a minimum of six grab samples collected within a 24 hour period with a minimum of two hours between each grab sample.
- **** pH is measured in pH units and is not to be averaged. The pH is limited to the range of 6.5 - 9.0 pH units.

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS (continued)

Sample discharge at least once for the months of:	Report is due:
January, February, or March (1st Quarter)	April 28
April, May, or June (2nd Quarter)	July 28
July, August, or September (3rd Quarter)	October 28
October, November, or December (4th Quarter)	January 28

C. SPECIAL CONDITIONS

1. This permit may be reopened and modified, or alternatively revoked and reissued, to:
 - (a) Comply with any applicable effluent standard or limitation issued or approved under Sections 301(b)(2)(C) and (D), 304(b)(2), and 307(a) (2) of the Clean Water Act, if the effluent standard or limitation so issued or approved:
 - (1) contains different conditions or is otherwise more stringent than any effluent limitation in the permit; or
 - (2) controls any pollutant not limited in the permit.
 - (b) Incorporate new or modified effluent limitations or other conditions, if the result of a waste load allocation study, toxicity test or other information indicates changes are necessary to assure compliance with Missouri's Water Quality Standards.
 - (c) Incorporate new or modified effluent limitations or other conditions if, as the result of a watershed analysis, a Total Maximum Daily Load (TMDL) limitation is developed for the receiving waters which are currently included in Missouri's list of waters of the state not fully achieving the state's water quality standards, also called the 303(d) list.
 The permit as modified or reissued under this paragraph shall also contain any other requirements of the Clean Water Act then applicable.
2. All outfalls must be clearly marked in the field.
3. Permittee will cease discharge by connection to a facility with an area-wide management plan per 10 CSR 20-6.010(3)(B)1. or 2. within 90 days of notice of its availability. The permittee shall obtain department approval for closure or alternate use of the facility.
4. Changes in Discharges of Toxic Substances
 The permittee shall notify the Director as soon as it knows or has reason to believe:
 - (a) That any activity has occurred or will occur which would result in the discharge of any toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following "notification levels:"
 - (1) One hundred micrograms per liter (100 µg/L);
 - (2) Two hundred micrograms per liter (200 µg/L) for acrolein and acrylonitrile; five hundred micrograms per liter (500 µg/L) for 2,5 dinitrophenol and for 2-methyl-4, 6-dinitrophenol; and one milligram per liter (1 mg/L) for antimony;
 - (3) Five (5) times the maximum concentration value reported for the pollutant in the permit application;
 - (4) The level established in Part A of the permit by the Director.
 - (b) That they have begun or expect to begin to use or manufacture as an intermediate or final product or byproduct any toxic pollutant, which was not reported in the permit application.
5. Report as no-discharge when a discharge does not occur during the monitoring period.
6. Water Quality Standards
 - (a) Discharges to waters of the state shall not cause a violation of water quality standards rule under 10 CSR 20-7.031, including both specific and general criteria.
 - (b) General Criteria. The following general water quality criteria shall be applicable to all waters of the state at all times including mixing zones. No water contaminant, by itself or in combination with other substances, shall prevent the waters of the state from meeting the following conditions:
 - (1) Waters shall be free from substances in sufficient amounts to cause the formation of putrescent, unsightly or harmful bottom deposits or prevent full maintenance of beneficial uses;
 - (2) Waters shall be free from oil, scum and floating debris in sufficient amounts to be unsightly or prevent full maintenance of beneficial uses;
 - (3) Waters shall be free from substances in sufficient amounts to cause unsightly color or turbidity, offensive odor or prevent full maintenance of beneficial uses;
 - (4) Waters shall be free from substances or conditions in sufficient amounts to result in toxicity to human, animal or aquatic life;
 - (5) There shall be no significant human health hazard from incidental contact with the water;
 - (6) There shall be no acute toxicity to livestock or wildlife watering;
 - (7) Waters shall be free from physical, chemical or hydrologic changes that would impair the natural biological community;

C. SPECIAL CONDITIONS (continued)

- (8) Waters shall be free from used tires, car bodies, appliances, demolition debris, used vehicles or equipment and solid waste as defined in Missouri's Solid Waste Law, section 260.200, RSMo, except as the use of such materials is specifically permitted pursuant to section 260.200-260.247.
7. The permittee shall comply with any applicable requirements listed in 10 CSR 20-8 and 10 CSR 20-9, unless the facility has received written notification that the Department has approved a modification to the requirements. The monitoring frequencies contained in this permit shall not be construed by the permittee as a modification of the monitoring frequencies listed in 10 CSR 20-9. If a modification of the monitoring frequencies listed in 10 CSR 20-9 is needed, the permittee shall submit a written request to the department for review and, if deemed necessary, approval.

D. SCHEDULE OF COMPLIANCE

1. The final daily maximum and monthly average Ammonia as N limits shall become effective three (3) years after the issue date of the permit. The Effluent Regulation, 10 CSR 20-7.031(10) allows the permittee up to three (3) years from the issuance date of this permit to comply with new or revised National Pollutant Discharge Elimination System (NPDES) or Missouri operating permit limitations based on criteria in the Clean Water Commission Regulations. It states that such compliance "shall be achieved with all deliberate speed and no later than three (3) years from the date of issuance of the permit." Therefore modification to the facilities must be made if required to meet the final effluent limits of this permit.
2. If modifications to the facility are required to meet the final effluent limits of this permit, Benton County R-9 School District shall submit to the department a facility plan (or engineering report) by **September 1, 2012**, for changes to the Warsaw R-9 South Elementary Wastewater Treatment Facility (WWTF) so the discharge from the facility will meet the final effluent limits for Ammonia as Nitrogen.
3. Within **six months** of department approval of the facility plan, Benton County R-9 School District will then submit to the department engineering plans, technical specifications, and a construction permit application, for changes to the Warsaw R-9 South Elementary WWTF so the discharge from the facility will meet the final effluent limits for Ammonia as N.
4. If completion of construction will be more than 1 year, Benton County R-9 School District shall submit interim progress reports every 12 months from **December 1, 2011**.
5. If Benton County R-9 School District determines that modifications to the facility are not needed to meet the final effluent limits of this permit, Benton County R-9 School District shall submit a letter to the department by issue **September 1, 2012**, stating that modifications are not needed for Warsaw R-9 South Elementary WWTF to meet the final effluent limitations of this permit.
6. Warsaw R-9 South Elementary WWTF will meet final effluent limits by **December 1, 2014**.

PERMIT TRANSFER

This permit may be transferred to a new owner by submitting an "Application for Transfer of Operating Permit" signed by the seller and buyer of the facility, along with the appropriate modification fee.

PERMIT RENEWAL REQUIREMENTS

Unless this permit is terminated, the permittee shall submit an application for the renewal of this permit no later than six (6) months prior to the permit's expiration date. Failure to apply for renewal may result in termination of this permit and enforcement action to compel compliance with this condition and the Missouri Clean Water Law.

TERMINATION

In order to terminate this permit, the permittee shall notify the department by submitting Form J, included with the State Operating Permit. The permittee shall complete Form J and mail it to the department at the address noted in the cover letter of this permit. Proper closure of any storage structure is required prior to permit termination. A closure plan shall be submitted to the department and approved prior to initiating closure activities.

DUTY OF COMPLIANCE

The permittee shall comply with all conditions of this permit. Any noncompliance with this permit constitutes a violation of Chapter 644, Missouri Clean Water Law, and 10 CSR 20-6. Noncompliance may result in enforcement action, termination of this authorization, or denial of the permittee's request for renewal. This permit authorizes only the activities described in this permit.

MISSOURI DEPARTMENT OF NATURAL RESOURCES

FACT SHEET

FOR THE PURPOSE OF RENEWAL OF

MO-0121151

WARSAW R-9 SOUTH ELEMENTARY

The Federal Water Pollution Control Act ("Clean Water Act" Section 402 Public Law 92-500 as amended) established the National Pollution Discharge Elimination System (NPDES) permit program. This program regulates the discharge of pollutants from point sources into the waters of the United States, and the release of storm water from certain point sources. All such discharges are unlawful without a permit (Section 301 of the "Clean Water Act"). After a permit is obtained, a discharge not in compliance with all permit terms and conditions is unlawful. Missouri State Operating Permits (MSOPs) are issued by the Director of the Missouri Department of Natural Resources (Department) under an approved program, operating in accordance with federal and state laws (Federal "Clean Water Act" and "Missouri Clean Water Law" Section 644 as amended). MSOPs are issued for a period of five (5) years unless otherwise specified.

As per [40 CFR Part 124.8(a)] and [10 CSR 20-6.020(1)2.] a Factsheet shall be prepared to give pertinent information regarding the applicable regulations, rationale for the development of effluent limitations and conditions, and the public participation process for the Missouri State Operating Permit listed below.

A Factsheet is not an enforceable part of an operating permit.

This Factsheet is for a Major Minor Industrial Facility Variance
 Master General Permit General Permit Covered Facility Permit with widespread public interest .

Part I – Facility Information

Facility Type: Elementary School
 Facility SIC Code(s): #8211/#4952

Facility Description: The facility consists of two septic tanks with an effluent filter followed by a re-circulating sand filter with the septage disposed of by a contract hauler. The design population equivalent is 52. The design flow is 5,250 gallons per day with an actual flow of 3,375 gallons per day average based upon submitted discharge monitoring reports. The design sludge production is 8.65 dry tons per year.

Have any changes occurred at this facility or in the receiving water body that effects effluent limit derivation? - Yes; - No

Application Date: 4/28/11
 Expiration Date: 9/22/11
 Last Inspection: 9/22/04 In Compliance Not in Compliance

OUTFALL(S) TABLE:

OUTFALL	DESIGN FLOW (CFS)	TREATMENT LEVEL	EFFLUENT TYPE	DISTANCE TO CLASSIFIED SEGMENT (MI)
#001	0.008	secondary	domestic wastewater	~ 3.3

Outfall #001
 Legal Description: NE ¼, NW ¼, Sec. 6, T39N, R21W, Benton County
 UTM Coordinates: X = 476138.282, Y = 4224872.419
 Receiving Stream: P D Creek (U)
 First Classified Stream and ID: P D Creek (C) (03715)
 USGS Basin & Sub-watershed No.: (10290109-0102)

Comments: The original construction permit states that this facility is to serve 350 people with a design flow of 5,250 gallons per day. For the purposes of this permit, the design population equivalent is to be based on a flow of 100 gallons per capita per day of the design flow, as described in Regulation 10 CSR 20-9.020(1)(D) Population Equivalent (P.E.). Therefore, the design population equivalent is 52. The change in the design population equivalent from 124 in the previous permit to 52 in this permit does not reduce the allowable capacity of the facility (the facility can still treat a design flow of 5,250 gallons per day), nor does it change the actual number of people the system can treat the waste from (the Regulation 10 CSR 20-8.020(11)(B)3. design basis for the system is still 350 people with 15 gallons per person per day giving the actual design flow of 5,250 gallons per day); it simply clarifies the basis for the design population equivalent for the application of Chapter 9 and brings consistency with other permits.

The facility has been given limitations for Oil and Grease because the school has a cafeteria. The facility has also been given limitations for Ammonia as N, with a schedule of compliance, because the Reasonable Potential Analysis indicated the facility could exceed chronic criteria during the summer and both acute and chronic criteria during the winter.

Receiving Water Body's Water Quality & Facility Performance History: No Stream Surveys or Low Flow Studies have been conducted at this facility. Please see the table below for DMR exceedances during the current permit cycle. The facility reported that they lost their Director of Maintenance during that quarter and as a result of the exceedances they had the filters cleaned and all tanks pumped. The facility is only missing the second quarter 2008 Discharge Monitoring Report due to transitioning to another lab. The facility was not in compliance when it was inspected on September 22, 2004, for failure to submit monitoring reports. The facility has not been inspected during the current permit cycle.

LIMITATION EXCEEDANCES FROM SUBMITTED DISCHARGE MONITORING REPORTS						
PARAMETER	UNITS	DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	REPORTED VALUE	DATE OR REPORTING PERIOD
Biochemical Oxygen Demand ₅	mg/L		45	30	235.6	1 st Q 2010
Total Suspended Solids	mg/L		45	30	38.9	1 st Q 2010

Part II – Operator Certification Requirements

As per [10 CSR 20-9.010(2)(A)], this facility is not required to have a certified operator.

Part III – Receiving Stream Information

APPLICABLE DESIGNATIONS OF WATERS OF THE STATE:

As per Missouri's Effluent Regulations [10 CSR 20-7.015], the waters of the state are divided into the listed seven (7) categories. Each category lists effluent limitations for specific parameters, which are presented and discussed in each outfall's Effluent Limitation Derivation & Discussion of Limits section.

- Missouri or Mississippi River [10 CSR 20-7.015(2)]:
- Lake or Reservoir [10 CSR 20-7.015(3)]:
- Lossing [10 CSR 20-7.015(4)]:
- Metropolitan No-Discharge [10 CSR 20-7.015(5)]:
- Special Stream [10 CSR 20-7.015(6)]:
- Subsurface Water [10 CSR 20-7.015(7)]:
- All Other Waters [10 CSR 20-7.015(8)]:

10 CSR 20-7.031 Missouri Water Quality Standards, the Department defines the Clean Water Commission water quality objectives in terms of "water uses to be maintained and the criteria to protect those uses." The receiving stream and/or 1st classified receiving stream's beneficial water uses to be maintained, are located in the Receiving Stream Table located below in accordance with [10 CSR 20-7.031(3)].

RECEIVING STREAM(S) TABLE:

WATERBODY NAME	CLASS	WBID	DESIGNATED USES*	8-DIGIT HUC	EDU**
P D Creek	U	N/A	General Criteria	10290109	Ozark / Osage
P D Creek	C	03715	LWW, AQL, WBC***		

* - Irrigation (IRR), Livestock & Wildlife Watering (LWW), Protection of Warm Water Aquatic Life and Human Health-Fish Consumption (AQL), Cool Water Fishery (CLF), Cold Water Fishery (CDF), Whole Body Contact Recreation (WBC), Secondary Contact Recreation (SCR), Drinking Water Supply (DWS), Industrial (IND), Groundwater (GRW).

** - Ecological Drainage Unit

*** - UAA has not been conducted.

N/A – Not Applicable.

RECEIVING STREAM(S) LOW-FLOW VALUES TABLE:

RECEIVING STREAM (U, C, P)	LOW-FLOW VALUES (CFS)		
	1Q10	7Q10	30Q10
P D Creek (U)	0	0	0

MIXING CONSIDERATIONS:

Mixing Zone: Not Allowed [10 CSR 20-7.031(4)(A)4.B.(I)(a)].

Zone of Initial Dilution: Not Allowed [10 CSR 20-7.031(4)(A)4.B.(I)(b)].

Part IV – Rationale and Derivation of Effluent Limitations & Permit Conditions

ANTI-BACKSLIDING:

A provision in the Federal Regulations [CWA §303(d)(4); CWA §402(c); 40 CFR Part 122.44(I)] that requires a reissued permit to be as stringent as the previous permit with some exceptions.

- All limits in this operating permit are at least as protective as those previously established; therefore, backsliding does not apply.

ANTIDEGRADATION:

In accordance with Missouri's Water Quality Standard [10 CSR 20-7.031(2)], the Department is to document by means of an Antidegradation Review that the use of a water body's available assimilative capacity is justified. Degradation is justified by documenting the socio-economic importance of a discharging activity after determining the necessity of the discharge.

- Renewal no degradation proposed and no further review necessary.

AREA-WIDE WASTE TREATMENT MANAGEMENT & CONTINUING AUTHORITY:

As per [10 CSR 20-6.010(3)(B)], An applicant may utilize a lower preference continuing authority by submitting, as part of the application, a statement waiving preferential status from each existing higher preference authority, providing the waiver does not conflict with any area-wide management plan approved under §208 of the Federal Clean Water Act or any other regional sewage service and treatment plan approved for higher preference authority by the Department.

BIOSOLIDS & SEWAGE SLUDGE:

Biosolids are solid materials resulting from domestic wastewater treatment that meet federal and state criteria for beneficial uses (e.g. fertilizer). Sewage sludge is solids, semi-solids, or liquid residue generated during the treatment of domestic sewage in a treatment works; including but not limited to, domestic septage; scum or solids removed in primary, secondary, or advanced wastewater treatment process; and a material derived from sewage sludge. Sewage sludge does not include ash generated during the firing of sewage sludge in a sewage sludge incinerator or grit and screening generated during preliminary treatment of domestic sewage in a treatment works. Additional information regarding biosolids and sludge is located at the following web address: <http://dnr.mo.gov/env/wpp/pub/index.html>, items WQ422 through WQ449.

- Sludge/biosolids are removed by contract hauler or are stored in the lagoon.

COMPLIANCE AND ENFORCEMENT:

Enforcement is the action taken by the Water Protection Program (WPP) to bring an entity into compliance with the Missouri Clean Water Law, its implementing regulations, and/or any terms and conditions of an operating permit. The primary purpose of the enforcement activity in the WPP is to resolve violations and return the entity to compliance.

- Not Applicable - The permittee/facility is not currently under Water Protection Program enforcement action.

REASONABLE POTENTIAL ANALYSIS (RPA):

Federal regulation [40 CFR Part 122.44(d)(1)(i)] requires effluent limitations for all pollutants that are or may be discharged at a level that will cause or have the reasonable potential to cause or contribute to an in-stream excursion above narrative or numeric water quality standard.

In accordance with [40 CFR Part 122.44(d)(iii)] if the permit writer determines that any give pollutant has the reasonable potential to cause, or contribute to an in-stream excursion above the WQS, the permit must contain effluent limits for that pollutant.

- Applicable - A RPA was conducted on appropriate parameters. Please see **Appendix A – RPA Results**.

REMOVAL EFFICIENCY:

Removal efficiency is a method by which the Federal Regulations define Secondary Treatment and Equivalent to Secondary Treatment, which applies to Biochemical Oxygen Demand 5-day (BOD₅) and Total Suspended Solids (TSS) for Publicly Owned Treatment Works (POTWs)/municipals.

- Not Applicable - Influent monitoring is not being required to determine percent removal.

SANITARY SEWER OVERFLOWS (SSO) AND INFLOW AND INFILTRATION (I&I):

Sanitary Sewer Overflows (SSOs) are defined as an untreated or partially treated sewage release, they are considered bypassing under state regulation [10 CSR 20-2.010(11)] and should not be confused with the federal definition of bypass. SSOs have a variety of causes including blockages, line breaks, and sewer defects that allow excess storm water and ground water to (1) enter and overload the collection system, and (2) overload the treatment facility. Additionally, SSOs can be also be caused by lapses in sewer system operation and maintenance, inadequate sewer design and construction, power failures, and vandalism. SSOs also include overflows out of manholes and onto city streets, sidewalks, and other terrestrial locations.

Additionally, Missouri RSMo §644.026.1 mandates that the Department require proper maintenance and operation of treatment facilities and sewer systems and proper disposal of residual waste from all such facilities.

- Not applicable - This facility is not required to develop or implement a program for maintenance and repair of the collection system; however, it is a violation of Missouri State Environmental Laws and Regulations to allow untreated wastewater to discharge to waters of the state.

SCHEDULE OF COMPLIANCE (SOC):

A schedule of remedial measures included in a permit, including an enforceable sequence of interim requirements (actions, operations, or milestone events) leading to compliance with the Missouri Clean Water Law, its implementing regulations, and/or the terms and conditions of an operating permit.

- Applicable - The time given for effluent limitations of this permit listed under Interim Effluent Limitation and Final Effluent Limitations were established in accordance with [10 CSR 20-7.031(10)].

WASTELOAD ALLOCATIONS (WLA) FOR LIMITS:

As per [10 CSR 20-2.010(78)], the amount of pollutant each discharger is allowed by the Department to release into a given stream after the Department has determined the total amount of pollutant that may be discharged into that stream without endangering its water quality.

- Applicable - Wasteload allocations were calculated where applicable using water quality criteria or water quality model results and the dilution equation:

$$C = \frac{(Cs \times Qs) + (Ce \times Qe)}{(Qe + Qs)} \quad (\text{EPA/505/2-90-001, Section 4.5.5})$$

Where C = downstream concentration
Cs = upstream concentration
Qs = upstream flow
Ce = effluent concentration
Qe = effluent flow

Chronic wasteload allocations were determined using applicable chronic water quality criteria (CCC: criteria continuous concentration) and stream volume of flow at the edge of the mixing zone (MZ). Acute wasteload allocations were determined using applicable water quality criteria (CMC: criteria maximum concentration) and stream volume of flow at the edge of the zone of initial dilution (ZID).

Water quality based maximum daily and average monthly effluent limitations were calculated using methods and procedures outlined in USEPA's *Technical Support Document for Water Quality-based Toxics Control* (TSD) (EPA/505/2-90-001).

Number of Samples "n": Additionally, in accordance with the TSD for water quality-based permitting, effluent quality is determined by the underlying distribution of daily values, which is determined by the Long Term Average (LTA) associated with a particular Wasteload Allocation (WLA) and by the Coefficient of Variation (CV) of the effluent concentrations. Increasing or decreasing the monitoring frequency does not affect this underlying distribution or treatment performance, which should, at a minimum, be targeted to comply with the values dictated by the WLA. Therefore, it is recommended that the actual planned frequency of monitoring normally be used to determine the value of "n" for calculating the AML. However, in situations where monitoring frequency is once per month or less, a higher value for "n" must be assumed for AML derivation purposes. Thus, the statistical procedure being employed using an assumed number of samples is "n = 4" at a minimum. For Total Ammonia as Nitrogen, "n = 30" is used.

WATER QUALITY STANDARDS:

Per [10 CSR 20-7.031(3)], General Criteria shall be applicable to all waters of the state at all times including mixing zones. Additionally, [40 CFR 122.44(d)(1)] directs the Department to establish in each NPDES permit conditions to achieve water quality established under Section 303 of the Clean Water Act, including State narrative criteria for water quality.

WHOLE EFFLUENT TOXICITY (WET) TEST:

A WET test is a quantifiable method of determining if a discharge from a facility may be causing toxicity to aquatic life by itself, in combination with or through synergistic responses when mixed with receiving stream water.

- Not Applicable - At this time, the permittee is not required to conduct WET test for this facility.

40 CFR 122.41(M) - BYPASSES:

The federal Clean Water Act (CWA), §402 prohibits wastewater dischargers from “bypassing” untreated or partially treated sewage (wastewater) beyond the headworks. A bypass, which includes blending, is defined as an intentional diversion of waste streams from any portion of a treatment facility, [40 CFR 122.41(m)(1)(i)]. Additionally, Missouri regulation [10 CSR 20-2.010(11)] defines a bypass as the diversion of wastewater from any portion of wastewater treatment facility or sewer system to waters of the state. Only under exceptional and specified limitations do the federal regulations allow for a facility to bypass some or all of the flow from its treatment process. Bypasses are prohibited by the CWA unless a permittee can meet all of the criteria listed in [40 CFR 122.41(m)(4)(i)(A), (B), & (C)]. Any bypasses from this facility are subject to the reporting required in [40 CFR 122.41(1)(6)] and per Missouri’s Standard Conditions I, Section B, part 2.b. Additionally, anticipated Bypasses include bypasses from peak flow basins or similar devices designed for peak wet weather flows.

- Not Applicable - This facility does not bypass.

303(d) LIST & TOTAL MAXIMUM DAILY LOAD (TMDL):

§303(d) of the federal Clean Water Act requires that each state identify waters that are not meeting water quality standards and for which adequate water pollution controls have not been required. Water quality standards protect such beneficial uses of water as whole body contact (such as swimming), maintaining fish and other aquatic life, and providing drinking water for people, livestock and wildlife. The 303(d) list helps state and federal agencies keep track of waters that are impaired but not addressed by normal water pollution control programs.

A TMDL is a calculation of the maximum amount of a given pollutant that a body of water can assimilate before its water quality is affected. If a water body is determined to be impaired, as listed on the 303(d) list, then a watershed management plan will be developed that shall include a TMDL calculation.

- Not Applicable - This facility does not discharge to a 303(d) listed stream.

Part V – Effluent Limits Determination

Outfall #001 – Main Facility Outfall

Effluent limitations derived and established in the below Effluent Limitations Table are based on current operations of the facility. Future permit action due to facility modification may contain new operating permit terms and conditions that supersede the terms and conditions, including effluent limitations, of this operating permit.

EFFLUENT LIMITATIONS TABLE:

PARAMETER	UNIT	BASIS FOR LIMITS	DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MODIFIED	PREVIOUS PERMIT LIMITATIONS
Flow	MGD	1	*		*	No	S
BOD ₅	mg/L	1		45	30	No	S
TSS	mg/L	1		45	30	No	S
pH	SU	1	6.5 – 9.0		6.5 – 9.0	Yes	6.0 – 9.0
Ammonia as N (Interim)	mg/L	1/5	*		*	No	S
Ammonia as N (Final) (April 1 – Sept. 30)	mg/L	2/5/9	3.6		1.4	Yes	*
Ammonia as N (Final) (Oct. 1 – March 31)	mg/L	2/5/9	7.5		2.9	Yes	*
Temperature (effluent)	°C	3/5/9	*		*	No	S
Oil & Grease	mg/L	1/3/9	15		10	N/A	**

* - Monitoring requirement only.

** - Parameter was not established in previous state operating permit.

N/A – Not applicable.

S – Same as previous operating permit.

Basis for Limitations Codes:

- | | |
|--|------------------------------------|
| 1. State or Federal Regulation/Law | 7. Antidegradation Policy |
| 2. Water Quality Standard (includes RPA) | 8. Water Quality Model |
| 3. Water Quality Based Effluent Limits | 9. Best Professional Judgment |
| 4. Lagoon Policy | 10. TMDL or Permit in lieu of TMDL |
| 5. Ammonia Policy | 11. WET Test Policy |
| 6. Antidegradation Review | |

OUTFALL #001 – DERIVATION AND DISCUSSION OF LIMITS:

- **Flow.** In accordance with [40 CFR Part 122.44(i)(1)(ii)] the volume of effluent discharged from each outfall is needed to assure compliance with permitted effluent limitations. If the permittee is unable to obtain effluent flow, then it is the responsibility of the permittee to inform the Department, which may require the submittal of an operating permit modification.
- **Biochemical Oxygen Demand (BOD₅).** Effluent limitations from the previous state operating permit have been reassessed and verified that they are still protective of the receiving stream’s Water Quality. Therefore, effluent limitations have been retained from previous state operating permit. [10 CSR 20-7.015(8)(A)3.B].
- **Total Suspended Solids (TSS).** Effluent limitations from the previous state operating permit have been reassessed and verified that they are still protective of the receiving stream’s Water Quality. Therefore, effluent limitations have been retained from previous state operating permit. [10 CSR 20-7.015(8)(A)3.B].
- **pH.** Effluent limitations have been modified to reflect the change in the Code of State Regulations. pH is measured in standard pH units and is not to be averaged. The pH is to be maintained at or above 6.5 pH units. The pH is limited to the range of 6.5-9.0 pH units. [10 CSR 20-7.015(8)(A)2].
- **Total Ammonia Nitrogen.** Early Life Stages Present Total Ammonia Nitrogen criteria apply [10 CSR 20-7.031(4)(B)7.C. & Table B3] default pH 7.8 SU, default background total ammonia nitrogen = 0.01 mg/L. No mixing considerations allowed; therefore, WLA = appropriate criterion.

Season	Temp (°C)	pH (SU)	Total Ammonia Nitrogen CCC (mg/L)	Total Ammonia Nitrogen CMC (mg/L)
Summer	26	7.8	1.5	12.1
Winter	6	7.8	3.1	12.1

Summer: April 1 – September 30

Chronic WLA: $C_e = 1.5 \text{ mg/L}$

Acute WLA: $C_e = 12.1 \text{ mg/L}$

$LTA_c = 1.5 \text{ mg/L} (0.780) = \mathbf{1.17 \text{ mg/L}}$

[CV = 0.6, 99th Percentile, 30 day avg.]

$LTA_a = 12.1 \text{ mg/L} (0.321) = 3.88 \text{ mg/L}$

[CV = 0.6, 99th Percentile]

Use most protective number of LTA_c or LTA_a .

$MDL = 1.17 \text{ mg/L} (3.11) = 3.64 \text{ mg/L}$

[CV = 0.6, 99th Percentile]

$AML = 1.17 \text{ mg/L} (1.19) = 1.39 \text{ mg/L}$

[CV = 0.6, 95th Percentile, n = 30]

Winter: October 1 – March 31

Chronic WLA: $C_e = 3.1 \text{ mg/L}$

Acute WLA: $C_e = 12.1 \text{ mg/L}$

$LTA_c = 3.1 \text{ mg/L} (0.780) = \mathbf{2.42 \text{ mg/L}}$

[CV = 0.6, 99th Percentile, 30 day avg.]

$LTA_a = 12.1 \text{ mg/L} (0.321) = 3.88 \text{ mg/L}$

[CV = 0.6, 99th Percentile]

Use most protective number of LTA_c or LTA_a .

$MDL = 2.42 \text{ mg/L} (3.11) = 7.53 \text{ mg/L}$

[CV = 0.6, 99th Percentile]

$AML = 2.42 \text{ mg/L} (1.19) = 2.88 \text{ mg/L}$

[CV = 0.6, 95th Percentile, n = 30]

Season	Maximum Daily Limit (mg/L)	Average Monthly Limit (mg/L)
Summer	3.6	1.4
Winter	7.5	2.9

- **Temperature.** Monitoring requirement due to the toxicity of Ammonia varies by temperature. [10 CSR 20-7.031(4)(B)7]

- **Oil & Grease.** Conventional pollutant, effluent limitation for protection of aquatic life; 10 mg/L monthly average, 15 mg/L daily maximum. [10 CSR 20-7.031(4)(B)1]
- **Minimum Sampling and Reporting Frequency Requirements.** Sampling and reporting frequency requirements have been retained from the previous permit.

Part VI – Administrative Requirements

On the basis of preliminary staff review and the application of applicable standards and regulations, the Department, as administrative agent for the Missouri Clean Water Commission, proposes to issue a permit(s) subject to certain effluent limitations, schedules, and special conditions contained herein and within the operating permit. The proposed determinations are tentative pending public comment.

PUBLIC NOTICE:

The Department shall give public notice that a draft permit has been prepared and its issuance is pending. Additionally, public notice will be issued if a public hearing is to be held because of a significant degree of interest in and water quality concerns related to a draft permit. No public notice is required when a request for a permit modification or termination is denied; however, the requester and permittee must be notified of the denial in writing.

The Department must issue public notice of a pending operating permit or of a new or reissued statewide general permit. The public comment period is the length of time not less than 30 days following the date of the public notice which interested persons may submit written comments about the proposed permit.

For persons wanting to submit comments regarding this proposed operating permit, then please refer to the Public Notice page located at the front of this draft operating permit. The Public Notice page gives direction on how and where to submit appropriate comments.

- The Public Notice period for this operating permit is tentatively scheduled to begin on October 28, 2011, or is in process.

- The Public Notice period for this operating permit was from October 28, 2011, to November 29, 2011. No responses received or responses to the Public Notice of this operating permit do not warrant the modification of effluent limits and/or the terms and conditions of this permit.

DATE OF FACT SHEET: OCTOBER 24, 2011

COMPLETED BY:

Terrie Burch, Environmental Specialist
Kansas City Regional Office
NPDES Permitting Unit
816-622-7047
terrie.burch@dnr.mo.gov

Part VII – Appendices

APPENDIX A – RPA RESULTS:

Parameter	CMC*	CCC*	RWC*	n**	Range min - max	CV***	MF	RP Acute Yes/No	RP Chronic Yes/No
Ammonia as N - Summer (April 1 – Oct 31)	12.1	1.5	7.2	7	ND – 2.0	0.6	3.6	No	Yes
Ammonia as N - Winter (Nov 1 – Apr 30)	12.1	3.1	136.8	7	0.14 - 38	0.6	3.6	Yes	Yes

N/A – Not Applicable

* - Units are mg/L.

** - n is the number of samples. If the number of samples is greater than 10, then the CV value must be used in the WQBEL.

*** - Coefficient of Variation (CV) is calculated by dividing the Standard Deviation (σ) of the sample set by the Mean (μ) of the same sample set.

CMC - Criteria Maximum Concentration. It is the maximum acute concentration of the constituent allowed in the receiving water as specified by 10 CSR 20-7.031.

CCC - Criteria Continuous Concentration. It is the maximum chronic concentration of the constituent allowed in the receiving stream as specified by 10 CSR 20-7.031.

RWC - Receiving Water Concentration. It is the projected maximum concentration of the constituent discharged from the facility calculated from available data.


MF - Multiplying Factor. 99% Confidence Level and 99% Probability Basis.

RP - Reasonable Potential. It is where an effluent is projected or calculated to cause an excursion above a water quality standard based on a number of factors including, as a minimum, the four factors listed in 40 CFR 122.44(d)(1)(ii).

Reasonable Potential Analysis was conducted as per (TSD, EPA/505/2-90-001, Section 3.3.2). A more detailed version, including calculations, is available upon request.

APPENDIX B – FACILITY LOCATION MAP:

MO-0121151
 Warsaw R-9 South Elementary

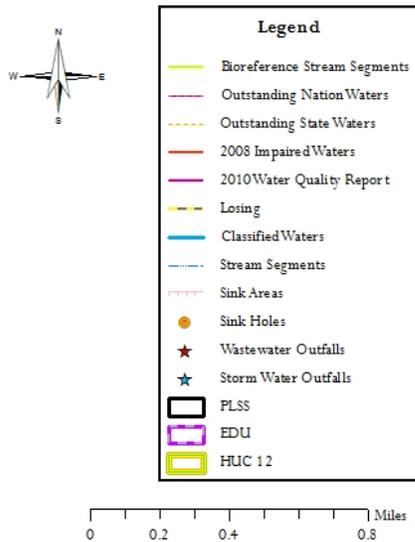

MO-0121151
 Warsaw R-9 South Elementary
 NE ¼, SW ¼, Sec. 6, T39N, R21W, Benton County
 UTM: X = 476138.282, Y = 4224872.419
 Tributary to P D Creek (U)
 1st Class: P D Creek (C) (03715)
 Huc12: (10290109-0102)
 EDU: Ozark/Osage

