

STATE OF MISSOURI
DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION



MISSOURI STATE OPERATING PERMIT

In compliance with the Missouri Clean Water Law, (Chapter 644 R.S. Mo. as amended, hereinafter, the Law), and the Federal Water Pollution Control Act (Public Law 92-500, 92nd Congress) as amended,

Permit No. MO-0086274

Owner: Lakeside Manor LLC, c/o David & Tammy Brown
Address: P.O. Box 455, Festus, MO, 63028

Continuing Authority: Same as above
Address: Same as above

Facility Name: Lakeside Manor
Facility Address: #1 Blue Fountain, Festus, MO 63028

Legal Description: SE ¼, NE ¼, SE ¼, Sec. 19, T40N, R6E; Jefferson County
Latitude/Longitude: +381039.2/ -0902328.3

Receiving Stream: Plattin Creek (P)
First Classified Stream and ID: Plattin Creek (P) (01728)
USGS Basin & Sub-watershed No.: (07140101-170002)

is authorized to discharge from the facility described herein, in accordance with the effluent limitations and monitoring requirements as set forth herein:

FACILITY DESCRIPTION

Outfall #001 – Mobile Home Park - SIC # 4952
Two cell facultative lagoon/ chlorination/ dechlorination/sludge is retained in the lagoon
Design population equivalent is 278.
Design flow is 27,750 gallons per day.
Actual flow is 4,500 gallons per day.
Design sludge production is 4.17 dry tons/year.

This permit authorizes only wastewater discharges under the Missouri Clean Water Law and the National Pollutant Discharge Elimination System; it does not apply to other regulated areas. This permit may be appealed in accordance with Section 644.051.6 of the Law.

Handwritten signature of Doyle Childers in black ink.

February 9, 2007
Effective Date

Doyle Childers, Director, Department of Natural Resources
Executive Secretary, Clean Water Commission

February 8, 2012
Expiration Date

Mike Struckhoff, Director, St. Louis Regional Office

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS					PAGE NUMBER 2 of 4	
					PERMIT NUMBER MO-0086274	
The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The final effluent limitations shall become effective upon issuance and remain in effect until expiration of the permit. Such discharges shall be controlled, limited and monitored by the permittee as specified below:						
(OUTFALL NUMBER AND EFFLUENT PARAMETERS)	UNITS	FINAL EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
<u>Outfall #001</u>						
Flow	MGD	*		*	Once/week	24 hour est.
Temperature	°C	*		*	Once/month	grab
Biochemical Oxygen Demand ₅	mg/L		65	45	Once/month	grab
Total Suspended Solids	mg/L		110	80	Once/month	grab
pH – Units	SU	**		**	Once/month	grab
Ammonia as N	mg/L	*		*	Once/month	grab
Fecal Coliform (Note 1)	#/100 mL	1000		400	Once/month	grab
Total Residual Chlorine (Notes 1 & 2)	mg/L	0.019 (.13ML)		0.01 (.13 ML)	Once/month	grab
MONITORING REPORTS SHALL BE SUBMITTED MONTHLY THE FIRST REPORT IS DUE March 28, 2007 . THERE SHALL BE NO DISCHARGE OF FLOATING SOLIDS OR VISIBLE FOAM IN OTHER THAN TRACE AMOUNTS.						
B. STANDARD CONDITIONS						
IN ADDITION TO SPECIFIED CONDITIONS STATED HEREIN, THIS PERMIT IS SUBJECT TO THE ATTACHED <u>Parts I & III</u> STANDARD CONDITIONS DATED <u>October 1, 1980</u> and <u>August 15, 1994</u> , AND HEREBY INCORPORATED AS THOUGH FULLY SET FORTH HEREIN.						

MO 780-0010 (8/91)

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

- * Monitoring requirement only.
- ** pH is measured in pH units and is not to be averaged. The pH is limited to the range of 6.0 to 9.0 pH units

Note 1 – Final limitations and monitoring requirements for Fecal Coliform and Total Residual Chlorine are applicable only during the recreational season from April 1 through October 31.

Note 2 - This permit contains a Total Residual Chlorine (TRC) limit.

- (a) This effluent limit is below the minimum quantification level (ML) of the most common and practical EPA approved CLTRC methods. The department has determined the current acceptable ML for total residual chlorine to be 0.13 mg/L when using the DPD Colorimetric Method #4500 – CL G. from Standard Methods for the Examination of Waters and Wastewater. The permittee will conduct analyses in accordance with this method, or equivalent, and report actual analytical values. Measured values greater than or equal to the minimum quantification level of 0.13 mg/L will be considered violations of the permit and values less than the minimum quantification level of 0.13 mg/L will be considered to be in compliance with the permit limitation. The minimum quantification level does not authorize the discharge of chlorine in excess of the effluent limits stated in the permit.
- (b) Disinfection is required year-round unless the permit specifically states that “Final limitations and monitoring requirements for Fecal Coliform are applicable only during the recreational season from April 1 through October 31.” If your permit does not require disinfection during the non-recreational months, do not chlorinate in those months.
- (c) Do not chemically dechlorinate **if it is not needed to meet the limits in your permit**.
- (d) If no chlorine was used in a given sampling period, an actual analysis is not necessary. Simply report as “0 mg/L” TRC.

C. SPECIAL CONDITIONS

1. This permit may be reopened and modified, or alternatively revoked and reissued, to:
 - a. Comply with any applicable effluent standard or limitation issued or approved under Sections 301(b)(2)(C) and (D), 304(b)(2), and 307(a) (2) of the Clean Water Act, if the effluent standard or limitation so issued or approved:
 - (1) contains different conditions or is otherwise more stringent than any effluent limitation in the permit; or
 - (2) controls any pollutant not limited in the permit.
 - b. Incorporate new or modified effluent limitations or other conditions, if the result of a waste load allocation study, toxicity test or other information indicates changes are necessary to assure compliance with Missouri's Water Quality Standards.
 - c. Incorporate new or modified effluent limitations or other conditions if, as the result of a watershed analysis, a Total Maximum Daily Load (TMDL) limitation is developed for the receiving waters which are currently included in Missouri's list of waters of the state not fully achieving the state's water quality standards, also called the 303(d) list.

The permit as modified or reissued under this paragraph shall also contain any other requirements of the Clean Water Act then applicable.
2. All outfalls must be clearly marked in the field.
3. Permittee will cease discharge by connection to areawide wastewater treatment system within 90 days of notice of its availability.
4. Changes in Discharges of Toxic Substances.

The permittee shall notify the Director as soon as it knows or has reason to believe:

 - a. That any activity has occurred or will occur which would result in the discharge of any toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following "notification levels:"
 - (1) One hundred micrograms per liter (100 µg/L);
 - (2) Two hundred micrograms per liter (200 µg/L) for acrolein and acrylonitrile; five hundred micrograms per liter (500 µg/L) for 2,5 dinitrophenol and for 2-methyl-4, 6-dinitrophenol; and one milligram per liter (1 mg/L) for antimony;
 - (3) Five (5) times the maximum concentration value reported for the pollutant in the permit application;
 - (4) The level established in Part A of the permit by the Director.
 - b. That they have begun or expect to begin to use or manufacture as an intermediate or final product or byproduct any toxic pollutant, which was not reported in the permit application.
 - c. That the effluent limit established in part A of the permit will be exceeded.
5. Report as no-discharge when a discharge does not occur during the report period.
6. Water Quality Standards.
 - a. Discharges to waters of the state shall not cause a violation of water quality standards rule under 10 CSR 20-7.031, including both specific and general criteria.
 - b. General Criteria. The following general water quality criteria shall be applicable to all waters of the state at all times including mixing zones. No water contaminant, by itself or in combination with other substances, shall prevent the waters of the state from meeting the following conditions:
 - (1) Waters shall be free from substances in sufficient amounts to cause the formation of putrescent, unsightly or harmful bottom deposits or prevent full maintenance of beneficial uses;
 - (2) Waters shall be free from oil, scum and floating debris in sufficient amounts to be unsightly or prevent full maintenance of beneficial uses;
 - (3) Waters shall be free from substances in sufficient amounts to cause unsightly color or turbidity, offensive odor or prevent full maintenance of beneficial uses;
 - (4) Waters shall be free from substances or conditions in sufficient amounts to result in toxicity to human, animal or aquatic life;
 - (5) There shall be no significant human health hazard from incidental contact with the water;
 - (6) There shall be no acute toxicity to livestock or wildlife watering;
 - (7) Waters shall be free from physical, chemical or hydrologic changes that would impair the natural biological community;
 - (8) Waters shall be free from used tires, car bodies, appliances, demolition debris, used vehicles or equipment and solid waste as defined in Missouri's Solid Waste Law, section 260.200, RSMo, except as the use of such materials is specifically permitted pursuant to section 260.200-260.247.
7. Sludge and Biosolids Use For Domestic Wastewater Treatment Facilities
 - a. Permittee shall comply with the pollutant limitations, monitoring, reporting, and other requirements in accordance with the attached permit Standard Conditions.

C. SPECIAL CONDITIONS (continued)

- b. If sludge is not removed by a contract hauler, permittee is authorized to land apply biosolids. Permit Standard Conditions, Part III shall apply to the land application of biosolids. Permittee shall notify the department at least 180 days prior to the planned removal of biosolids. The department may require submittal of a biosolids management plan for department review and approval as determined appropriate on a case-by-case basis.

Date of Fact Sheet: December 6, 2006

Date of Public Notice: December 15, 2006

**NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES) PERMIT
FACT SHEET**

This Fact Sheet explains the applicable regulations and rationale for development of this permit and the public participation process.

NPDES PERMIT NUMBER: MO-0086274

FACILITY NAME: Lakeside Manor

OWNER NAME: Lakeside Manor LLC, c/o David & Tammy Brown

LOCATION: # 1 Blue Fountain, Festus, MO 63028

RECEIVING STREAM: Plattin Creek

FACILITY CONTACT PERSON: David & Tammy Brown TEL (636) 933-0946

FACILITY DESCRIPTION AND RATIONALE

Effluent limitations for BOD, TSS, and pH are consistent with those found in the regulation for the receiving waterbody (01728)[10 CSR 20-7.015 (8)(B)3A] In order to expedite the reissuance of State Operating Permits for existing lagoons, a procedure has been established to renew the operating permits for lagoons that have "equivalent to secondary" treatment effluent limits in the absence of a water quality impact study. Permits are being updated to incorporate new water quality criteria, receiving stream classification, or wasteload allocations and monitoring requirements as stipulated by a Total Maximum Daily Load (TMDL). (See attached Water Quality Review Sheet Check List) If there has been no stream survey conducted within the past five years, there is no observable water quality impacts, and the facility has been in compliance with their existing operating permit, then the operating permit will be renewed maintaining the existing lagoon limits with a reopener clause.

This permit will be issued for a period of five years.



Missouri Department of Natural Resources
 Water Protection Program
 Water Pollution Control Branch
 NPDES Permits and Engineering Section

Water Quality Review Sheet Check List

Lagoon Operating Permit Renewal

Facility Information

FACILITY NAME: Lakeside Manor PERMIT #: MO-0086274
 FACILITY TYPE: Two cell facultative lagoon AGE: 20+ years

Outfall Characteristics

OUTFALL	DESIGN FLOW (MGD)	ACTUAL FLOW (MGD)	ACTUAL FLOW/DESIGN FLOW
#001	0.02775	0.0045	16.2 %

Effluent Characteristics

Biochemical Oxygen Demand (BOD₅) In Compliance Significant Noncompliance
 Total Suspended Solids (TSS) In Compliance Significant Noncompliance
 Percent Removal (>65%) BOD & TSS In Compliance Significant Noncompliance
 N/A

Effluent Limit/Monitoring Requirement Frequency at regulatory minimum: Yes No

Receiving Waterbody Information


WATERBODY NAME: Plattin Creek CLASS P
 WATERBODY NAME: _____ CLASS _____

Discharge to or within two (2) miles of a losing stream (10 CSR 20-7.031, Table J or as determined by GSRAD)
 Discharge to or within two (2) miles of a classified waterbody designated for whole body contact recreation
 Use Attainability Analysis Conducted
 Stream Survey Conducted within the past five (5) years Observed water quality impacts

If the facility discharges to any of the waterbody types below, is within an area experiencing rapid development, or if a site-specific water quality impact study has been conducted, this form is not applicable.

Lake/Reservoir 303(d) Waterbody Metropolitan No-Discharge Stream

Outstanding National/State Resource Water and Drainages Thereto

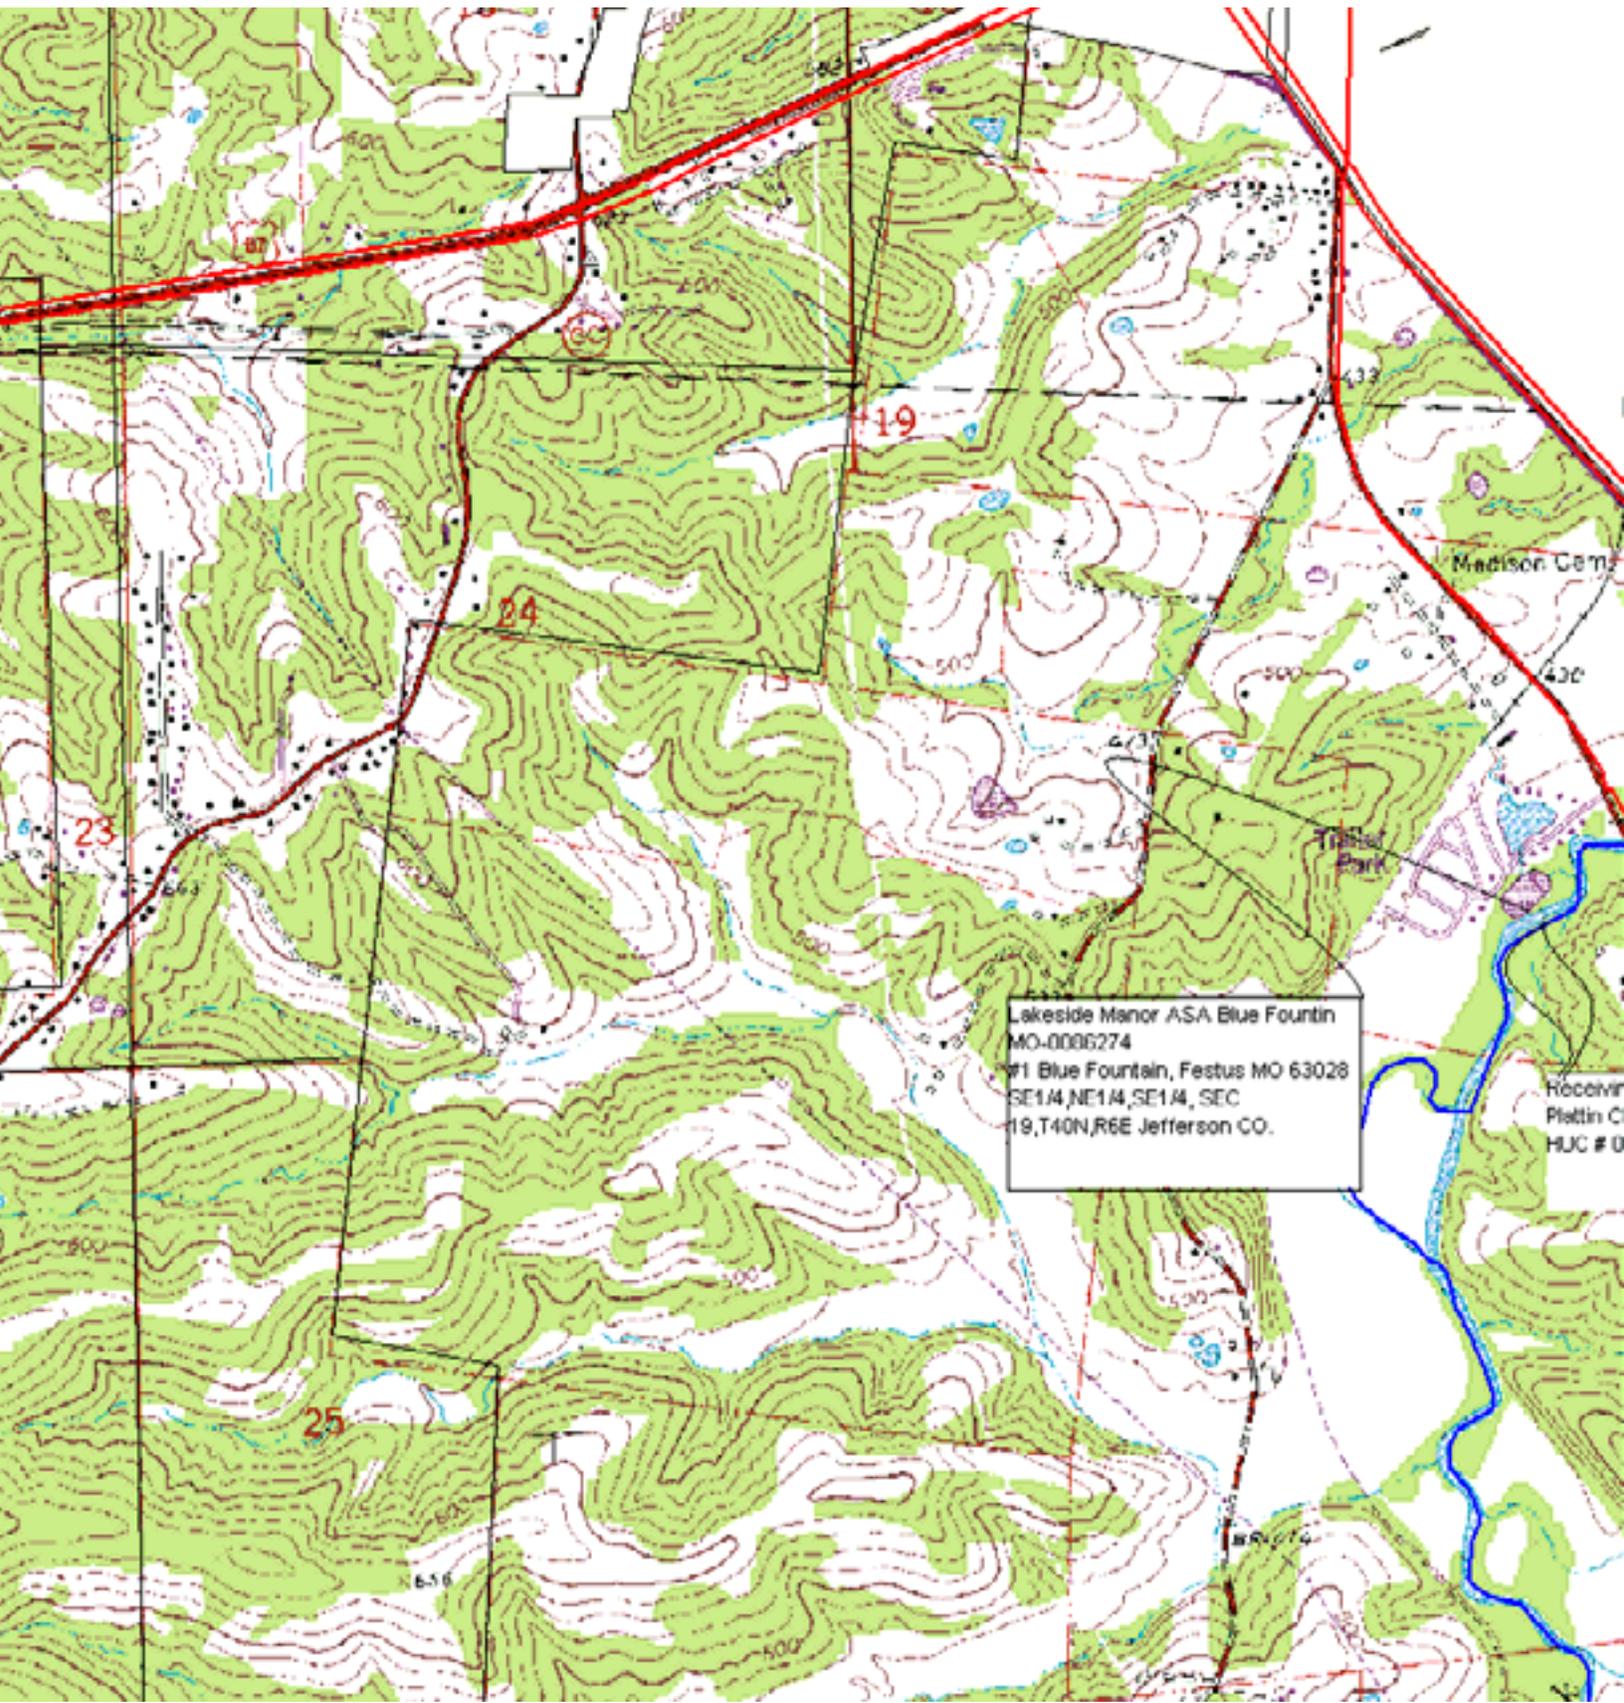

Lakeside Manor ASA Blue Fountain
MO-0006274
#1 Blue Fountain, Festus MO 63028
SE1/4 NE1/4, SEC 19, T40N, R6E Jefferson CO.

Madison Cem

Trest Park

Receiver
Platin C
HJC # 0