

STATE OF MISSOURI
DEPARTMENT OF NATURAL RESOURCES

MISSOURI CLEAN WATER COMMISSION



MISSOURI STATE OPERATING PERMIT

In compliance with the Missouri Clean Water Law, (Chapter 644 R.S. Mo. as amended, hereinafter, the Law), and the Federal Water Pollution Control Act (Public Law 92-500, 92nd Congress) as amended,

Permit No. MO-0109657

Owner: Paradise Landing Kimberling Shores Treatment Facility
Address: 1000 Paradise Landing, Kimberling City, MO 65686

Continuing Authority: Same as above
Address: Same as above

Facility Name: Paradise Landing Kimberling Shores Treatment Facility
Facility Address: 1002 Paradise Landing, Kimberling City, MO 65686

Legal Description: SE $\frac{1}{4}$, NE $\frac{1}{4}$, SE $\frac{1}{4}$, Sec. 16, T22N, R23W, Stone County
UTM Coordinates: X= 462345, Y= 4051670

Receiving Stream: Table Rock Lake (L2)
First Classified Stream and ID: Table Rock Lake (L2) (7313) 303(d)
USGS Basin & Sub-watershed No.: (11010001-1401)

is authorized to discharge from the facility described herein, in accordance with the effluent limitations and monitoring requirements as set forth herein:

FACILITY DESCRIPTION

Outfall #001 – Residential Subdivision– SIC # 8641

Flow equalization / extended aeration / chemical addition to facilitate phosphorus removal / chlorination / dechlorination / sludge disposal by contract hauler.

Design population equivalent is 507


Design flow is 43,140 gallons per day.

Actual flow is 29,999 gallons per day.

Design sludge production is 7.8 dry tons/year.

This permit authorizes only wastewater discharges under the Missouri Clean Water Law and the National Pollutant Discharge Elimination System; it does not apply to other regulated areas. This permit may be appealed in accordance with Section 621.250 RSMo, Section 640.013 RSMo and Section 644.051.6 of the Law.

November 1, 2013
Effective Date

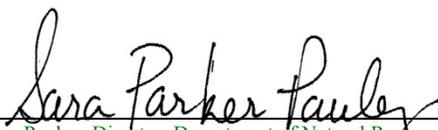
Sara Parker Pauley, Director, Department of Natural Resources

October 31, 2018
Expiration Date


John Madras, Director, Water Protection Program

OUTFALL #001	TABLE A. FINAL EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS	PAGE NUMBER 2 of 6
		PERMIT NUMBER MO-0109657

The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The final effluent limitations shall become effective upon issuance and remain in effect until expiration of the permit. Such discharges shall be controlled, limited and monitored by the permittee as specified below:

EFFLUENT PARAMETER(S)	UNITS	FINAL EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
Flow	MGD	*		*	once/quarter****	24 hr. estimate
Biochemical Oxygen Demand ₅	mg/L		30	20	once/quarter****	composite**
Total Suspended Solids	mg/L		30	20	once/quarter****	composite**
<i>E. coli</i> (Note 1, Page 3)	#/100 ml		630	126	once/quarter****	grab
pH – Units	SU	***		***	once/quarter****	grab
Ammonia as N (April 1 – Sept 30) (Oct 1 – March 31)	mg/L	12.1 12.1		3.1 3.6	once/quarter****	grab
Total Phosphorus as P	mg/L			0.5	once/quarter****	grab
Total Residual Chlorine (Note 2, Page 3)	µg/L	17 (130ML)		8 (130ML)	once/quarter****	grab
Aluminum, Total Recoverable (Note 3, Page 3)	mg/L	*		*	once/quarter****	grab

EFFLUENT PARAMETER(S)	UNITS	DAILY MINIMUM	WEEKLY AVERAGE MINIMUM	MONTHLY AVERAGE MINIMUM	MEASUREMENT FREQUENCY	SAMPLE TYPE
Dissolved Oxygen	mg/L	*		*	once/quarter****	grab

MONITORING REPORTS SHALL BE SUBMITTED QUARTERLY; THE FIRST REPORT IS DUE JANUARY 28, 2014.

Whole Effluent Toxicity (WET) test	% Survival	See Special Condition # 16	once/permit cycle	composite**
------------------------------------	------------	----------------------------	-------------------	-------------

WET TEST REPORTS SHALL BE SUBMITTED ONCE PER PERMIT CYCLE; THE FIRST REPORT IS DUE BY NOVEMBER 28, 2018.

- * Monitoring requirement only.
- ** A composite sample made up from a minimum of four grab samples collected within a 24 hour period with a minimum of two hours between each grab sample.
- *** pH is measured in pH units and is not to be averaged. The pH is limited to the range of 6.5-9.0 pH units
- **** See table below for quarterly sampling

Minimum Sampling Requirements				
Quarter	Months	<i>E. coli</i> and Total Residual Chlorine (TRC)	All Other Parameters	Report is Due
First	January, February, March	Not required to sample.	Sample at least once during any month of the quarter	April 28 th
Second	April, May, June	Sample at least once during any month of the quarter	Sample at least once during any month of the quarter	July 28 th
Third	July, August, September	Sample at least once during any month of the quarter	Sample at least once during any month of the quarter	October 28 th
Fourth	October, November, December	Sample once during October; no sample required in either November or December	Sample at least once during any month of the quarter	January 28 th

Note 1 - Effluent limitations and monitoring requirements for *E. coli* are applicable only during the recreational season from April 1 through October 31. The Monthly Average Limit for *E. coli* is expressed as a geometric mean.

Note 2 - This permit contains a Total Residual Chlorine (TRC) limit.

This effluent limit is below the minimum quantification level (ML) of the most common and practical EPA approved CLTRC methods. The department has determined the current acceptable ML for total residual chlorine to be 130 µg/L when using the DPD Colorimetric Method #4500 – CL G. from Standard Methods for the Examination of Waters and Wastewater. The permittee will conduct analyses in accordance with this method, or equivalent, and report actual analytical values. Measured values greater than or equal to the minimum quantification level of 130 µg/L will be considered violations of the permit and values less than the minimum quantification level of 130 µg/L will be considered to be in compliance with the permit limitation. The minimum quantification level does not authorize the discharge of chlorine in excess of the effluent limits stated in the permit.

- (a) Disinfection is required during the recreational season from April 1 through October 31. Do not chlorinate during the non-recreational months.
- (b) Do not chemically de-chlorinate **if it is not needed to meet the limits in your permit.**
- (c) If no chlorine was used in a given sampling period, an actual analysis is not necessary. Simply report as “0 µg/L” TRC.

Note 3 - If no Aluminum or Iron was used in a given sampling period, an actual analysis is not necessary. Simply report as “0 mg/L”.

B. STANDARD CONDITIONS

In addition to specified conditions stated herein, this permit is subject to the attached Parts I & III standard conditions dated October 1, 1980 and August 15, 1994, and hereby incorporated as though fully set forth herein.

C. SPECIAL CONDITIONS

1. This permit establishes final ammonia limitations based on Missouri’s current Water Quality Standard. On August 22, 2013, the Environmental Protection Agency (EPA) published a notice in the Federal Register announcing the final national recommended ambient water quality criteria for protection of aquatic life from the effects of ammonia in freshwater. The EPA’s guidance, Final Aquatic Life Ambient Water Quality Criteria for Ammonia – Fresh Water 2013, is not a rule, nor automatically part of a state’s water quality standards. States must adopt new ammonia criteria consistent with EPA’s published ammonia criteria into their water quality standards that protect the designated uses of the water bodies. The Department of Natural Resources intends to adopt the new ammonia criteria during the next review. Information on this topic can be obtained by viewing the Department’s 2013 EPA criteria Factsheet located at <http://dnr.mo.gov/pubs/pub2481.pdf>.
2. This permit may be reopened and modified, or alternatively revoked and reissued, to:
 - (a) Comply with any applicable effluent standard or limitation issued or approved under Sections 301(b)(2)(C) and (D), 304(b)(2), and 307(a) (2) of the Clean Water Act, if the effluent standard or limitation so issued or approved:
 - (1) contains different conditions or is otherwise more stringent than any effluent limitation in the permit; or
 - (2) controls any pollutant not limited in the permit.
 - (b) Incorporate new or modified effluent limitations or other conditions, if the result of a waste load allocation study, toxicity test or other information indicates changes are necessary to assure compliance with Missouri’s Water Quality Standards.
 - (c) Incorporate new or modified effluent limitations or other conditions if, as the result of a watershed analysis, a Total Maximum Daily Load (TMDL) limitation is developed for the receiving waters which are currently included in Missouri’s list of waters of the state not fully achieving the state’s water quality standards, also called the 303(d) list.

The permit as modified or reissued under this paragraph shall also contain any other requirements of the Clean Water Act then applicable.

3. All outfalls must be clearly marked in the field.
4. Permittee will cease discharge by connection to a facility with an area-wide management plan per 10 CSR 20-6.010(3)(B) within 90 days of notice of its availability.

C. SPECIAL CONDITIONS (continued)

5. Water Quality Standards

- (a) Discharges to waters of the state shall not cause a violation of water quality standards rule under 10 CSR 20-7.031, including both specific and general criteria.
- (b) General Criteria. The following general water quality criteria shall be applicable to all waters of the state at all times including mixing zones. No water contaminant, by itself or in combination with other substances, shall prevent the waters of the state from meeting the following conditions:
 - (1) Waters shall be free from substances in sufficient amounts to cause the formation of putrescent, unsightly or harmful bottom deposits or prevent full maintenance of beneficial uses;
 - (2) Waters shall be free from oil, scum and floating debris in sufficient amounts to be unsightly or prevent full maintenance of beneficial uses;
 - (3) Waters shall be free from substances in sufficient amounts to cause unsightly color or turbidity, offensive odor or prevent full maintenance of beneficial uses;
 - (4) Waters shall be free from substances or conditions in sufficient amounts to result in toxicity to human, animal or aquatic life;
 - (5) There shall be no significant human health hazard from incidental contact with the water;
 - (6) There shall be no acute toxicity to livestock or wildlife watering;
 - (7) Waters shall be free from physical, chemical or hydrologic changes that would impair the natural biological community;
 - (8) Waters shall be free from used tires, car bodies, appliances, demolition debris, used vehicles or equipment and solid waste as defined in Missouri's Solid Waste Law, section 260.200, RSMo, except as the use of such materials is specifically permitted pursuant to section 260.200-260.247.

6. Changes in Discharges of Toxic Substances

The permittee shall notify the Director as soon as it knows or has reason to believe:

- (a) That any activity has occurred or will occur which would result in the discharge of any toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following "notification levels":
 - (1) One hundred micrograms per liter (100 µg/L);
 - (2) Two hundred micrograms per liter (200 µg/L) for acrolein and acrylonitrile; five hundred micrograms per liter (500 µg/L) for 2,5 dinitrophenol and for 2-methyl-4, 6-dinitrophenol; and one milligram per liter (1 mg/L) for antimony;
 - (3) Five (5) times the maximum concentration value reported for the pollutant in the permit application;
 - (4) The level established by the Director in accordance with 40 CFR 122.44(f).
- (b) That they have begun or expect to begin to use or manufacture as an intermediate or final product or byproduct any toxic pollutant, which was not reported in the permit application.

7. Report as no-discharge when a discharge does not occur during the report period.

8. It is a violation of the Missouri Clean Water Law to fail to pay fees associated with this permit (644.055 RSMo).

9. Bypasses are not authorized at this facility and are subject to 40 CFR 122.41(m). If a bypass occurs, the permittee shall report in accordance to 40 CFR 122.41(m)(3)(i), and with Standard Condition Part I, Section B, subsection 2.b. Bypasses are to be reported to the Southwest Regional Office.

10. The facility must be sufficiently secured to restrict entry by children, livestock and unauthorized persons as well as to protect the facility from vandalism.

11. A least one gate must be provided to access the wastewater treatment facility and provide for maintenance and mowing. The gate shall remain locked except when opened by the permittee to perform operational monitoring, sampling, maintenance, mowing, or for inspections by the Department.

12. At least one (1) warning sign shall be placed on each side of the facility enclosure in such positions as to be clearly visible from all directions of approach. There shall also be one (1) sign placed for every five hundred feet (500') (150 m) of the perimeter fence. A sign shall also be placed on each gate. Minimum wording shall be SEWAGE TREATMENT FACILITY—KEEP OUT. Signs shall be made of durable materials with characters at least two inches (2") high and shall be securely fastened to the fence, equipment or other suitable locations.

13. An Operation and Maintenance (O & M) manual shall be maintained by the permittee and made available to the operator. The O & M manual shall include key operating procedures and a brief summary of the operation of the facility.

C. SPECIAL CONDITIONS (continued)

14. An all-weather access road shall be provided to the treatment facility.
15. The discharge from the wastewater treatment facility shall be conveyed to the receiving stream via a closed pipe or a paved or rip-rapped open channel. Sheet or meandering drainage is not acceptable. The outfall sewer shall be protected against the effects of floodwater, ice or other hazards as to reasonably insure its structural stability and freedom from stoppage. The outfall shall be maintained so that a sample of the effluent can be obtained at a point after the final treatment process and before the discharge mixes with the receiving waters.
16. Whole Effluent Toxicity (WET) Test shall be conducted as follows:

SUMMARY OF ACUTE WET TESTING FOR THIS PERMIT				
OUTFALL	AEC	FREQUENCY	SAMPLE TYPE	MONTH
001	100%	Once/Permit Cycle	24 hr. composite*	Any

* A 24-hour composite sample is composed of 48 aliquots (subsamples) collected at 30 minute intervals by an automatic sampler.

Dilution Series							
AEC% = 100%	100% effluent	50% effluent	25% effluent	12.5% effluent	6.25% effluent	(Control) 100% upstream, if available	(Control) 100% Lab Water, also called synthetic water

(a) Test Schedule and Follow-Up Requirements

- (1) Perform a MULTIPLE-dilution acute WET test in the months and at the frequency specified above. For tests which are successfully passed, submit test results using the Department's WET test report form #MO-780-1899 along with complete copies of the test reports as received from the laboratory, including copies of chain-of-custody forms within 30 calendar days of availability to the WATER PROTECTION PROGRAM, P.O. Box 176, Jefferson City, MO 65102. If the effluent passes the test, do not repeat the test until the next test period.
 - (i) Chemical and physical analysis of the upstream control and effluent sample shall occur immediately upon being received by the laboratory, prior to any manipulation of the effluent sample beyond preservation methods consistent with federal guidelines for WET testing that are required to stabilize the sample during shipping.
 - (ii) Any and all chemical or physical analysis of the effluent sample performed in conjunction with the WET test shall be performed at the 100% Effluent concentration in addition to analysis performed upon any other effluent concentration.
 - (iii) All chemical analyses included in the Missouri Department of Natural Resources WET test report form #MO-780-1899 shall be performed and results shall be recorded in the appropriate field of the report form.
- (2) The WET test will be considered a failure if mortality observed in effluent concentrations for either specie, equal to or less than the AEC, is significantly different (at the 95% confidence level; $p = 0.05$) than that observed in the upstream receiving-water control sample. Where upstream receiving water is not available, synthetic laboratory control water may be used.
- (3) All failing test results along with complete copies of the test reports as received from the laboratory, INCLUDING THOSE TESTS CONDUCTED UNDER CONDITION (3) BELOW, shall be reported to the WATER PROTECTION PROGRAM, P.O. Box 176, Jefferson City, MO 65102 within 14 calendar days of the availability of the results.
- (4) If the effluent fails the test for BOTH test species, a multiple dilution test shall be performed for BOTH test species within 30 calendar days and biweekly thereafter (for storm water, tests shall be performed on the next and subsequent storm water discharges as they occur, but not less than 7 days apart) until one of the following conditions are met: Note: Written request regarding single species multiple dilution accelerated testing will be address by THE WATER PROTECTION PROGRAM on a case by case basis.
 - (i) THREE CONSECUTIVE MULTIPLE-DILUTION TESTS PASS. No further tests need to be performed until next regularly scheduled test period.
 - (ii) A TOTAL OF THREE MULTIPLE-DILUTION TESTS FAIL.
- (5) Follow-up tests do not negate an initial failed test.
- (6) The permittee shall submit a summary of all test results for the test series along with complete copies of the test reports as received from the laboratory to the WATER PROTECTION PROGRAM, P.O. Box 176, Jefferson City, MO 65102 within 14 calendar days of the third failed test.
- (7) Additionally, the following shall apply upon failure of the third follow up MULTIPLE DILUTION test The permittee should contact THE WATER PROTECTION PROGRAM within 14 calendar days from availability of the test results to ascertain as to whether a TIE or TRE is appropriate. If the permittee does not contact THE WATER PROTECTION PROGRAM upon the third follow up test failure, a toxicity identification evaluation

C. SPECIAL CONDITIONS (continued)

(TIE) or toxicity reduction evaluation (TRE) is automatically triggered. The permittee shall submit a plan for conducting a TIE or TRE to the WATER PROTECTION PROGRAM within 60 calendar days of the date of the automatic trigger or DNR's direction to perform either a TIE or TRE. This plan must be approved by DNR before the TIE or TRE is begun. A schedule for completing the TIE or TRE shall be established in the plan approval.

- (8) Upon DNR's approval, the TIE/TRE schedule may be modified if toxicity is intermittent during the TIE/TRE investigations. A revised WET test schedule may be established by DNR for this period.
- (9) If a previously completed TIE has clearly identified the cause of toxicity, additional TIEs will not be required as long as effluent characteristics remain essentially unchanged and the permittee is proceeding according to a DNR approved schedule to complete a TRE and reduce toxicity. Regularly scheduled WET testing as required in the permit, without the follow-up requirements, will be required during this period.
- (10) When WET test sampling is required to run over one DMR period, each DMR report shall contain a copy of the Department's WET test report form that was generated during the reporting period.
- (11) Submit a concise summary in tabular format of all WET test results with the annual report.

(b) Test Conditions

- (1) Test Type: Acute Static non-renewal
- (2) All tests, including repeat tests for previous failures, shall include both test species listed below unless approved by the department on a case by case basis.
- (3) Test species: Ceriodaphnia dubia and Pimephales promelas (fathead minnow). Organisms used in WET testing shall come from cultures reared for the purpose of conducting toxicity tests and cultured in a manner consistent with the most current USEPA guidelines. All test animals shall be cultured as described in the most current edition of Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms.
- (4) Test period: 48 hours at the "Allowable Effluent Concentration" (AEC) specified above.
- (5) Upstream receiving stream water shall be used as dilution water. If upstream water is unavailable or if mortality in the upstream water exceeds 10%, "reconstituted" water will be used as dilution water. Procedures for generating reconstituted water will be supplied by the MDNR upon request.
- (6) Tests will be run with 100% receiving-stream water (if available), collected upstream of the outfall at a point beyond any influence of the effluent, and reconstituted water.
- (7) If reconstituted-water control mortality for a test species exceeds 10%, the entire test will be rerun.
- (8) If upstream control mortality exceeds 10%, the entire test will be rerun using reconstituted water as the dilutant.
- (9) Whole-effluent-toxicity test shall be consistent with the most current edition of Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms

Missouri Department of Natural Resources
Statement of Basis
#MO-0109657
Paradise Landing Kimberling Shores Treatment Facility

This Statement of Basis (Statement) gives pertinent information regarding minor/simple modification(s) to the above listed operating permit without the need for a public comment process.

A Statement is not an enforceable part of a Missouri State Operating Permit.

Part I – Facility Information

Facility Type: Residential Subdivision– SIC # 8641

Part II – Modification Rationale

This operating permit is hereby modified to revise Special Condition #1. The requirement to submit a report has been removed. No other changes were made at this time.

Part III – Administrative Requirements

On the basis of preliminary staff review and the application of applicable standards and regulations, the Department, as administrative agent for the Missouri Clean Water Commission, proposes to issue a permit(s) subject to certain effluent limitations, schedules, and special conditions contained herein and within the operating permit.

Date of Statement of Basis: 10-24-2013

Submitted by

Curt Gateley, Chief
Domestic Wastewater Unit
Operating Permits Section
Water Protection Program

**MISSOURI DEPARTMENT OF NATURAL RESOURCES
FACT SHEET
FOR THE PURPOSE OF RENEWAL
OF
MO-0109657
PARADISE LANDING KIMBERLING SHORES TREATMENT FACILITY**

The Federal Water Pollution Control Act ("Clean Water Act" Section 402 Public Law 92-500 as amended) established the National Pollution Discharge Elimination System (NPDES) permit program. This program regulates the discharge of pollutants from point sources into the waters of the United States, and the release of storm water from certain point sources. All such discharges are unlawful without a permit (Section 301 of the "Clean Water Act"). After a permit is obtained, a discharge not in compliance with all permit terms and conditions is unlawful. Missouri State Operating Permits (MSOPs) are issued by the Director of the Missouri Department of Natural Resources (Department) under an approved program, operating in accordance with federal and state laws (Federal "Clean Water Act" and "Missouri Clean Water Law" Section 644 as amended). MSOPs are issued for a period of five (5) years unless otherwise specified.

As per [40 CFR Part 124.8(a)] and [10 CSR 20-6.020(1)2.] a Factsheet shall be prepared to give pertinent information regarding the applicable regulations, rationale for the development of effluent limitations and conditions, and the public participation process for the Missouri State Operating Permit (operating permit) listed below.

A Factsheet is not an enforceable part of an operating permit.

This Factsheet is for a Minor

Part I – Facility Information

Facility Type: NON-POTW – Residential Subdivision – SIC #8641

Facility Description:

Outfall #001 – Residential Subdivision– SIC # 8641

Flow equalization / extended aeration / chemical addition to facilitate phosphorus removal / chlorination / dechlorination / sludge disposal by contract hauler.

Design population equivalent is 507.

Design flow is 43,140 gallons per day.

Actual flow is 29,999 gallons per day.

Design sludge production is 7.8 dry tons/year.

Have any changes occurred at this facility or in the receiving water body that effects effluent limit derivation?

- No.

Application Date: 04/19/2012

Expiration Date: 10/17/2012

OUTFALL(S) TABLE:

OUTFALL	DESIGN FLOW (CFS)	TREATMENT LEVEL	EFFLUENT TYPE	DISTANCE TO CLASSIFIED SEGMENT (MI)
#001	0.043	Secondary	Domestic	0.08

Receiving Water Body's Water Quality & Facility Performance History:

The receiving stream, unnamed tributary to Table Rock Lake, is 0.08 miles from Table Rock Lake. Table Rock Lake is currently on EPA's approved 303(d) list for nutrients and chlorophyll. No stream survey has been conducted.

This facility was last inspected on May 19th 2008. The conditions of the facility at the time of inspection were found to be satisfactory.

Part II – Operator Certification Requirements

As per [10 CSR 20-6.010(8) Terms and Conditions of a Permit], permittees shall operate and maintain facilities to comply with the Missouri Clean Water Law and applicable permit conditions and regulations. Operators or supervisors of operations at regulated wastewater treatment facilities shall be certified in accordance with [10 CSR 20-9.020(2)] and any other applicable state law or regulation. As per [10 CSR 20-9.020(2)(A)], requirements for operation by certified personnel shall apply to all wastewater treatment systems, if applicable, as listed below:

Operator’s Name: Shawn Raglin
 Certification Number: 5489
 Certification Level: A

The listing of the operator above only signifies that staff drafting this operating permit have reviewed appropriate Department records and determined that the name listed on the operating permit application has the correct and applicable Certification Level.

Not Applicable ; This facility is not required to have a certified operator. Although a certified operator is not required, the permittee has indicated that the individual listed above will operate and maintain the facility.

Part III– Operational Monitoring

As per [10 CSR 20-9.010(4)], the facility is not required to conduct operational monitoring.

Part IV – Receiving Stream Information

10 CSR 20-7.031 Missouri Water Quality Standards, the Department defines the Clean Water Commission water quality objectives in terms of "water uses to be maintained and the criteria to protect those uses." The receiving stream and/or 1st classified receiving stream’s beneficial water uses to be maintained are located in the Receiving Stream Table located below in accordance with [10 CSR 20-7.031(3)].

RECEIVING STREAM(S) TABLE:

WATER-BODY NAME	CLASS	WBID	DESIGNATED USES*	12-DIGIT HUC	EDU**
Unnamed tributary to Table Rock Lake	U	-	General Criteria	11010001 1401	Ozark/White
Table Rock Lake	L2	7313	LWW, AQL, WBC(A), SCR		

* - Irrigation (IRR), Livestock & Wildlife Watering (LWW), Protection of Warm Water Aquatic Life and Human Health-Fish Consumption (AQL), Cool Water Fishery(CLF), Cold Water Fishery (CDF), Whole Body Contact Recreation (WBC), Secondary Contact Recreation (SCR), Drinking Water Supply (DWS), Industrial (IND), Groundwater (GRW).

** - Ecological Drainage Unit

MIXING CONSIDERATIONS

Mixing Zone: Not Allowed [10 CSR 20-7.031(4)(A)4.B.(I)(a)].

Zone of Initial Dilution: Not Allowed [10 CSR 20-7.031(4)(A)4.B.(I)(b)].

MIXING CONSIDERATIONS

Zone of Initial Dilution: Not Allowed [10 CSR 20-7.031(4)(A)4.B.(I)(b)].

Mixing Zone:

Mixing Zone (MZ) Parameters: According to the USGS 1:24,000K Quadrangle, the mainstem lake width near the facility outfall location is approximately 4455 feet (ft.). Using “normal” water levels of 4455 ft. wide and one-quarter of this width equals 1113ft. Therefore, because 100 feet is less than 1113 ft., MZ = 100 feet [10 CSR 20-7.031(4)(A)5.B.(IV)(a)].

Mixing Zone Volume: The flow volume approximates a triangular prism because of the slope of the lake bottom, where the formula is $Volume = L * W * (D * 0.5)$. Assuming that the width will be either side of the discharge (MZ) length (100 feet) to form the plume effect, the box dimensions are length (L) = 100 ft., width (W) = 100 ft., and depth (D) = 10 ft. Depth was obtained using mixing zone length projected 100 ft. from shoreline to the intersecting contour on 7.5' USGS topographic map (shoreline contour=910 ft. and lake depth contour at 100 ft. from shore = 900 ft.).

$$Volume = L * W * (D * 0.5) = (100') * (100') * (5') = 50,000 \text{ ft}^3$$

The flow volume of 50,000 ft³ is assumed as the daily mixing zone. Therefore;
 $30Q_{10} = (50,000 \text{ ft}^3/\text{day}) * (1 \text{ day}/86,400 \text{ sec}) = 0.58 \text{ ft}^3/\text{sec}$.

Part V – Rationale and Derivation of Effluent Limitations & Permit Conditions

ALTERNATIVE EVALUATIONS FOR NEW FACILITIES:

As per [10 CSR 20-7.015(4)(A)], discharges to losing streams shall be permitted only after other alternatives including land application, discharges to a gaining stream and connection to a regional wastewater treatment facility have been evaluated and determined to be unacceptable for environmental and/or economic reasons.

Not Applicable ; The facility does not discharge to a Losing Stream as defined by [10 CSR 20-2.010(36)] & [10 CSR 20-7.031(1)(N)], or is an existing facility.

ANTI-BACKSLIDING:

A provision in the Federal Regulations [CWA §303(d)(4); CWA §402(c); 40 CFR Part 122.44(I)] that requires a reissued permit to be as stringent as the previous permit with some exceptions.

- All limits in this operating permit are at least as protective as those previously established; therefore, backsliding does not apply.

ANTIDegradation:

In accordance with Missouri's Water Quality Standard [10 CSR 20-7.031(2)], the Department is to document by means of Antidegradation Review that the use of a water body's available assimilative capacity is justified. Degradation is justified by documenting the socio-economic importance of a discharging activity after determining the necessity of the discharge.

- No degradation proposed and no further review necessary. Facility did not apply for authorization to increase pollutant loading or to add additional pollutants to their discharge.

AREA-WIDE WASTE TREATMENT MANAGEMENT & CONTINUING AUTHORITY:

As per [10 CSR 20-6.010(3)(B)], ...An applicant may utilize a lower preference continuing authority by submitting, as part of the application, a statement waiving preferential status from each existing higher preference authority, providing the waiver does not conflict with any area-wide management plan approved under section 208 of the Federal Clean Water Act or any other regional sewage service and treatment plan approved for higher preference authority by the Department.

BIOSOLIDS & SEWAGE SLUDGE:

Biosolids are solid materials resulting from domestic wastewater treatment that meet federal and state criteria for beneficial uses (i.e. fertilizer). Sewage sludge is solids, semi-solids, or liquid residue generated during the treatment of domestic sewage in a treatment works; including but not limited to, domestic septage; scum or solids removed in primary, secondary, or advanced wastewater treatment process; and a material derived from sewage sludge. Sewage sludge does not include ash generated during the firing of sewage sludge in a sewage sludge incinerator or grit and screening generated during preliminary treatment of domestic sewage in a treatment works. Additional information regarding biosolids and sludge is located at the following web address: <http://dnr.mo.gov/env/wpp/pub/index.html>, items WQ422 through WQ449.

- Permittee is not authorized to land apply biosolids. Sludge/biosolids are removed by contract hauler, incinerated, stored in the lagoon, etc.

COMPLIANCE AND ENFORCEMENT:

Enforcement is the action taken by the Water Protection Program (WPP) to bring an entity into compliance with the Missouri Clean Water Law, its implementing regulations, and/or any terms and conditions of an operating permit. The primary purpose of the enforcement activity in the WPP is to resolve violations and return the entity to compliance.

Not Applicable ; The permittee/facility is not currently under Water Protection Program enforcement action.

PRETREATMENT PROGRAM:

The reduction of the amount of pollutants, the elimination of pollutants, or the alteration of the nature of pollutant properties in wastewater prior to or in lieu of discharging or otherwise introducing such pollutants into a Publicly Owned Treatment Works [40 CFR Part 403.3(q)].

Not Applicable ; The permittee, at this time, is not required to have a Pretreatment Program or does not have an approved pretreatment program.

REASONABLE POTENTIAL ANALYSIS (RPA):

Federal regulation [40 CFR Part 122.44(d)(1)(i)] requires effluent limitations for all pollutants that are or may be discharged at a level that will cause or have the reasonable potential to cause or contribute to an in-stream excursion above narrative or numeric water quality standard.

In accordance with [40 CFR Part 122.44(d)(iii)] if the permit writer determines that any given pollutant has the reasonable potential to cause, or contribute to an in-stream excursion above the WQS, the permit must contain effluent limits for that pollutant.

Applicable ; A RPA was conducted on appropriate parameters. Please see **APPENDIX – RPA RESULTS**.

REMOVAL EFFICIENCY:

Removal efficiency is a method by which the Federal Regulations define Secondary Treatment and Equivalent to Secondary Treatment, which applies to Biochemical Oxygen Demand 5-day (BOD₅) and Total Suspended Solids (TSS) for Publicly Owned Treatment Works (POTWs)/municipals.

Not Applicable ; Influent monitoring is not being required to determine percent removal.

SANITARY SEWER OVERFLOWS (SSO) AND INFLOW AND INFILTRATION (I&I):

Sanitary Sewer Overflows (SSOs) are defined as an untreated or partially treated sewage release are considered bypassing under state regulation [10 CSR 20-2.010(11)] and should not be confused with the federal definition of bypass. SSO's have a variety of causes including blockages, line breaks, and sewer defects that allow excess storm water and ground water to (1) enter and overload the collection system, and (2) overload the treatment facility. Additionally, SSO's can be also be caused by lapses in sewer system operation and maintenance, inadequate sewer design and construction, power failures, and vandalism. SSOs also include overflows out of manholes and onto city streets, sidewalks, and other terrestrial locations.

Additionally, Missouri RSMo §644.026.1 mandates that the Department require proper maintenance and operation of treatment facilities and sewer systems and proper disposal of residual waste from all such facilities.

- Not applicable. This facility is not required to develop or implement a program for maintenance and repair of the collection system; however, it is a violation of Missouri State Environmental Laws and Regulations to allow untreated wastewater to discharge to waters of the state.

SCHEDULE OF COMPLIANCE (SOC):

A schedule of remedial measures included in a permit, including an enforceable sequence of interim requirements (actions, operations, or milestone events) leading to compliance with the Missouri Clean Water Law, its implementing regulations, and/or the terms and conditions of an operating permit.

Not Applicable ; This permit does not contain a SOC.

STORM WATER POLLUTION PREVENTION PLAN (SWPPP):

In accordance with 40 CFR 122.44(k) *Best Management Practices (BMPs)* to control or abate the discharge of pollutants when: (1) Authorized under section 304(e) of the Clean Water Act (CWA) for the control of toxic pollutants and hazardous substances from ancillary industrial activities; (2) Authorized under section 402(p) of the CWA for the control of storm water discharges; (3) Numeric effluent limitations are infeasible; or (4) the practices are reasonably necessary to achieve effluent limitations and standards or to carry out the purposes and intent of the CWA.

Not Applicable ; At this time, the permittee is not required to develop and implement a SWPPP.

VARIANCE:

As per the Missouri Clean Water Law § 644.061.4, variances shall be granted for such period of time and under such terms and conditions as shall be specified by the commission in its order. The variance may be extended by affirmative action of the commission. In no event shall the variance be granted for a period of time greater than is reasonably necessary for complying with the Missouri Clean Water Law §§644.006 to 644.141 or any standard, rule or regulation promulgated pursuant to Missouri Clean Water Law §§644.006 to 644.141.

Not Applicable ; This operating permit is not drafted under premises of a petition for variance.

WASTELOAD ALLOCATIONS (WLA) FOR LIMITS:

As per [10 CSR 20-2.010(78)], the amount of pollutant each discharger is allowed by the Department to release into a given stream after the Department has determined total amount of pollutant that may be discharged into that stream without endangering its water quality.

Applicable ; Wasteload allocations were calculated where applicable using water quality criteria or water quality model results and the dilution equation below:

$$C_e = \frac{(Q_e + Q_s)C - (C_s \times Q_s)}{(Q_e)} \quad (\text{EPA/505/2-90-001, Section 4.5.5})$$

Where C = downstream concentration
Cs = upstream concentration
Qs = upstream flow
Ce = effluent concentration
Qe = effluent flow

Chronic wasteload allocations were determined using applicable chronic water quality criteria (CCC: criteria continuous concentration) and stream volume of flow at the edge of the mixing zone (MZ). Acute wasteload allocations were determined using applicable water quality criteria (CMC: criteria maximum concentration) and stream volume of flow at the edge of the zone of initial dilution (ZID).

Water quality based maximum daily and average monthly effluent limitations were calculated using methods and procedures outlined in USEPA's "Technical Support Document For Water Quality-based Toxics Control" (EPA/505/2-90-001).

Number of Samples "n":

Additionally, in accordance with the TSD for water quality-based permitting, effluent quality is determined by the underlying distribution of daily values, which is determined by the Long Term Average (LTA) associated with a particular Wasteload Allocation (WLA) and by the Coefficient of Variation (CV) of the effluent concentrations. Increasing or decreasing the monitoring frequency does not affect this underlying distribution or treatment performance, which should be, at a minimum, be targeted to comply with the values dictated by the WLA. Therefore, it is recommended that the actual planned frequency of monitoring normally be used to determine the value of "n" for calculating the AML. However, in situations where monitoring frequency is once per month or less, a higher value for "n" must be assumed for AML derivation purposes. Thus, the statistical procedure being employed using an assumed number of samples is "n = 4" at a minimum. For Total Ammonia as Nitrogen, "n = 30" is used.

Not Applicable ; Wasteload allocations were not calculated.

WLA MODELING:

There are two general types of effluent limitations, technology-based effluent limits (TBELs) and water quality based effluent limits (WQBELs). If TBELs do not provide adequate protection for the receiving waters, then WQBEL must be used.

Not Applicable ; A WLA study was either not submitted or determined not applicable by Department staff.

WATER QUALITY STANDARDS:

Per [10 CSR 20-7.031(3)], General Criteria shall be applicable to all waters of the state at all times including mixing zones. Additionally, [40 CFR 122.44(d)(1)] directs the Department to establish in each NPDES permit to include conditions to achieve water quality established under Section 303 of the Clean Water Act, including State narrative criteria for water quality.

WHOLE EFFLUENT TOXICITY (WET) TEST:

A WET test is a quantifiable method of determining if a discharge from a facility may be causing toxicity to aquatic life by itself, in combination with or through synergistic responses when mixed with receiving stream water.

Applicable ; Under the federal Clean Water Act (CWA) §101(a)(3), requiring WET testing is reasonably appropriate for site-specific Missouri State Operating Permits for discharges to waters of the state issued under the National Pollutant Discharge Elimination System (NPDES). WET testing is also required by 40 CFR 122.44(d)(1). WET testing ensures that the provisions in the 10 CSR 20-6.010(8)(A)7. and the Water Quality Standards 10 CSR 20-7.031(3)(D),(F),(G),(I)2.A & B are being met. Under [10 CSR 20-6.010(8)(A)4], the Department may require other terms and conditions that it deems necessary to assure compliance with the Clean Water Act and related regulations of the Missouri Clean Water Commission. In addition the following MCWL apply: §§644.051.3 requires the Department to set permit conditions that comply with the MCWL and CWA; 644.051.4 specifically references toxicity as an item we must consider in writing permits (along with water quality-based effluent limits, pretreatment, etc...); and 644.051.5 is the basic authority to require testing conditions. WET test will be required by facilities meeting the following criteria:

- Facility is a designated Major.
- Facility continuously or routinely exceeds its design flow.
- Facility (industrial) that alters its production process throughout the year.
- Facility handles large quantities of toxic substances, or substances that are toxic in large amounts.
- Facility has Water Quality-based Effluent Limitations for toxic substances (other than NH₃)
- Facility is a municipality or domestic discharger with a Design Flow ≥ 22,500 gpd.
- Other – please justify.

40 CFR 122.41(M) - BYPASSES:

The federal Clean Water Act (CWA), Section 402 prohibits wastewater dischargers from “bypassing” untreated or partially treated sewage (wastewater) beyond the headworks. A bypass is defined as an intentional diversion of waste streams from any portion of a treatment facility, [40 CFR 122.41(m)(1)(i)]. Additionally, Missouri regulation 10 CSR 20-2.010(11) defines a bypass as the diversion of wastewater from any portion of wastewater treatment facility or sewer system to waters of the state. Only under exceptional and specified limitations do the federal regulations allow for a facility to bypass some or all of the flow from its treatment process. Bypasses are prohibited by the CWA unless a permittee can meet all of the criteria listed in 40 CFR 122.41(m)(4)(i)(A), (B), & (C). Any bypasses from this facility are subject to the reporting required in 40 CFR 122.41(l)(6) and per Missouri’s Standard Conditions I, Section B, part 2.b. Additionally, Anticipated Bypasses include bypasses from peak flow basins or similar devices designed for peak wet weather flows.

Not Applicable ; This facility does not anticipate bypassing.

303(d) LIST & TOTAL MAXIMUM DAILY LOAD (TMDL):

Section 303(d) of the federal Clean Water Act requires that each state identify waters that are not meeting water quality standards and for which adequate water pollution controls have not been required. Water quality standards protect such beneficial uses of water as whole body contact (such as swimming), maintaining fish and other aquatic life, and providing drinking water for people, livestock and wildlife. The 303(d) list helps state and federal agencies keep track of waters that are impaired but not addressed by normal water pollution control programs.

A TMDL is a calculation of the maximum amount of a given pollutant that a body of water can absorb before its water quality is affected. If a water body is determined to be impaired as listed on the 303(d) list, then a watershed management plan will be developed that shall include the TMDL calculation

Applicable ; Table Rock Lake is listed on the 2010 Missouri 303(d) List for nutrients and chlorophyll.

– This facility is considered to be a source of or has the potential to contribute to the above listed pollutant(s). When the nutrient implementation procedure is approved, the permit may be reopened and modified to include nutrient monitoring. Once a TMDL is developed, the permit will be modified to include WLAs from the TMDL.

Part VI –2013 Water Quality Criteria for Ammonia

Upcoming changes to the Water Quality Standard for ammonia may require significant upgrades to wastewater treatment facilities.

On August 22, 2013, the U.S. Environmental Protection Agency (EPA) finalized new water quality criteria for ammonia, based on toxicity studies of mussels. Missouri's current ammonia criteria are based on toxicity testing of several species, but did not include data from mussels. Missouri is home to 65 of North America's mussel species, which are spread across the state. According to the Missouri Department of Conservation nearly two-thirds of the mussel species in Missouri are considered to be "of conservation concern". Nine species are listed as federally endangered, with an additional species currently proposed as endangered and another species proposed as threatened.

The adult forms of mussels that are seen in rivers, lakes, and streams are sensitive to pollutants because they are sedentary filter feeders. They vacuum up many pollutants with the food they bring in and cannot escape to new habitats, so they can accumulate toxins in their bodies and die. But very young mussels, called glochidia, are exceptionally sensitive to ammonia in water. As a result of a citizen suit, the EPA was compelled to conduct toxicity testing and develop ammonia water quality criteria that would be protective if young mussels may be present in a waterbody. These new criteria will apply to any discharge with ammonia levels that may pose a reasonable potential to violate the standards. Nearly all discharging domestic wastewater treatment facilities (cities, subdivisions, mobile home parks, etc.), as well as certain industrial and stormwater dischargers with ammonia in their effluent, will be affected by this change in the regulations.

When new water quality criteria are established by the EPA, states must adopt them into their regulations in order to keep their authorization to issue permits under the National Pollutant Discharge Elimination System (NPDES). States are required to review their water quality standards every three years, and if new criteria have been developed they must be adopted. States may be more protective than the Federal requirements, but not less protective. Missouri does not have the resources to conduct the studies necessary for developing new water quality standards, and therefore our standards mirror those developed by the EPA; however, we will utilize any available flexibility based on actual species of mussels that are native to Missouri and their sensitivity to ammonia.

Many treatment facilities in Missouri are currently scheduled to be upgraded to comply with the current water quality standards. But these new ammonia standards may require a different treatment technology than the one being considered by the permittee. It is important that permittees discuss any new and upcoming requirements with their consulting engineers to ensure that their treatment systems are capable of complying with the new requirements. The Department encourages permittees to construct treatment technologies that can attain effluent quality that supports the EPA ammonia criteria.

Ammonia toxicity varies by temperature and by pH of the water. Assuming a stable pH value, but taking into account winter and summer temperatures, Missouri includes two seasons of ammonia effluent limitations. Current effluent limitations in this permit are:

Summer – 12.1 mg/L daily maximum, 3.1 mg/L monthly average.

Winter – 12.1 mg/L daily maximum, 3.6 mg/L monthly average.

Under the new EPA criteria, where mussels of the family Unionidae are present or expected to be present, your estimated effluent limitations will be:

Summer – 3.4 mg/L daily maximum, 0.9 mg/L monthly average.

Winter – 8.1 mg/L daily maximum, 2.4 mg/L monthly average.

Actual effluent limits will depend in part on the actual performance of the facility.

Operating permits for facilities in Missouri must be written based on current statutes and regulations. It is expected that the new WQS will be adopted in the next review of our standards. Therefore permits will be written with the existing effluent limitations until the new standards are adopted. To aid permittees in decision making, an advisory will be added to permit Fact Sheets notifying permittees of the expected effluent limitations for ammonia. When setting schedules of compliance for ammonia effluent limitations, consideration will be given to facilities that have recently constructed upgraded facilities to meet the current ammonia limitations.

For more information on this topic feel free to contact the Missouri Department of Natural Resources, Water Protection Program, Water Pollution Control Branch, Operating Permits Section at (573) 751-1300.

Part VII – Effluent Limits Determination

APPLICABLE DESIGNATIONS OF WATERS OF THE STATE:

As per Missouri’s Effluent Regulations [10 CSR 20-7.015], the waters of the state are divided into the below listed seven (7) categories. Each category lists effluent limitations for specific parameters, which are presented in each outfall’s Effluent Limitation Table and further discussed in the Derivation & Discussion of Limits section.

- Missouri or Mississippi River [10 CSR 20-7.015(2)]:
 Lake or Reservoir [10 CSR 20-7.015(3)]:
 Losing [10 CSR 20-7.015(4)]:
 Metropolitan No-Discharge [10 CSR 20-7.015(5)]:
 Special Stream [10 CSR 20-7.015(6)]:
 Subsurface Water [10 CSR 20-7.015(7)]:
 All Other Waters [10 CSR 20-7.015(8)]:

OUTFALL #001 – MAIN FACILITY OUTFALL

EFFLUENT LIMITATIONS TABLE:

PARAMETER	Unit	Basis for Limits	Daily Maximum	Weekly Average	Monthly Average	Modified	Previous Permit Limitations
Flow	MGD	1	*		*	No	*
BOD ₅	mg/L	1		30	20	No	30/20
TSS	mg/L	1		30	20	No	30/20
pH	SU	1	6.5-9.0		6.5-9.0	No	6.5-9.0
Ammonia as N (April 1 – Sept 30)	mg/L	2, 3, 5	12.1		3.1	Yes	*
Ammonia as N (Oct 1 – March 31)	mg/L	2, 3, 5	12.1		3.6	Yes	*
Dissolved Oxygen (DO)**	mg/L	3, 9	*		*	No	*
Escherichia coli	***	1, 3	630		126	Yes	1000/400
Chlorine, Total Residual	µg/L	1, 3	17		8	Yes	19/9.5
Total Phosphorus	mg/L	1,3	0.5		0.5	No	0.5
Aluminum, Total Recoverable	mg/L	1	*		*	Yes	0.074/0.05
Whole Effluent Toxicity (WET) Test	% Survival	11	Please see WET Test in the Derivation and Discussion Section below.				

* - Monitoring requirement only.

** - For DO the Daily Maximum is a Daily Minimum and the Monthly Average is a Monthly Average Minimum.

*** - # of colonies/100mL; the Monthly Average for *E. coli* is a geometric mean.

**** - Parameter not previously established in previous state operating permit.

Basis for Limitations Codes:

- | | |
|--|------------------------------------|
| 1. State or Federal Regulation/Law | 7. Antidegradation Policy |
| 2. Water Quality Standard (includes RPA) | 8. Water Quality Model |
| 3. Water Quality Based Effluent Limits | 9. Best Professional Judgment |
| 4. Lagoon Policy | 10. TMDL or Permit in lieu of TMDL |
| 5. Ammonia Policy | 11. WET Test Policy |
| 6. Antidegradation Review | |

OUTFALL #001 – DERIVATION AND DISCUSSION OF LIMITS:

- **Flow.** In accordance with [40 CFR Part 122.44(i)(1)(ii)] the volume of effluent discharged from each outfall is needed to assure compliance with permitted effluent limitations. If the permittee is unable to obtain effluent flow, then it is the responsibility of the permittee to inform the Department, which may require the submittal of an operating permit modification.

- **Biochemical Oxygen Demand (BOD₅)**.

☒ – 30 mg/L Weekly Average and 20 mg/L Monthly Average effluent limitations, as per [10 CSR 20-7.015].

- **Total Suspended Solids (TSS)**.

☒ – 30 mg/L Weekly Average and 20 mg/L Monthly Average effluent limitations, as per [10 CSR 20-7.015].

- **pH**. Effluent limitation range is 6.5 – 9.0 Standard pH Units (SU), as per the applicable section of 10 CSR 20-7.015. pH is not to be averaged.

- **Total Ammonia Nitrogen**. Early Life Stages Present Total Ammonia Nitrogen criteria apply [10 CSR 20-7.031(4)(B)7.C. & Table B3] default pH 7.8 SU Background total ammonia nitrogen = 0.01 mg/L

Season	Temp (°C)	pH (SU)	Total Ammonia Nitrogen CCC (mg/L)	Total Ammonia Nitrogen CMC (mg/L)
Summer	26	7.8	1.5	12.1
Winter	6	7.8	3.1	12.1

Summer: April 1 – September 30

Chronic WLA: $C_e = ((0.043 + 0.58)1.5 - (0.58 * 0.01))/0.043$
 $C_e = 21.6 \text{ mg/L}$

Acute WLA: $C_e = ((0.043 + 0.0)12.1 - (0.0 * 0.01))/0.043$
 $C_e = 12.1 \text{ mg/L}$

$LTA_c = 21.6 \text{ mg/L} (0.654) = 14.12 \text{ mg/L}$

[CV = 1.0, 99th Percentile, 30 day avg.]

$LTA_a = 12.1 \text{ mg/L} (0.195) = 2.36 \text{ mg/L}$

[CV = 1.0, 99th Percentile]

Use most protective number of LTA_c or LTA_a .

MDL = 2.36 mg/L (5.13) = 12.1 mg/L

[CV = 1.0, 99th Percentile]

AML = 2.36 mg/L (1.34) = 3.1 mg/L

[CV = 1.0, 95th Percentile, n=30]

Winter: October 1 – March 31

Chronic WLA: $C_e = ((0.043 + 0.58)3.1 - (0.58 * 0.01))/0.043$
 $C_e = 44.78 \text{ mg/L}$

Acute WLA: $C_e = ((0.043 + 0.0)12.1 - (0.0 * 0.01))/0.043$
 $C_e = 12.1 \text{ mg/L}$

$LTA_c = 44.78 \text{ mg/L} (0.704) = 31.52 \text{ mg/L}$

[CV = 0.9, 99th Percentile, 30 day avg.]

$LTA_a = 12.1 \text{ mg/L} (0.234) = 2.83 \text{ mg/L}$

[CV = 0.9, 99th Percentile]

Use most protective number of LTA_c or LTA_a .

MDL = 2.83 mg/L (4.28) = 12.1 mg/L

[CV = 0.9, 99th Percentile]

AML = 2.83 mg/L (1.28) = 3.6 mg/L

[CV = 0.9, 95th Percentile, n=30]

- **Dissolved Oxygen**. Monitoring requirement only. Monitoring for dissolved oxygen is included to determine whether reasonable potential to exceed water quality standards exists after the discharge begins.

- **Escherichia coli (E. coli)**. Monthly average of 126 per 100 ml as a geometric mean and Daily Maximum of 630 during the recreational season (April 1 – October 31), to protect Whole Body Contact Recreation (A) designated use of the receiving stream, as per 10 CSR 20-7.031(4)(C). An effluent limit for both monthly average and daily maximum is required by 40 CFR 122.45(d).

- **Total Residual Chlorine (TRC)**. Total Residual Chlorine effluent limits of 17 µg/L daily maximum, 8 µg/L monthly average are recommended if chlorine is used as a disinfectant. Standard compliance language for TRC, including the minimum level (ML), should be included in the permit.

- **Total Phosphorus** To Table Rock Lake and Lake Taneycomo 0.5 mg/L per 10 CSR 20-7.015 (3).
- **Aluminum, Total Recoverable** Monitoring requirement only. This facility uses chemicals for phosphorous removal that may contain aluminum. Monitoring is required to determine if reasonable potential exists for this facility’s discharge to exceed water quality standards for Aluminum (Total Recoverable).
- **WET Test.** WET Testing schedules and intervals are established in accordance with the Department’s Permit Manual; Section 5.2 *Effluent Limits / WET Testing for Compliance Bio-monitoring*. It is recommended that WET testing be conducted during the period of lowest stream flow.
 - Acute
 - No less than ONCE/PERMIT CYCLE:**
 - Municipality or domestic facility with a design flow \geq 22,500 gpd, but less than 1.0 MGD.

Acute and/or Chronic Allowable Effluent Concentrations (AECs) for facilities that discharge to unclassified, Class C, Class P (with default Mixing Considerations), or Lakes [10 CSR 20-7.031(4)(A)4.B.(IV)(b)] are 100%, 50%, 25%, 12.5%, & 6.25%.

Minimum Sampling and Reporting Frequency Requirements.

PARAMETER	SAMPLING FREQUENCY	REPORTING FREQUENCY
Flow	once/quarter	once/quarter
BOD ₅	once/quarter	once/quarter
TSS	once/quarter	once/quarter
pH	once/quarter	once/quarter
Ammonia as N	once/quarter	once/quarter
<i>E. coli</i>	once/quarter	once/quarter
Total Residual Chlorine	once/quarter	once/quarter
Dissolved Oxygen	once/quarter	once/quarter
Total Phosphorus	once/quarter	once/quarter
Total Recoverable Aluminum	once/quarter	once/quarter
WET test	once/permit cycle	once/permit cycle

Sampling Frequency Justification:

The Clean Water Commission has directed the Department to proceed with amending 10 CSR 20-7.015 to reduce the sampling frequency required for E.coli to a lesser frequency, still protective of water quality standards, for smaller facilities, including those with discharges of 100,000 gallons per day or less.

Sampling Type Justification

As per 10 CSR 20-7.015, BOD5, TSS, and WET test samples collected for mechanical plants shall be a 24 hour composite sample. Due to the small size of this facility this composite sample shall be made up from a minimum of four grab samples collected within a 24-hour period with a minimum of two hours between each grab sample. Grab samples, however, must be collected for pH, ammonia as N, E. coli, and TRC. This is due to the holding time restriction for E. coli, the volatility of ammonia and TRC, and the fact that pH and DO cannot be preserved and must be sampled in the field. The total Phosphorus sample must be immediately acidified to a pH below 2, and therefore must also be a grab.

Part VIII – Finding of Affordability

Pursuant to Section 644.145, RSMo., the Department is required to determine whether a permit or decision is affordable and makes a finding of affordability for certain permitting and enforcement decisions. This requirement applies to discharges from combined or separate sanitary sewer systems or publically-owned treatment works.

Not Applicable;

The Department is not required to determine findings of affordability because the facility is not a **combined or separate sanitary sewer system for a publically-owned treatment works**.

Part IX – Administrative Requirements

On the basis of preliminary staff review and the application of applicable standards and regulations, the Department, as administrative agent for the Missouri Clean Water Commission, proposes to issue a permit(s) subject to certain effluent limitations, schedules, and special conditions contained herein and within the operating permit. The proposed determinations are tentative pending public comment.

PERMIT SYNCHRONIZATION:

The Department of Natural Resources is currently undergoing a synchronization process for operating permits. Permits are normally issued on a five-year term, but to achieve synchronization many permits will need to be issued for less than the full five years allowed by regulation. The intent is that all permits within a watershed will move through the Watershed Based Management (WBM) cycle together will all expire in the same fiscal year. This will allow further streamlining by placing multiple permits within a smaller geographic area on public notice simultaneously, thereby reducing repeated administrative efforts. This will also allow the department to explore a watershed based permitting effort at some point in the future.

PUBLIC NOTICE:

The Department shall give public notice that a draft permit has been prepared and its issuance is pending. Additionally, public notice will be issued if a public hearing is to be held because of a significant degree of interest in and water quality concerns related to a draft permit. No public notice is required when a request for a permit modification or termination is denied; however, the requester and permittee must be notified of the denial in writing.

The Department must issue public notice of a pending operating permit or of a new or reissued statewide general permit. The public comment period is the length of time not less than 30 days following the date of the public notice which interested persons may submit written comments about the proposed permit.

For persons wanting to submit comments regarding this proposed operating permit, then please refer to the Public Notice page located at the front of this draft operating permit. The Public Notice page gives direction on how and where to submit appropriate comments.

- The Public Notice period for this operating permit was from 8/22/2013 to 9/22/2013. No comments received.

DATE OF FACT SHEET: 01/15/2013

COMPLETED BY:

**LACEY HIRSCHVOGEL, ENVIRONMENTAL SPECIALIST
MISSOURI DEPARTMENT OF NATURAL RESOURCES
WATER PROTECTION PROGRAM
OPERATING PERMITS SECTION - DOMESTIC WASTEWATER UNIT
(573) 751-9391
lacey.hirschvogel@dnr.mo.gov**

APPENDIX – RPA RESULTS:

Parameter	CMC*	RWC Acute*	CCC*	RWC Chronic*	n**	Range max/min	CV***	MF	RP Yes/No
Total Ammonia as Nitrogen (Summer) mg/L	12.1	36.85	1.5	36.85	14.00	8.17/0	1.05	4.51	YES
Total Ammonia as Nitrogen (Winter) mg/L	12.1	20.44	3.1	20.44	17.00	6.17/0.01	0.86	3.31	YES

* - Units are (µg/L) unless otherwise noted.

** - If the number of samples is 10 or greater, then the CV value must be used in the WQBEL for the applicable constituent.

*** - Coefficient of Variation (CV) is calculated by dividing the Standard Deviation of the sample set by the Mean of the same sample set.

RWC – Receiving Water Concentration. It is the concentration of a toxicant or the parameter toxicity in the receiving water after mixing (if applicable).

n – Is the number of samples.

MF – Multiplying Factor. 99% Confidence Level and 99% Probability Basis.

RP – Reasonable Potential. It is where an effluent is projected or calculated to cause an excursion above a water quality standard based on a number of factors including, as a minimum, the four factors listed in 40 CFR 122.44(d)(1)(ii).

Reasonable Potential Analysis is conducted as per (TSD, EPA/505/2-90-001, Section 3.3.2). A more detailed version including calculations of this RPA is available upon request.

APR 19 2012

AP 11299



MISSOURI DEPARTMENT OF NATURAL RESOURCES
WATER PROTECTION PROGRAM, WATER POLLUTION BRANCH
FORM B - APPLICATION FOR CONSTRUCTION OR OPERATING PERMIT FOR FACILITIES WHICH RECEIVE PRIMARILY DOMESTIC WASTE (≤100,000 gallons per day) UNDER MISSOURI CLEAN WATER LAW

FOR AGENCY USE ONLY	
CHECK NUMBER	15161718
DATE RECEIVED	4/19/12
FEE SUBMITTED	No fee

NOTE ► PLEASE READ THE ACCOMPANYING INSTRUCTIONS BEFORE COMPLETING THIS FORM

1. This application is for:

- An operating permit and antidegradation review public notice.
- A construction permit following an appropriate operating permit and antidegradation review public notice.
- A construction permit and a concurrent operating permit and antidegradation review public notice.
- A construction permit (submitted before Aug. 30, 2008 or antidegradation review is not required).
- An operating permit for a new or unpermitted facility. Construction Permit # _____
- An operating permit renewal: Permit #MO- 0109657 Expiration Date 10/27/09 Reason: _____
- An operating permit modification: Permit #MO- _____

1.1 Is this a Federal/State Funded Project? YES NO Funding Agency/Project # _____
 1.2 Is the appropriate fee included with the application (See instructions for appropriate fee)? YES NO

2. FACILITY (Outfall 001 of 1)

NAME Paradise Landing Kimberling Shores Treatment Facility		TELEPHONE WITH AREA CODE (417) 779-3601	
ADDRESS (PHYSICAL) 1002 Paradise Landing	CITY Kimberling City	STATE MO	ZIP CODE 65686

2.1 LEGAL DESCRIPTION: SE ¼, NE ¼, ¼, Sec. 16 , T 22n , R 23w Stone County

2.2 UTM Coordinates Easting (X): _____ Northing (Y): _____
For Universal Transverse Mercator (UTM), Zone 15 North referenced to North American Datum 1983 (NAD83)

2.3 Name of receiving stream: Table Rock Lake

3. OWNER

NAME Paradise Landing Kimberling Shores Treatment Facility		E-MAIL ADDRESS paradise004@centurytel.net	TELEPHONE WITH AREA CODE (417) 779-3601
ADDRESS 1000 Paradise Landing	CITY Kimberling City	STATE MO	ZIP CODE 65686

3.1 Request review of draft permit prior to Public Notice? YES NO

4. CONTINUING AUTHORITY: Permanent organization which will serve as the continuing authority for the operation, maintenance and modernization of the facility.

NAME Paradise Landing Kimberling Shores Treatment Facility		TELEPHONE WITH AREA CODE (417) 779-3601	
ADDRESS 1000 Paradise Landing	CITY Kimberling City	STATE MO	ZIP CODE 65686

5. OPERATOR

NAME Shawn Raglin	CERTIFICATE NUMBER 5489	TELEPHONE WITH AREA CODE (870) 654-6639
----------------------	----------------------------	--

6. FACILITY CONTACT

NAME Robert Pitts	TITLE President	TELEPHONE WITH AREA CODE (417) 818-5325
----------------------	--------------------	--

7.0 ADDITIONAL FACILITY INFORMATION

7.1 Description of facilities (Attach additional sheet if required). Attach a 1" = 2,000' scale U.S. Geological Survey topographic map showing location of all outfalls and downstream landowners. (See Item 9.)

7.2 Facility SIC code: 4952; Discharge SIC code: _____; Facility NAICS code: _____; Discharge NAICS code: _____.

7.3 Number of people presently connected or population equivalent (P.E.) 507 Design P.E. 155
 Number of units presently connected: Homes _____ Trailers _____ Apartments _____ Other 118 Condos
 Design flow for this outfall: 43140 Total design flow for the facility: 43140 Actual flow for this outfall: 29999
 Commercial Establishment: Daily number of employees working N/A Daily number of customers/guests N/A

7.4 Length of pipe in the sewer collection system? 1.25 feet/miles (Please denote which unit is appropriate.)

7.5 Does any bypassing occur in the collection system or at the treatment facility? Yes No (If yes, attach explanation.)

7.6 Does significant infiltration occur in the collection system? Yes No (If yes, attach explanation and proposed repair.)

7.7 Is industrial waste discharged to the facility identified in Item 2? Yes No (If yes, see instructions.)

7.8 Will the discharge be continuous through the year? Yes No
 a. Discharge will occur during the following months: Jan. - Dec.
 b. How many days of the week will the discharge occur? 7

7.9 Is wastewater land applied? Yes No (If yes, attach Form I.)

7.10 Will chlorine be added to the effluent? Yes No
 a. If chlorine is added, what is the resulting residual? 1.0 µg/l (micrograms per liter)

7.11 Does this facility discharge to a losing stream or sinkhole? Yes No

7.12 Attach a flow chart showing all influents, treatment facilities and outfalls.

7.13 Has a waste load allocation study been completed for this facility? Yes No

7.14 List all permit violations, including effluent limit exceedances in the last five years. Attach a separate sheet if necessary.
 If none, write none. Jan 2012 Total Recoverable Aluminum exceeded Permit Limitations

8. SLUDGE HANDLING, USE AND DISPOSAL

8.1 Is the sludge a hazardous waste as defined by 10 CSR 25? Yes No

8.2 Sludge Production, including sludge received from others: 9.13 Design Dry Tons/Year Actual Dry Tons/Year


8.3 Capacity of sludge holding structures:
 Sludge storage provided: 22400 cubic feet; 120 days of storage; 1.5% average percent solids of sludge;
 No sludge storage is provided.

8.4 Type of Storage: Holding tank Building
 Basin Other (Please describe)

8.5 Sludge Treatment:
 Anaerobic Digester Lagoon Composting
 Storage Tank Aerobic Digester Other (Attach description)
 Lime Stabilization Air or Heat Drying

8.6 Sludge Use or Disposal:
 Land Application Surface Disposal (Sludge Disposal Lagoon, Sludge held for more than two years)
 Contract Hauler Incineration
 Hauled to Another Treatment Facility Sludge Retained in Wastewater treatment lagoon
 Solid Waste Landfill Other _____ Attach explanation sheet.

8.7 PERSON RESPONSIBLE FOR HAULING SLUDGE TO DISPOSAL FACILITY
 By Applicant By Others (complete below)

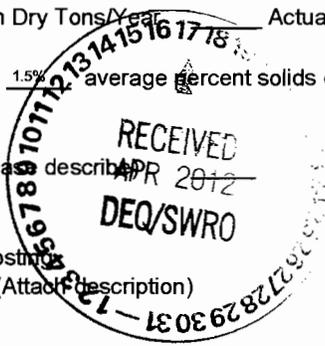

NAME
Tillman Septic Service

ADDRESS 147 Victory Lane	CITY Branson West	STATE MO	ZIP CODE 65737
CONTACT PERSON Jody Tillman	TELEPHONE WITH AREA CODE 417-739-4780	PERMIT NO. MO- G821083	

8.8 SLUDGE USE OR DISPOSAL FACILITY
 By Applicant By Others (Please complete below.)

NAME
Tillman Septic Service

ADDRESS 147 Victory Lane	CITY Branson West	STATE MO	ZIP CODE 65737
CONTACT PERSON Jody Tillman	TELEPHONE WITH AREA CODE 417-739-4780	PERMIT NO. MO- G821083	

8.9 Does the sludge or biosolids disposal comply with federal sludge regulations under 40 CFR 503?
 Yes No (Please attach explanation)

9. DOWNSTREAM LANDOWNER (S). ATTACH ADDITIONAL SHEETS AS NECESSARY. SEE INSTRUCTIONS.

NAME
United States Government (Corps of Engineers)

ADDRESS PO Box 1100	CITY Branson	STATE MO	ZIP CODE 65615
------------------------	-----------------	-------------	-------------------

10. DRINKING WATER SUPPLY INFORMATION

10.1 WHAT IS THE SOURCE OF YOUR DRINKING WATER SUPPLY:
 A. Public supply (municipal or water district water) N/A
 If public, please give name of the public supply N/A
 B. Private well X
 C. Surface water (lake, pond or stream) N/A

10.2 Does your drinking water source serve at least 25 people at least 60 days per year (not necessarily consecutive days)?
 Yes No

10.3 Does your supply serve housing which is occupied year round by the same people? This does not include housing which is occupied seasonally?
 Yes No


11. I certify that I am familiar with the information contained in the application, that to the best of my knowledge and belief such information is true, complete and accurate, and if granted this permit, I agree to abide by the Missouri Clean Water Law and all rules, regulations, orders and decisions, subject to any legitimate appeal available to applicant under the Missouri Clean Water Law.

NAME AND OFFICIAL TITLE (TYPE OR PRINT) Robert Pitts President	TELEPHONE WITH AREA CODE 417-818-5325
SIGNATURE 	DATE SIGNED 4/17/12



Appendix A: Map of Discharge Location

Paradise Landing Kimberling Shores WWTF

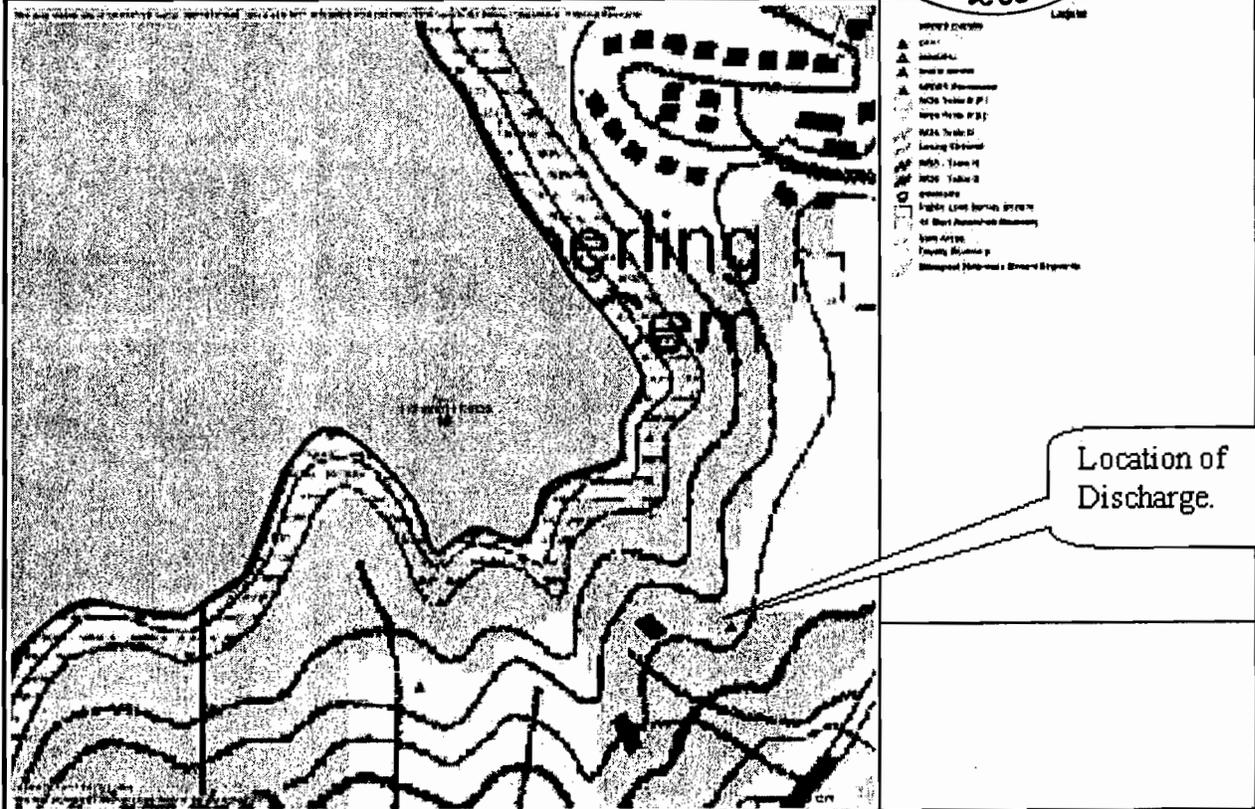

Location of Discharge.

View Scale 1:3,471
 Disclaimer: Although this map has been compiled by the Missouri Department of Natural Resources, no warranty, expressed or implied, is made by the department as to the accuracy of the data and related materials. The act of distribution shall not constitute any such warranty, and no responsibility is assumed by the department in the use of these data or related materials.

Missouri Secretary of State, Robin Carnahan

SOS Home :: Business Services :: Business Entity Search

- Search
- By Business Name
 - By Charter Number
 - By Registered Agent
 - For New Corporations Verify
 - Verify Certification Registration Report
 - File Online File Fictitious Name Registration
 - File Online Renew Online File LLC Registration
 - File Online Online Orders
 - Register for Online Orders
 - Order Good Standing
 - Order Certified Documents

Filed Documents

Date: 4/17/2012 (Click above to view filed documents that are available.)



Business Name History

Name	Name Type
PARADISE LANDING-KIMBERLING SHORES TREATMENT FACILITY ASSOCIATION, INC.	Legal

Non-Profit Corporation - Domestic - Information

Charter Number: N00051611
Status: Good Standing
Entity Creation Date: 1/27/1995
State of Business.: MO
Expiration Date: Perpetual
Last Registration Report Filed Date: 9/12/2011 8:00:00 AM
Last Registration Report Filed: 2011

Registered Agent

Agent Name: Pitts, Rob
Office Address: 1000 Paradise Landing Rd. Kimberling City MO 65686

Mailing Address:

Commissions
Phone: (573) 751-2783
Toll Free: (866) 223-6535

Corporations
Phone: (573) 751-4153
Toll Free: (866) 223-6535

UCC Office
Phone: (573) 751-4628
Toll Free: (866) 223-6535

600 West Main Street
 Jefferson City, MO 65101
 Main Office: (573) 751-4936