



Missouri  
Department of Natural Resources

# **2007 Annual Compliance Report of Missouri Public Drinking Water Systems**



**Photo: Nevada Water Treatment Plant, Nevada, Mo**

## Table of Contents

Note from the Branch Chief . . . . .	2
Missouri Public Water System Universe . . . . .	3
Analysis of Compliance by Water Systems in 2007 . . . . .	4
Compliance Activities . . . . .	6
For Further Information . . . . .	7
Summary of Violations Table	
Definitions for Summary of Violations Table . . . . .	8
Organic Contaminants. . . . .	10
Inorganic Contaminants . . . . .	12
Radiologicals. . . . .	13
Microbiologicals . . . . .	13
Surface Water Treatment Rule . . . . .	14
Lead and Copper Rule . . . . .	14
Public Notification . . . . .	15
Appendix A: Listing of Maximum Contaminant Level Violators . . . . .	16
I.Coliform	
A.2005 Boil Water Orders. . . . .	16
B. Non-Acute MCL Violations . . . . .	17
II.Chemical MCL Violations . . . . .	29
III.Radiological MCL. . . . .	30
IV.Surface Waters . . . . .	31
Appendix B: Listing of Chronic Major Monitoring Violators . . . . .	32
Appendix C: Listing of Major Repeat Monitoring Violators . . . . .	39
Appendix D: Listing of Significant Non-Compliers. . . . .	40

*Front Cover:* Nevada Missouri Reverse Osmosis Drinking Water Treatment Plant

# Note from the Branch Chief



The Public Drinking Water Branch of the Missouri Department of Natural Resources has an important mission to ensure that public water systems provide safe drinking water to every visitor and resident of Missouri. To do this, the branch sets limits and monitors for nearly 100 contaminants that could be found in public drinking water supplies. This report provides information on how well public water systems in Missouri are meeting the standards for providing safe drinking water.

This is the eleventh Annual Compliance Report the Public Drinking Water Branch has produced since 1996 and covers compliance statistics for calendar year 2007. Each state produces a similar annual report on its public water systems. The reports are made available to the public and are provided to the U.S. Environmental Protection Agency for inclusion in a national report summarizing the performance of the nation's public drinking water systems.

The branch provides this report not only to comply with statutory obligations mandated by the federal Safe Drinking Water Act, but also to focus attention and provide an understanding of the importance of quality drinking water.

The report shows that Missouri's water systems continued to provide safe and reliable drinking water in 2007. While most of Missouri's compliance figures are very high, one measure saw a significant decline in 2007. The decline is due almost entirely to a single, short-term event at our largest water supplier. Even though the event lasted 14 minutes and only affected a small number of customers, EPA considers the entire water system to have been out of compliance for the entire year.

Compliance with the monitoring and maximum contaminant level requirements of the Total Coliform Rule continues to be challenging. We are focusing on compliance and enforcement of these and other standards to ensure that Missourians will be confident they will continue to receive high quality, safe drinking water.

I hope you find this report informative and useful.

A handwritten signature in black ink, appearing to read "Steve Sturgess". The signature is fluid and cursive, written on a light-colored background.

Steve Sturgess, Chief  
Public Drinking Water Branch  
Missouri Department of Natural Resources

## What is a Public Water System

A Public Water System is defined as a system that provides water through piping or other constructed conveyances for human consumption to at least 15 service connections or serves an average of at least 25


people for at least 60 days each year. These are the systems that are the focus of this report.

There are three types of PWSs: community, non-transient noncommunity and transient non-community. Examples of community systems include towns, water districts, subdivisions, mobile home parks and residential facilities such as nursing homes or prisons.

Nontransient non-community systems serve the same people every day, but not in a residential setting; schools and factories are good examples. Transient non-community systems serve different people daily, such as restaurants, resorts and rest stops. These smaller systems are typically in rural areas where it is not feasible to hook up to a city or water district.

Requirements for construction, operation, monitoring, etc., vary among systems based on their type, size, and source of water.

## 2007 Public Water Systems by Type

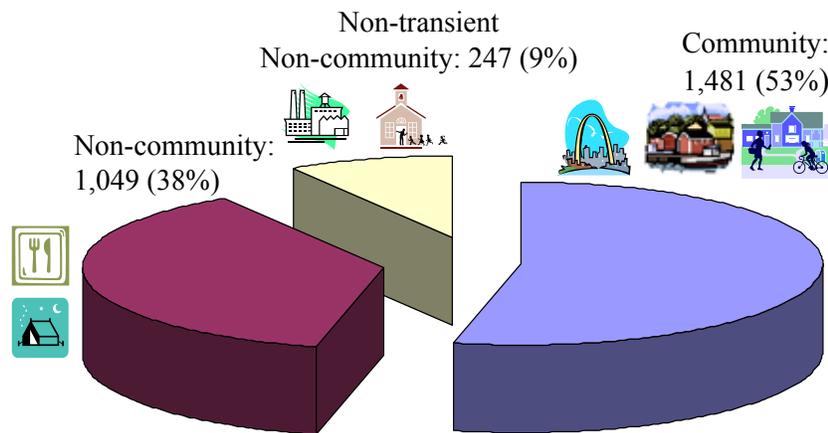

Water testing at systems that are not PWSs (for example, homes served by private wells) is facilitated by local and county sanitarians and the Missouri Department of Health and Senior Services, rather than the Department of Natural Resources.

## The Missouri Public Water System Universe


In 2007, there were 2,772 active PWSs in Missouri. Of this total, 1,481 were community, 247 were non-transient non-community and 1,049 were transient non-community systems.

The community water systems in Missouri served more than 5 million citizens in 2007. These citizens benefit from one of Missouri's most outstanding resources: its water. There is generally a large quantity of high-quality water in Missouri.

By far the largest source of drinking water for Missourians is surface water from the Missouri River. The abundant supply of water in the Missouri River and its proximity to the state's major population centers make the use of this river as a source so popular.

Groundwater is the next most used source of drinking water for Missouri's community supplies. In southern Missouri good quality groundwater is easy to obtain and typically requires very little treatment to be used for drinking water. Some groundwater systems have the best of both worlds and use alluvial wells in valleys

## Source of Water (Percent Population Served)

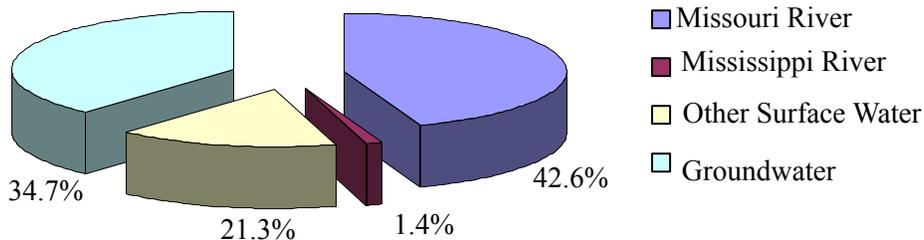


of the Missouri and Mississippi river system where they can get large volumes of water free of surface contaminants. Wells in the Missouri River alluvium provide groundwater to a significant population. More than half the state's population get their drinking water from the Missouri River or its alluvial wells. The importance of this resource cannot be overstated.

### Analysis of Compliance

We expect a lot from our public water systems and require testing for nearly 100 different regulated chemicals and microbiological contaminants on a regular schedule. A system is to be applauded for performing all required testing and meeting all maximum contaminant level (MCL) and treatment technique standards. When violations do occur, that often is the first identification of a problem and can be the first step toward correcting it. Many public water systems perform testing beyond what is required by the state.

The Summary of Violations table in this report counts individual violations. Each PWS has the potential to accumulate multiple violations during the year because there are multiple regulations involved and some monitoring is on a monthly schedule. For example, the monitoring requirements for the Total Coliform Rule alone create a potential for more than 30,000 violations. This puts some perspective on the violation figures shown in the Summary of Violations table and the information in the

### Percent Population of Community Water Systems Meeting Health-based Standards

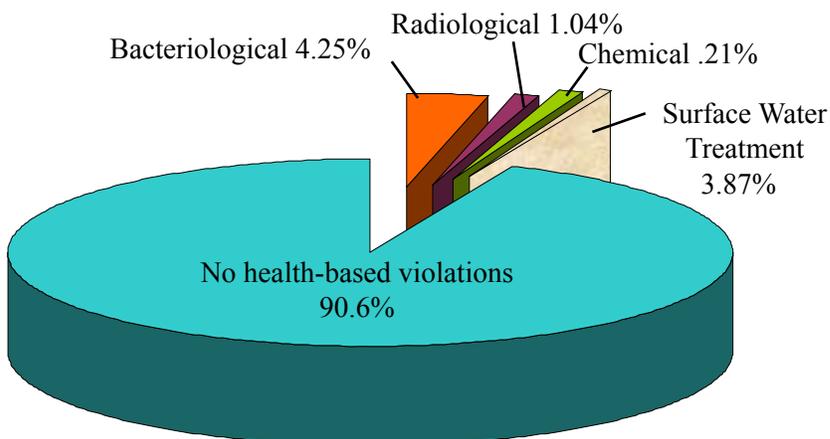


appendices. Another factor to consider is the number of systems that have violations. Many of the violations are from water systems with problems that result in multiple violations during the year. Other systems may only have one or two violations.


Appendices A through D list specific systems by county. The department uses various methods to focus on the water systems that need attention. One of these is the Significant Noncomplier (SNC) List. This is a list of systems with serious violations that potentially affect public health or with multiple monitoring violations. Appendix D gives the list of Significant Non-Compliers for 2007. Some of the systems listed, however, may have already resolved their problems.

During 2007 there were 114 systems on the SNC list. Those systems listed as Significant Non-Compliers typically serve a small population. They accounted for 4 percent of public water systems, but only 1 percent of the population served.

### Significant Non-Compliers

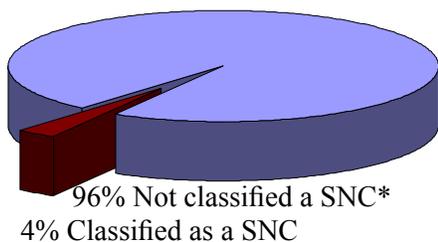

### Percent of Population Served by Significant Non-Compliers

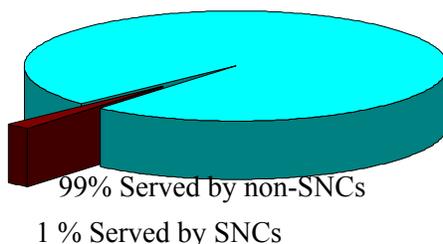

Maximum contaminant level and treatment technique violations represent the most significant impact on the public health. These occurred at a small number of public water systems serving approximately 10 percent of the population.

\* Significant Non-Complier

Since 1996, when the first Annual Compliance Report was produced, through 2003, Missouri has consistently met or exceeded EPA's 2008 target of serving water that meets all health-based standards to 95 percent of the population. Again in 2006, Missouri community water systems met EPA's target. The small dip below the 95 percent target in 2004 and 2005 did not represent a reduction in water quality, but is a result of more stringent drinking water standards. In 2007, this compliance measure dropped significantly.

In 2007 one of Missouri's largest public water systems experienced a treatment technique violation. The water system, Missouri American-St. Louis Division, serves St. Louis County. They have four separate treatment plants on the Missouri River and the Meramec River, serving a total of 1,049,600 customers. The violation they incurred was for exceeding the maximum combined filter effluent turbidity provision of the Interim Enhanced Surface Water Treatment Rule at one plant.

The violation occurred in one set of filters in the South Central Plant when staff were preparing to backwash another set of filters. The duration of the event was 14 minutes between the time the turbidity spike began and the time the plant was shut down. A hydraulic analysis shows that in this period of time the water


entering the distribution system reached 9,831 connections. Based on an average of 2.5 persons per connection, the water may have reached approximately 24,578 customers. There were no reports of any illnesses associated with this event.

However, the compliance measure set by EPA requires counting the entire population of the public water system as being served water that violated a health-based standard, even when the entire population was not affected. In this instance, this causes Missouri's compliance statistic for 2007 to be 70.4 percent. Had the actual population affected been used in the calculation, the statistic would have been 90.6 percent.

EPA and the states have worked together to develop an additional compliance measure called "person-months during which community water systems provide water that meets health-based standards." This measure is intended to take into account situations where violations are of short duration. Missouri is currently achieving 95.7 percent compliance with this new measure. The national target for federal fiscal year 2009 is 95 percent.

The majority of MCL and monitoring violations in 2007 were for failure to meet the requirements

**Population Served Drinking Water Meeting All Health-Based Requirements**

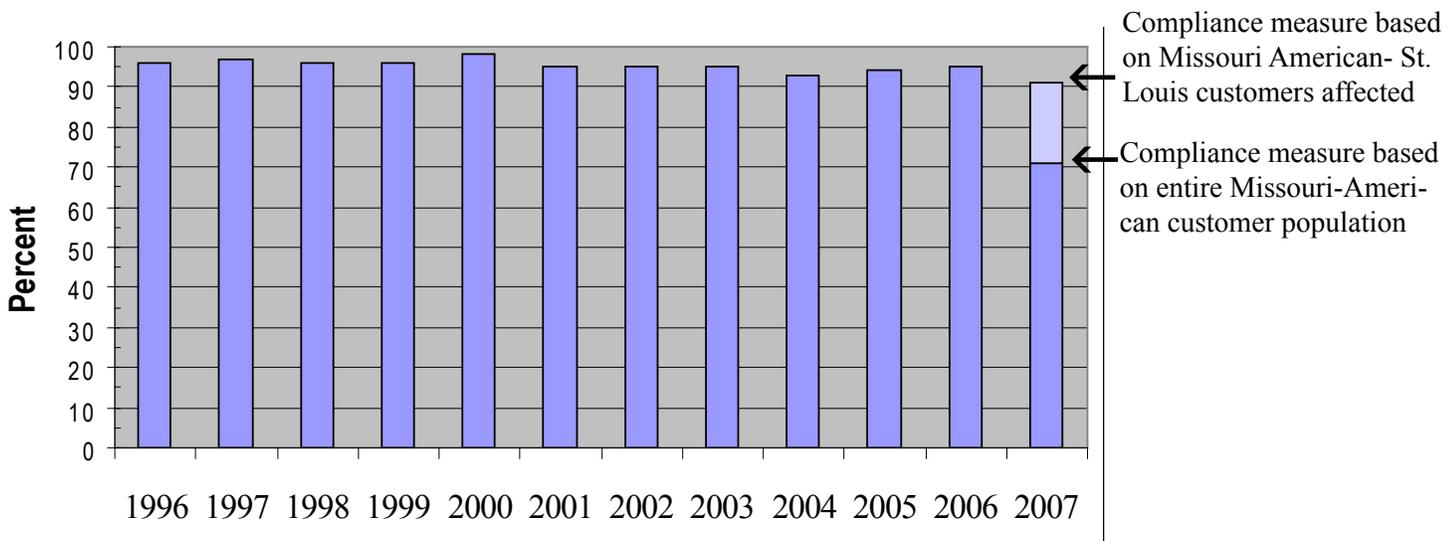

of the Total Coliform Rule. Total coliform bacteria serve as an indicator that disease-causing organisms may be present. All public water systems in the state must test for this type of bacteria every month they dispense water to the public. Monitoring violations are by far the most common violation for this rule. The department is particularly concerned when monitoring violations occur at public water systems that have a history of bacteriological contamination. Adequate testing is the only way to know for sure if the problems have been corrected or have reoccurred.

In 2007 less than one percent, 21 public water systems, had acute violations for fecal coliform or *E. coli*. (One of these systems had three acute MCL violations during the year, resulting in a total of 23 acute MCL violations.)

Another way to look at the number of acute MCL violations is to compare the number that actually occurred to the number possible. Since bacteriological testing is required monthly, the 2,772 water systems had more than 30,000 chances to get an *E. coli* MCL violation. The 23 that actually occurred represent less than one tenth of one percent of the number possible. While these acute violations can be serious, they are rare.

Some people may be more vulnerable to water-borne illness than the general population. To educate the public on this issue, community water systems include a warning in their annual Consumer Confidence Reports stating that some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections.

The Consumer Confidence Report provides detailed information about the specific

community water system, while this report does not. Consumer Confidence Reports include specifics about the water system, including the source of drinking water and the levels of naturally occurring substances in drinking water. Usually these pose no health threat and are not violations. The report must list violations of state and federal requirements for that year. Approximately 95 percent of the state's community water systems are complying with the requirement to produce and distribute Consumer Confidence Reports. Anyone can request a copy of their report from their public water system or by calling the department's Public Drinking Water Branch at 1-800-361-4827 or 573-751-5331.

### **Compliance Activities: Preserving the Quality of Drinking Water**

The department works closely with violators to return them to compliance in a timely manner. This includes phone contacts, on-site inspections, meetings with owners or operators and technical assistance as needed. For the more serious violations, a Bilateral Compliance Agreement between the water system owner and the department is the tool used to move the system back into compliance. Bilateral Compliance Agreements are written agreements negotiated between and signed by the system owner and department staff. This process allows the department to determine the improvements the water system needs to make without either party having to endure the time and cost of litigation.

If a water system owner/operator violates a Bilateral Compliance Agreement, the department implements a negotiated settlement policy. Negotiated settlement agreements are more formal and enforceable than Bilateral Compliance Agreements and are reviewed and signed by staff from the Missouri Attorney General's Office. If the negotiated settlement agreement is unsuccessful, the department refers the case for legal action through the courts.

Public Drinking Water Branch staff work in

conjunction with other agencies to protect public health. By serving on a committee with staff from the Department of Health and Senior Services, the two agencies identify ways to support and benefit each other's activities. One of those areas is enforcement activity against facilities, such as restaurants, that are regulated by both agencies.

The department established the Field Services Division in August 2005, reflecting a focus on improving local services and proactively helping communities and facilities understand and meet environmental regulations. Fundamental to this new approach has been the development of Environmental Assistance Visits. These visits are a tool to help regulated facilities, providing an informal and scheduled walk-through of their permit requirements. Environmental Assistance Visits also allow field staff the opportunity to work with facility operators on technical and administrative issues if necessary.

The department provides training and technical assistance in an effort to prevent the occurrence of violations. Training is routinely provided to operators and owners of public water systems around the state, primarily concentrating on the basic principles of running a water system, performing the required monitoring and preventing contamination of the system. Technical assistance in the form of phone contacts and on-site visits is also available to help water system operators avoid or correct problems. Staff in the department's regional and satellite offices carry out most of these activities.

For all violations, public water systems are required to notify the consumers they serve. The department provides all public water systems with the necessary forms and information to effectively notify the public. The method of notification varies by the violation and system type. Systems must report back to the department how the public notice was performed. Some violations, such as the confirmed detection of fecal coliform bacteria or *E. coli*, warrant

immediate action due to the threat to public health. For such acute violations, the department requires systems to notify customers within 24 hours to boil water before consumption. Boil water orders remain in effect until the problem has been corrected and the water is safe to consume.

#### **For more information**

Information about Missouri's public water systems can be obtained by writing to the Missouri Department of Natural Resources, Public Drinking Branch, Water Protection Program, P.O. Box 176, Jefferson City, MO 65102 or calling 1-800-361-4827 or (573) 751-5331. Information is also available on the department's Web site at [www.dnr.mo.gov/env/wpp/dw-index.htm](http://www.dnr.mo.gov/env/wpp/dw-index.htm).

## Summary of Violations Table

The following definitions apply to the Summary of Violations table.

**Filtered Systems:** Water systems that have installed filtration treatment [10 CSR 60-4.055].

**Inorganic Contaminants:** Non-carbon-based compounds such as metals, nitrates and asbestos. These contaminants are naturally-occurring in some water, but can get into water through farming, chemical manufacturing and other human activities. [10 CSR 60-4.030].

**Lead and Copper Rule:** Lead and copper corrosion pose various health risks when ingested at any level, and can enter drinking water from household pipes and plumbing fixtures [10 CSR 60, Chapter 15]. Violations are reported for: failure to monitor; failure to install optimal corrosion control treatment or a source water treatment system that would reduce lead and copper levels in water at the tap; failure to replace lead service lines on the schedule required by the regulation; and failure to provide required public education about reducing or avoiding lead intake from drinking water.

**Maximum Contaminant Level (MCL):** The highest amount of a contaminant allowed in drinking water. MCLs ensure drinking water does not pose a health risk. MCLs are defined in milligrams per liter (parts per million) unless otherwise specified.

**Monitoring:** The department specifies which water testing methods the water systems must use and sets schedules for the frequency of testing. A water system that does not follow the department's schedule or methodology is in violation. [10 CSR 60-4.010]. States must report monitoring violations that are significant as determined by the EPA Administrator, in consultation with the department. For purposes of this report, significant monitoring violations are major violations and they occur when no

samples are taken or no results are reported during a compliance period.

**Organic Contaminants:** Carbon-based compounds, such as industrial solvents and pesticides. These contaminants generally get into water through runoff from cropland or discharge from factories. [10CSR 60-4.040 and 4.100].

**Radionuclides:** Radioactive particles that can occur naturally in water or result from human activity. Safe drinking water regulations set maximum contaminant levels on five types of radionuclides: radium-226, radium-228, uranium, gross alpha and beta particle/photon radioactivity [10 CSR 60-4.060].

**Surface Water Treatment Rule:** This includes a series of rules promulgated from 1989-2006 that establish criteria under which water systems supplied by surface water sources, or groundwater sources under the direct influence of surface water, must filter and disinfect their water (Surface Water Treatment Rule, Interim Enhanced Surface Water Treatment Rule, Long Term 1 Enhanced Surface Water Treatment Rule, Long Term 2 Enhanced Surface Water Treatment Rule). [10 CSR 60-4.055]

Violations of the surface water treatment rules are reported for the following categories:

- **Monitoring, routine/repeat (for filtered systems):** Failure to carry out required tests or to report the results of those tests. A major monitoring violation for the surface water treatment rule occurs when at least 90 percent of the required samples are not taken or results are not reported during the compliance period.
- **Treatment techniques (for filtered systems):** Failure to properly treat the water.

**Total Coliform Rule (TCR):** The Total Coliform Rule establishes regulations for microbiological contaminants in drinking water. These

contaminants can cause a short-term health problem. If no samples are collected during the one-month compliance period, a major monitoring violation occurs. States report four categories of violations to EPA:

- Acute MCL violation: A violation where the system found fecal coliform or E. Coli, potentially harmful bacteria, in its water.
- Non-acute MCL violation: A violation where the system found total coliform in samples of its water at a frequency or at a level that violates the rule. For systems collecting fewer than 40 samples per month, more than one positive sample for total coliform is a violation. For systems collecting 40 or more samples per month, more than 5 percent of the samples positive for total coliform violation.
- Major routine and follow-up monitoring: A violation where a system did not perform any monitoring.
- Sanitary Survey: A major monitoring violation if a system fails to collect five routine monthly samples if sanitary survey is not performed.

Treatment Techniques: A water disinfection process that EPA requires instead of a MCL for contaminants that laboratories cannot adequately measure. Failure to meet other operational and system requirements under the Surface Water Treatment and the Lead and Copper Rules have also been included in this category of violation for purposes of this report.

Violation: A failure to meet any state or federal drinking water regulation.

**Organic Contaminants**  
**Jan. 1, 2007 - Dec. 31, 2007**

	MCL <sup>1</sup> (mg/L)	MCL		Treatment Technique		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations
<b>Organic Contaminants</b>				*			
1,1,1-Trichloroethane	0.2					24	24
1,1,2-Trichloroethane	0.005					24	24
1,1-Dichloroethylene	0.007					24	24
1,2,4-Trichlorobenzene	0.07					24	24
1,2-DCBP	0.0002						
1,2-Dichloroethane	0.005					24	24
1,2-Dichloropropane	0.005					24	24
2,3,7,8-TCDD (Dioxin)	3x10-8						
2,4,5-TP	0.05						
2,4-D	0.07						
Acrylamide							
Alachlor	0.002						
Atrazine	0.003						
Benzene	0.005					24	24
Benzo[a]pyrene	0.0002						
Carbofuran	0.04						
Carbon tetrachloride	0.005					24	24
Chlordane	0.002						
cis-1,2-Dichloroethylene	0.07					24	24
Dalapon	0.2						
Di(2-ethylhexyl)adipate	0.4						
Di(2-ethylhexyl)phthalate	0.006						
Dichloromethane	0.005					24	24
Dinoseb	0.007						
Diquat	0.02						
Endothall	0.1						
Endrin	0.002						
Epichlorohydrin							
Ethylbenzene	0.7					24	24
Ethylene dibromide	0.00005						
Glyphosate	0.7						
Heptachlor	0.0004						

<sup>1</sup> Values are in milligrams per liter (mg/L), unless otherwise specified

\*Shaded areas indicate a violation is not applicable in this category

**Organic Contaminants**  
**Jan. 1, 2007 - Dec. 31, 2007**

	MCL <sup>1</sup> (mg/L)	MCL		Treatment Technique		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations
Heptachlor epoxide	0.0002						
Hexachlorobenzene	0.001						
Hexachlorocyclopentadiene	0.05						
Lindane	0.0002						
Methoxychlor	0.04						
Monochlorobenzene	0.1					24	24
o-Dichlorobenzene	0.6					24	24
Oxamyl (Vydate)	0.2						
Para-Dichlorobenzene	0.075					24	24
Pentachlorophenol	0.001						
Picloram	0.5						
Simazine	0.004						
Styrene	0.1					24	24
Tetrachloroethylene	0.005					24	24
Toluene	1					24	24
Total PCB	0.0005						
Toxaphene	0.003						
Trans-1,2-Dichloroethylene	0.1					24	24
Trichloroethylene	0.005					24	24
Vinyl chloride	0.002					24	24
Xylenes (total)	10					24	24
Total trihalomethanes	0.80						
Haloacetic acids	0.60						
Disinfection byproducts		41	15	7	5		

<sup>1</sup> Values are in milligrams per liter (mg/L), unless otherwise specified

**Inorganic Contaminants**  
**Jan. 1, 2007 - Dec. 31, 2007**

	MCL <sup>1</sup> (mg/L)	MCL		Treatment Technique		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations
<b>Inorganic Contaminants</b>							
Antimony	0.006					21	21
Arsenic	0.05					21	21
Asbestos	7 million fibers/L						
Barium	2					21	21
Beryllium	0.004					21	21
Cadmium	0.005					21	21
Chromium	0.1					21	21
Cyanide (as free cyanide)	0.2					17	17
Fluoride	4.0	5	2			21	21
Mercury	0.002					21	21
Nitrate	10 (as nitrogen)						
Nitrite	1 (as nitrogen)						
Selenium	0.05					21	21
Thallium	0.002					21	21
<b>Total nitrate and nitrite</b>	10 (as nitrogen)					56	56

<sup>1</sup> Values are in milligrams per liter (mg/L), unless otherwise specified

## Radiological Contaminants

Jan. 1, 2007 - Dec. 31, 2007

	MCL <sup>1</sup> (pCi/L)	MCL		Treatment Technique		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations
<b>Radiological Contaminants</b>							
Gross Alpha	15pCi/L	54	19			25	17
Radium-226 and radium-228	5 pCi/L	86	26			25	17
Gross beta	4 mrem/yr						
<b>Subtotal</b>		140	26 <sup>2</sup>			50	17

## Microbiological Contaminants

Jan. 1, 2007 - Dec. 31, 2007

	MCL Presence/Absence	MCL		Treatment Technique		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations
<b>Total Coliform Rule</b>							
Acute MCL violation	Presence	23	21				
Non-acute MCL violation	Presence	429	302				
Major routine and follow up Monitoring						797	457
Sanitary survey <sup>3</sup>							
<b>Subtotal</b>		452	302 <sup>4</sup>			797	457

<sup>1</sup> Values are in Picocuries per liter (pCi/L), unless otherwise specified

<sup>2</sup> Some systems may have violations in multiple categories

<sup>3</sup> Number of violations for failure to perform sanitary survey under the Total Coliform Rule.

<sup>4</sup> All Systems with an acute MCL violation also had a non-acute monthly MCL violation for the same month

**Surface Water Treatment Rule**  
**Jan. 1, 2007 - Dec. 31, 2007**

	MCL	MCL		Treatment Technique		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems with Violation	Number of Violations	Number of Systems with Violation	Number of Violations	Number of Systems with Violation
<b>Surface Water Treatment</b>							
Filtered systems							
Monitoring, routine/repeat						0	0
Treatment techniques				17	9		
Unfiltered systems							
Monitoring, routine/repeat							
Failure to filter							
<b>Subtotal</b>				17	9	0	0

**Lead and Copper Rule**  
**Jan. 1, 2007 - Dec. 31, 2007**

	MCL	MCL		Treatment Technique		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems with Violation	Number of Violations	Number of Systems with Violation	Number of Violations	Number of Systems with Violation
<b>Lead and Copper Rule <sup>1</sup></b>							
Initial lead and copper tap monitoring and reporting						10	10
Follow-up or routine lead and copper tap monitoring and reporting						36	36
Treatment installation							
Public education							
<b>Subtotal</b>						46	46

<sup>1</sup> Includes any system not up to date on lead and copper monitoring. Not comparable with Annual Compliance Report figures from 2007

**Public Notification**

**Jan. 1, 2007 - Dec. 31, 2007**

	MCL	MCL		Treatment Techniques		Significant Monitoring/ Reporting	
		Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations
<b>Public notification</b>						211	153
Consumer Confidence Reports <sup>1</sup>						65	65
<b>Subtotal</b>						65	65

<sup>1</sup> Violations for failure to produce and distribute the 2007 Consumer Confidence Report in 2008

## Appendix A - MCL Violations

### I. Coliform MCL Violations

#### A. Acute

The following systems were under boil water orders due to acute MCL violations for fecal coliform or E. coli bacteria for the months listed. These acute violations also violate the standard for total coliform bacteria.

County	ID	System Name	Month(s)	Issue	Rescind
Barry	MO5071306	Dell Apartments	February	2/20/2007	2/22/2007
Camden	MO5301407	Royale Palms	May	5/30/2007	6/7/2007
Cass	MO1010225	Drexel	July	7/23/2007	8/9/2007
Christian	MO5036054	Sunset Heights 2nd Addition	June	6/29/2007	7/9/2007
Dallas	MO5212851	Sebastians Diner	August	8/20/2007	11/5/2007
Greene	MO5258164	Crossroads Convenience Store	July	8/9/2007	8/15/2007
	MO5272307	Northwest Baptist Church	May	5/22/2007	6/1/2007
Jasper	MO5048210	Country Club MHP	August	8/15/2007	8/24/2007
	MO5270466	First Baptist Church-avilla	February	2/26/2007	3/8/2007
	MO5292829	Star Pump And Pantry	April	4/18/2007	5/15/2007
	MO5292829	Star Pump And Pantry	August	8/30/2007	9/24/2007
	MO5292829	Star Pump And Pantry	December	12/20/2007	1/2/2008
Jefferson	MO6069051	St Joseph Hill Infirmary	August	8/17/2007	8/22/2007
Lawrence	MO5292361	Baumers Food Mart	July	7/13/2007	7/27/2007
Newton	MO5048974	Tee Pee Reservation MHP	September	9/17/2007	10/12/2007
Ozark	MO5292331	Dora General Store	July	7/13/2007	7/19/2007
Pulaski	MO3010720	St Robert	June	6/27/2007	7/14/2007
Stone	MO5190988	Double Oak Resort	May	6/11/2007	7/9/2007
	MO5292451	Jj Junction	May	6/2/2007	6/11/2007
	MO5191413	Kimberling Suites Resort Hotel	June	6/21/2007	6/27/2007
	MO5191453	Village At Indian Point	September	9/13/2007	9/19/2007
Vernon	MO5024622	Vernon Co PWSD #7	May	6/2/2007	6/21/2007
Wayne	MO4212797	Wayne County Eagles #4187	February	3/1/2007	3/7/2007

## Appendix A - MCL Violations

### I. Coliform MCL Violations

#### B. Non-acute

The following systems had two or more samples test positive for total coliform bacteria in the months indicated.

County	ID#	System Name	Month(s)
Barry	MO5010027	Arrow Point Village	March
	MO5010837	Washburn	April
	MO5010856	Wheaton	July
	MO5071306	Dell Apartments	January
	MO5071306	Dell Apartments	February
	MO5102200	USFS Shell Knob Campground	May
	MO5102200	USFS Shell Knob Campground	June
	MO5102200	USFS Shell Knob Campground	July
	MO5211850	Pizza Hut	May
	MO5211850	Pizza Hut	August
	MO5212453	Country Diner	July
	MO5212453	Country Diner	August
	MO5212841	Fraternal Order Of Eagle #4155	July
	MO5218155	B & J Smoke House	September
	MO5242811	Mikes Hideaway	June
	MO5252497	Eagle Point Property Owners Assn	January
	MO5252497	Eagle Point Property Owners Assn	February
	MO5252511	Fishermans Table Rock Imprvmnt Assn	October
	MO5252511	Fishermans Table Rock Imprvmnt Assn	November
	MO5252511	Fishermans Table Rock Imprvmnt Assn	December
	MO5258287	Viola R V & Mobile Home Park	May
	MO5258287	Viola R V & Mobile Home Park	September
	MO5292405	Jenkins Kwik Stop	May
Benton	MO1031536	Oak Ridge Acres	August
	MO1031536	Oak Ridge Acres	September
	MO1031536	Oak Ridge Acres	November
	MO1031545	Cedar Grove Park	July
	MO1031545	Cedar Grove Park	August
	MO1202765	Country Lakes Campground Ii	April
	MO1202872	Warsaw Shrine Club	October
	MO1202872	Warsaw Shrine Club	November
	MO1212779	Valley Bar And Grill	March
	MO1212779	Valley Bar And Grill	June
	MO1212779	Valley Bar And Grill	July
	MO1212779	Valley Bar And Grill	October
	MO1212779	Valley Bar And Grill	December

## Appendix A - MCL Violations

### I. Coliform MCL Violations

#### B. Non-acute

The following systems had two or more samples test positive for total coliform bacteria in the months indicated.

County	ID#	System Name	Month(s)
	MO1212806	Lost Acres (Vikings)	October
	MO1212807	Two Sister Mm Bar And Grill	November
	MO1242707	All Wright Rv Park	May
	MO1282813	Shady Oaks Trailer Park	September
	MO1282813	Shady Oaks Trailer Park	October
	MO3010180	Cole Camp	October
	MO3010400	Ionia	December
	MO3040761	Lake Hills Mh/rv Park	November
	MO3112196	Truman Visitor Center	November
	MO3112196	Truman Visitor Center	December
	MO3120156	Harry S Truman State Park Office	June
	MO3190267	Grand River Resort	September
	MO3190267	Grand River Resort	October
	MO3190902	Head Waters Motel	October
	MO3210256	Bb Bar & Restaurant	February
	MO3210256	Bb Bar & Restaurant	December
	MO3210344	Dars Cafe	October
	MO3210344	Dars Cafe	November
	MO3242078	Heits Point Lutheran Camp System # 1	August
	MO3242534	Fairfield Rv Park	June
	MO3242534	Fairfield Rv Park	July
	MO3242534	Fairfield Rv Park	August
	MO3270289	Cedar Grove Baptist Church	September
	MO3291407	Hot Spot #1	August
Bollinger	MO4142183	Duck Creek Wildlife Area	June
	MO4172719	New Salem Baptist Church & School	December
Butler	MO4191461	Millers Motor Lodge	June
	MO4191461	Millers Motor Lodge	July
	MO4191461	Millers Motor Lodge	August
Camden	MO3024090	Camden Co PWS #1	December
	MO3031220	Seven Trails West Subd	October
	MO3031323	Ginger Cove Subdivision	June
	MO3198084	Deepwater Inn	June
	MO3198084	Deepwater Inn	September
	MO3198088	Mickeyland Resort	September
	MO3211107	Happy Fisherman	July

## Appendix A - MCL Violations

### I. Coliform MCL Violations

#### B. Non-acute

The following systems had two or more samples test positive for total coliform bacteria in the months indicated.

County	ID#	System Name	Month(s)
	MO3212312	Fish & Company	May
	MO3212446	Red Fox Bar & Grill	July
	MO3212539	Stingray Marina	May
	MO3212554	Neighbors Landing	August
	MO3218001	The Trail House Restaurant	August
	MO3218226	The Duck	August
	MO3218227	Bass Cove Lodge	September
	MO3238092	Osage Heritage Condominiums	July
	MO3238092	Osage Heritage Condominiums	August
	MO3258245	Kings Plaza	October
	MO3282519	Zack Wheat American Legion Post #6	May
	MO5031469	Oakwood Hills Subdivision	April
	MO5031544	Oak Shadows Subdivision	July
	MO5212764	Its Twelve O'clock Somewhere	March
	MO5212764	Its Twelve O'clock Somewhere	May
	MO5212764	Its Twelve O'clock Somewhere	July
	MO5212764	Its Twelve O'clock Somewhere	October
	MO5212764	Its Twelve O'clock Somewhere	November
	MO5212764	Its Twelve O'clock Somewhere	December
	MO5301407	Royale Palms	May
Cape Girardeau	MO4024100	Cape Girardeau Co PWSD #4	September
Carter	MO4218536	Piney Wood	August
Cass	MO1010225	Drexel	July
	MO1010675	Raymore	May
Cedar	MO5010241	El Dorado Springs	July
	MO5010241	El Dorado Springs	October
	MO5024120	Cedar Co PWSD #1	July
	MO5036164	Stockton Hills Water Co	May
	MO5190909	Chapel Hill Subd	September
	MO5282827	Vikings Office Bar Post 129	May
	MO5292828	Stockton Mini Mart Inc	October
	MO5292828	Stockton Mini Mart Inc	December
Chariton	MO2010420	Keytesville	September
Christian	MO5010071	Billings	July
	MO5024133	Christian Co PWSD #1	May
	MO5031152	Valley Woods Subdivision	September
	MO5036054	Sunset Heights 2nd Addition	June

## Appendix A - MCL Violations

### I. Coliform MCL Violations

#### B. Non-acute

The following systems had two or more samples test positive for total coliform bacteria in the months indicated.

County	ID#	System Name	Month(s)
	MO5218151	Riverside Inn	June
Cole	MO2182824	Wren Associates	October
	MO3031301	Red Field Subdivision	October
	MO3031301	Red Field Subdivision	November
Crawford	MO3190845	Skippys Route 66 Inn	August
	MO3202538	Cuba Lakes Golf And Country Club	June
	MO3202538	Cuba Lakes Golf And Country Club	August
	MO3241649	Bass River Resort	September
	MO6010759	Steelville	August
	MO6069079	Redwood Manor Care Center	May
	MO6069079	Redwood Manor Care Center	June
Dade	MO5031397	Three Hills Subdivision	August
	MO5110193	Stockton Mutton Creek Marina East	June
	MO5230535	Mutton Creek Marina	June
Dallas	MO5212821	Silver Spur Steakhouse	February
	MO5212851	Sebastians Diner	July
	MO5212851	Sebastians Diner	August
Dent	MO4048230	Teris Country Homes	October
	MO4048230	Teris Country Homes	November
	MO4171148	Oak Hill Elem School	July
Douglas	MO5102201	USFS Noblett Lake Recreation Area	June
	MO5171803	Skyline Elem School	May
	MO5241141	Twin Bridges Canoe And Campground	June
	MO5282625	C L Discount Grocery	July
Dunklin	MO4010022	Arbyrd	August
	MO4010170	Clarkton	July
	MO4010379	Hornersville	August
Franklin	MO6010303	Gerald	August
	MO6010801	Union	June
	MO6031237	Hayfield Water Works	June
	MO6036269	Woodland Hills Subd	July
	MO6036269	Woodland Hills Subd	August
	MO6212311	Wedding Bells	May
	MO6212311	Wedding Bells	June
	MO6212311	Wedding Bells	July
Gasconade	MO6036015	Peaceful Valley Service Co	May

## Appendix A - MCL Violations

### I. Coliform MCL Violations

#### B. Non-acute

The following systems had two or more samples test positive for total coliform bacteria in the months indicated.

County	ID#	System Name	Month(s)
	MO6211503	Silver Dollar Lounge	December
	MO6252212	Brown Shanty Lake Assn	September
Gentry	MO1024223	Gentry Co PWSD #1	December
Greene	MO5010768	Strafford	September
	MO5010860	Willard	June
	MO5010860	Willard	November
	MO5036094	Green Hills Country Club	May
	MO5036109	Wadsworth Park Unit 4&5	January
	MO5036109	Wadsworth Park Unit 4&5	May
	MO5036187	Cross Roads Acres	May
	MO5036187	Cross Roads Acres	July
	MO5036218	The Landing Subdivision	October
	MO5036218	The Landing Subdivision	November
	MO5036258	Eastbourough Subd	October
	MO5048145	Silver Bell Mobile Home Park	May
	MO5048145	Silver Bell Mobile Home Park	June
	MO5171256	Logan Rogersville Middle School	September
	MO5188035	Conco Quarries	September
	MO5258076	Boltons General Store	September
	MO5258076	Boltons General Store	October
	MO5258164	Crossroads Convenience Store	July
	MO5258164	Crossroads Convenience Store	September
	MO5272307	Northwest Baptist Church	May
	MO5272435	Evergreen Church	May
	MO5272758	Wilson Creek Baptist Church	August
	MO5272758	Wilson Creek Baptist Church	November
	MO5272758	Wilson Creek Baptist Church	December
	MO5272759	Springhill Baptist Church	September
Henry	MO1021117	Henry Co PWSD #3	December
Hickory	MO5192686	Nemo Bridge Resort	September
	MO5252773	Starlight Lane Subdivision	July
	MO5252773	Starlight Lane Subdivision	October
	MO5261466	Hickory Hollow MHP	January
Howell	MO4024267	Howell Oregon Co PWSD #2 North	August
Iron	MO4010017	Annapolis	July
Jackson	MO1070518	Kansas City Water Svcs Atherton Plant	July
Jasper	MO5048210	Country Club MHP	August

## Appendix A - MCL Violations

### I. Coliform MCL Violations

#### B. Non-acute

The following systems had two or more samples test positive for total coliform bacteria in the months indicated.

County	ID#	System Name	Month(s)
	MO5180568	Mars Petcare Us	August
	MO5180607	Dyno Nobel	November
	MO5218143	Royal Oaks Arena	May
	MO5270466	First Baptist Church-avilla	February
	MO5292829	Star Pump And Pantry	April
	MO5292829	Star Pump And Pantry	July
	MO5292829	Star Pump And Pantry	August
	MO5292829	Star Pump And Pantry	December
Jefferson	MO6010368	Hillsboro	June
	MO6036028	Lake Lorraine Water Co	September
	MO6036031	Summer Set Subd	June
	MO6036031	Summer Set Subd	September
	MO6036257	Paradise Valley Subd	November
	MO6036316	Palisades Village	February
	MO6036316	Palisades Village	April
	MO6069051	St Joseph Hill Infirmarary	August
	MO6291426	Festus Fuel & Food Mart	May
	MO6291426	Festus Fuel & Food Mart	June
	MO6291426	Festus Fuel & Food Mart	August
Johnson	MO1041466	Hazel Hill MHP	June
	MO1041466	Hazel Hill MHP	September
Laclede	MO5010185	Conway	July
	MO5010458	Lebanon	June
	MO5024319	Laclede Co PWSD #3	May
	MO5171189	Gasconade C 4 Elem School	August
	MO5282611	Sign Fab Inc	July
	MO5292470	Clayton Conoco	August
Lawrence	MO5010341	Halltown	September
	MO5010765	Stotts City	September
	MO5010765	Stotts City	October
	MO5048020	Vaughn Trailer Park	December
	MO5048294	Lucky Lady Mobile Home Park	May
	MO5211348	Dons Crossroads	March
	MO5212358	Route 66 Tavern	February
	MO5248289	Camp Wakonda	August
	MO5292361	Baumers Food Mart	July

## Appendix A - MCL Violations

### I. Coliform MCL Violations

#### B. Non-acute

The following systems had two or more samples test positive for total coliform bacteria in the months indicated.

County	ID#	System Name	Month(s)
	MO5292588	Kcs Enterprises Inc	June
	MO5292588	Kcs Enterprises Inc	August
	MO5292588	Kcs Enterprises Inc	October
	MO5292588	Kcs Enterprises Inc	December
Lincoln	MO6036217	Lakeview Subd Water System	April
	MO6036217	Lakeview Subd Water System	May
	MO6122660	Cuivre River State Park Picnic Shelter	October
	MO6212332	Jr Diamonds	June
	MO6212332	Jr Diamonds	November
	MO6212332	Jr Diamonds	December
	MO6282383	Lindenwood Skyway Farm	May
	MO6291625	Castles Grocery And Cafe	November
Madison	MO4100013	USFS Silver Mines Camp	August
	MO4100013	USFS Silver Mines Camp	October
	MO4240036	Blue Mountain United Methodist Camp	June
	MO4240036	Blue Mountain United Methodist Camp	July
Maries	MO3010054	Belle	October
	MO3010822	Vienna	September
	MO3242408	Turkey Hill Ranch Bible Camp	April
	MO3292561	Ray Rays Llc	July
McDonald	MO5010577	Noel	July
Miller	MO3048097	Doolittle MHP	June
	MO3048097	Doolittle MHP	July
	MO3178192	Our Lady Of The Snow School	December
	MO3190833	Spinnaker Point	August
	MO3231548	Lake Village Subd Well Owners Assn	May
	MO3231548	Lake Village Subd Well Owners Assn	June
	MO3231548	Lake Village Subd Well Owners Assn	July
	MO3231548	Lake Village Subd Well Owners Assn	August
	MO3231548	Lake Village Subd Well Owners Assn	September
	MO3231548	Lake Village Subd Well Owners Assn	October
Moniteau	MO3024395	Moniteau Co PWS #1	July
Montgomery	MO3241117	Kan Do Kampground & Rv Park	October
	MO3281053	Loutre Shore Country Club	May
	MO3281053	Loutre Shore Country Club	June
	MO3281053	Loutre Shore Country Club	July
	MO6122671	Graham Cave State Park Office	October

## Appendix A - MCL Violations

### I. Coliform MCL Violations

#### B. Non-acute

The following systems had two or more samples test positive for total coliform bacteria in the months indicated.

County	ID#	System Name	Month(s)
Morgan	MO3010767	Stover	October
	MO3010767	Stover	November
	MO3024413	Laurie	June
	MO3024413	Laurie	July
	MO3031358	Ivy Bend Water Association	April
	MO3031358	Ivy Bend Water Association	May
	MO3031358	Ivy Bend Water Association	October
	MO3190044	Camp Sabra	June
	MO3190822	The Anchorage Pub & MHP	May
	MO3192316	Beauty View Resort	September
	MO3202562	Rolling Hills Country Club	February
	MO3211305	Painted Pony	July
	MO3211305	Painted Pony	August
	MO3218268	Osage River Bar & Grill	August
	MO3250819	Cool Valley Association	June
	MO3250819	Cool Valley Association	July
	MO5031454	Bendco Cove	June
	MO5031454	Bendco Cove	September
	MO5031454	Bendco Cove	October
	MO5031454	Bendco Cove	November
	MO5041552	Shady Acres	June
	MO5041552	Shady Acres	July
	MO5202702	Mallard Bay	July
	MO5202702	Mallard Bay	August
	MO5202702	Mallard Bay	September
Newton	MO5048269	Quail Meadows MHP	August
	MO5048269	Quail Meadows MHP	October
	MO5048974	Tee Pee Reservation MHP	June
	MO5048974	Tee Pee Reservation MHP	August
	MO5048974	Tee Pee Reservation MHP	September
	MO5170238	Jesus Name Pentacostal Church	August
	MO5182750	Heritage Oak Flooring	June
	MO5182750	Heritage Oak Flooring	July
	MO5211212	Cjs Cafe	October
	MO5258147	Daves Super Stop	January
	MO5291268	Christines Conoco	August
Osage	MO3010517	Meta	October

## Appendix A - MCL Violations

### I. Coliform MCL Violations

#### B. Non-acute

The following systems had two or more samples test positive for total coliform bacteria in the months indicated.

County	ID#	System Name	Month(s)
	MO3010517	Meta	November
Ozark	MO5030209	Sundown Village Of	September
	MO5100022	USFS North Fork Recreation Area	August
	MO5191676	Thunder Bay Resort	August
	MO5212725	Cedar Cafe & Cedar Haven Park Inc	May
	MO5212755	Cross Roads Store	December
	MO5212795	Lori Sues Hillside Cafe	April
	MO5242739	Pettit Canoe Rental	May
	MO5292331	Dora General Store	July
Perry	MO4036132	Port Perry Service	May
Pettis	MO3021332	Pettis/johnson/saline PWSD #1	August
	MO3036105	Monsees Lake Estates	May
	MO3048254	Crestview MHP	February
	MO3048254	Crestview MHP	November
	MO3048254	Crestview MHP	December
	MO3190893	Budget Host Super 7 Motel	June
	MO3218195	Dickie Doo Bar B Que	August
Phelps	MO3048132	Scenic View MHP	January
	MO3048132	Scenic View MHP	September
	MO3069014	Ferndale Residential Care Ii	August
Platte	MO1010646	Platte City	March
	MO1024482	Platte Co PWSD #8	May
Polk	MO5036140	Prairie Heights Subd	October
	MO5222460	Bolivar Municipal Airport	October
	MO5258125	Cases Corner Llc	April
	MO5258125	Cases Corner Llc	December
Pulaski	MO3010720	St Robert	June
	MO3024490	Pulaski Co PWSD #1	September
	MO3202484	Oak Hills Country Club	September
	MO3202484	Oak Hills Country Club	October
	MO3242354	Gasconade Christian Svc Camp	July
Scott	MO4010743	Sikeston	August
	MO4010945	Morley	October
	MO4010971	Haywood City	September
Shannon	MO4248525	Jason Place Campground	July
	MO4248525	Jason Place Campground	August
St. Charles	MO6010849	Wentzville	September

## Appendix A - MCL Violations

### I. Coliform MCL Violations

#### B. Non-acute

The following systems had two or more samples test positive for total coliform bacteria in the months indicated.

County	ID#	System Name	Month(s)
	MO6024530	St Charles Co PWSD #2	September
	MO6030662	Big Country Acres Subdivision	January
	MO6202712	Indian Camp Creek Park	August
	MO6202712	Indian Camp Creek Park	September
St. Clair	MO5010480	Lowry City	October
	MO5212119	Jump Stop #8	June
St. Francois	MO4069082	L & J Boarding Home	April
	MO4069082	L & J Boarding Home	May
	MO4069082	L & J Boarding Home	September
	MO4218516	Moore's Farm	May
	MO4292751	D & B C Store	August
	MO4292751	D & B C Store	September
St. Louis	MO6202395	Lone Elk County Park	July
Ste. Genevieve	MO4282793	Crown Valley Winery	November
Stone	MO5030870	Country Time Estates	July
	MO5031141	Wildflowers Hoa	January
	MO5031145	Melody Manor Subdivision	October
	MO5031446	Country Meadows Subdivision	June
	MO5036076	Hoot Owl Point Subd	May
	MO5036090	Village Of Coney Island	April
	MO5036090	Village Of Coney Island	May
	MO5036090	Village Of Coney Island	June
	MO5036201	Stonebridge West Subd	January
	MO5036356	Kimberling Airways Subd	March
	MO5036356	Kimberling Airways Subd	July
	MO5036356	Kimberling Airways Subd	August
	MO5100028	USFS Big Bay Campground	July
	MO5111966	Table Rock Baxter Park 100	August
	MO5190587	White Eagle Woods MHP	September
	MO5190935	Bavarian Village Resort	July
	MO5190935	Bavarian Village Resort	November
	MO5190938	Cove Resort	June
	MO5190957	Shadrack Resort	June
	MO5190962	White Wing Resort	April
	MO5190962	White Wing Resort	May
	MO5190962	White Wing Resort	June

## Appendix A - MCL Violations

### I. Coliform MCL Violations

#### B. Non-acute

The following systems had two or more samples test positive for total coliform bacteria in the months indicated.

County	ID#	System Name	Month(s)
	MO5190976	Four Seasons Resorts	May
	MO5190988	Double Oak Resort	May
	MO5190992	Lucky 13 Resort	July
	MO5190998	Whispering Woods	July
	MO5190998	Whispering Woods	August
	MO5191312	Calm Waters Resort	September
	MO5191413	Kimberling Suites Resort Hotel	June
	MO5191453	Village At Indian Point	September
	MO5191925	Kings Cove Resort	September
	MO5210593	Colonial Mountain Inn	October
	MO5211961	Wooden Nickel Restaurant	May
	MO5211961	Wooden Nickel Restaurant	June
	MO5211961	Wooden Nickel Restaurant	August
	MO5238059	Table Rock Sportsmens Club	April
	MO5241680	Castlevew Country Club	October
	MO5242478	Starrville Park	May
	MO5252603	Turner Silver Bell Subdivision	June
	MO5252603	Turner Silver Bell Subdivision	July
	MO5252603	Turner Silver Bell Subdivision	August
	MO5252629	Anglers Bend Sub Rees 1st Addition	October
	MO5258134	Carr Lane Country Stop	September
	MO5282679	The Lake House	November
	MO5292451	Jj Junction	May
	MO5292451	Jj Junction	October
Taney	MO5010285	Forsyth	September
	MO5036117	Moore Bend Subd	March
	MO5036180	Taney Co Utilities Corp #1	October
	MO5041419	Hideaway MHP	July
	MO5070611	Branson East Apartments	September
	MO5071269	Paradise Point Resort Llc	July
	MO5072790	Casa De Luz	August
	MO5171231	Bradleyville R I School	August
	MO5171231	Bradleyville R I School	September
	MO5171233	Mark Twain R Viii Elem School	June
	MO5191008	Vickery Resort Motel	October
	MO5201414	Americas Best Cmpgrnd	September
	MO5218299	Taney County Memorial Post #5168	June

## Appendix A - MCL Violations

### I. Coliform MCL Violations

#### B. Non-acute

The following systems had two or more samples test positive for total coliform bacteria in the months indicated.

County	ID#	System Name	Month(s)
	MO5218299	Taney County Memorial Post #5168	August
	MO5258138	Rapid Roberts #104	February
	MO5258138	Rapid Roberts #104	March
	MO5282768	Branson Log Homes	May
	MO5282831	Sweet Pea Day Care	April
	MO5282831	Sweet Pea Day Care	July
	MO5292590	Gateway To Branson	October
Texas			
	MO4010382	Houston	June
	MO4024607	Texas Co PWSD #2	August
	MO4024607	Texas Co PWSD #2	September
	MO4024609	Texas Co PWSD #4	November
Vernon			
	MO5024622	Vernon Co PWSD #7	May
Warren			
	MO6010505	Marthasville	August
	MO6048093	Midway Trailer Park	August
	MO6182070	Flying J Travel Plaza	August
Washington			
	MO6120173	Washington State Park	November
Wayne			
	MO4198545	Twin Oaks Resort	June
	MO4212797	Wayne County Eagles #4187	January
	MO4212797	Wayne County Eagles #4187	February
Webster			
	MO5010734	Seymour	April
	MO5258117	Eagle Stop	October
Worth			
	MO1010739	Sheridan	June
	MO1010739	Sheridan	July
Wright			
	MO5010550	Mountain Grove	May
	MO5010550	Mountain Grove	July
	MO5010550	Mountain Grove	August
	MO5172799	Mountain Grove Mennonite Church & School	December

## Appendix A - MCL Violations

### II. Chemical MCL Violations

County	ID#	System Name	Chemical
Bates	MO1024031	Bates Co PWSD #2	Total Haloacetic Acids (HAA5)
Boone	MO3010181	Columbia	Total Trihalomethanes (TTHM)
Cass	MO1010024	Archie	Total Trihalomethanes (TTHM)
	MO1010225	Drexel	Total Trihalomethanes (TTHM)
	MO1010301	Garden City	Total Trihalomethanes (TTHM)
Daviess	MO1036130	Daviess Co PWSD #3	Total Haloacetic Acids (HAA5)
	MO1036130	Daviess Co PWSD #3	Total Trihalomethanes (TTHM)
Dekalb	MO1010510	Maysville	Total Trihalomethanes (TTHM)
Gentry	MO1070639	Middle Fork Water Co	Total Trihalomethanes (TTHM)
	MO1070639	Middle Fork Water Co	Total Haloacetic Acids (HAA5)
Grundy	MO2010796	Trenton Municipal Utilities	Total Trihalomethanes (TTHM)
Lincoln	MO6024340	Lincoln Co PWSD #1	Fluoride
	MO6031217	Timber Ridge Estates	Fluoride
Linn	MO2010112	Bucklin	Total Haloacetic Acids (HAA5)
	MO2010497	Marceline	Total Haloacetic Acids (HAA5)
Monroe	MO2010538	Monroe City	Total Haloacetic Acids (HAA5)
Montgomery	MO6010848	Wellsville	Total Haloacetic Acids (HAA5)
	MO6010848	Wellsville	Total Trihalomethanes (TTHM)
Newton	MO5041190	Raines MHP	Total Haloacetic Acids (HAA5)

**Appendix A - MCL Violations**  
**III. Radiological MCL Violations**

County	ID#	System Name	Violation
County	ID#	System Name	Chemical
Callaway	Mo3048994	New Christian Life Fellowship	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO3048994	New Christian Life Fellowship	Radium, Combined (226, 228)
Camden	MO3031265	Big Island Homeowner Water & Sewer Assoc.	Radium, Combined (226, 228)
Cape Girardeau	MO4031453	Westlake Meadows Subdivision	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO4031453	Westlake Meadows Subdivision	Radium, Combined (226, 228)
Iron	MO4069040	Bellevue Valley Nursing Home	Radium, Combined (226, 228)
Lincoln	MO6024340	Lincoln Co PWSD #1	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO6024340	Lincoln Co PWSD #1	Radium, Combined (226, 228)
	MO6041073	Charwood Estates	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO6041073	Charwood Estates	Radium, Combined (226, 228)
	MO6041076	Cedar Ridge Estates	Radium, Combined (226, 228)
	MO6041229	Autumn Hills MHP	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO6041229	Autumn Hills MHP	Radium, Combined (226, 228)
McDonald	MO5010449	Lanagan	Radium, Combined (226, 228)
	MO5021168	Mc Donald Co PWSD #3	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO5021168	Mc Donald Co PWSD #3	Radium, Combined (226, 228)
Montgomery	MO6010521	Middletown	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO6010521	Middletown	Radium, Combined (226, 228)
St Charles	MO6030484	Country Estates	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO6030484	Country Estates	Radium, Combined (226, 228)
St Francois	MO4010087	Bonne Terre	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO4010087	Bonne Terre	Radium, Combined (226, 228)
	MO4010270	Farmington	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO4010270	Farmington	Radium, Combined (226, 228)
	MO4010279	Park Hills	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO4010279	Park Hills	Radium, Combined (226, 228)
	MO4031206	Hunters Ridge Subd	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO4031206	Hunters Ridge Subd	Radium, Combined (226, 228)
	MO4036059	Terre Du Lac	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO4036059	Terre Du Lac	Radium, Combined (226, 228)
	MO4036124	Wycliff Meadows Subd	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO4036124	Wycliff Meadows Subd	Radium, Combined (226, 228)
	MO4041308	Walnut Grove MHP	Gross Alpha, Inclng Ra, Exclng Rn & U
	MO4041308	Walnut Grove MHP	Radium, Combined (226, 228)
	MO4048064	Town & Country Mobile Home Park	Radium, Combined (226, 228)
	MO4061410	Bonne Terre Prison	Gross Alpha, Inclng Ra, Exclng Rn & U

**Appendix A - MCL Violations**  
**III. Radiological MCL Violations**

County	ID#	System Name	Violation
	MO4061410	Bonne Terre Prison	Radium, Combined (226, 228)
	MO4069041	Farmington Correctional Center	Radium, Combined (226, 228)
	MO4069041	Farmington Correctional Center	Gross Alpha, Inclndg Ra, Exclndg Rn & U
St Louis	MO6069015	Whispering Oaks Health Care	Radium, Combined (226, 228)
Vernon	MO5010104	Bronaugh	Radium, Combined (226, 228)
Washington	MO4011123	Mineral Point	Gross Alpha, Inclndg Ra, Exclndg Rn & U
	MO4011123	Mineral Point	Radium, Combined (226, 228)
	MO6010659	Potosi	Gross Alpha, Inclndg Ra, Exclndg Rn & U
	MO6010659	Potosi	Radium, Combined (226, 228)

**Appendix A – MCL Violations**  
**IV. Surface Water MCL Violations**

The following systems violated the Surface Water Rule, Treatment Technique for Turbidity or other surface water requirements in the months or annual period indicated

County	ID#	System	Period	Violation
Bates	MO1010001	Adrian	March	Combined Filter Effluent Turbidity
	MO1010001	Adrian	June	Combined Filter Effluent Turbidity
	MO1010001	Adrian	February	Combined Filter Effluent Turbidity
Cass	MO1010024	Archie	June	Combined Filter Effluent Turbidity
	MO1010225	Drexel	July	Combined Filter Effluent Turbidity
	MO1010225	Drexel	July	Combined Filter Effluent Turbidity
	MO1010225	Drexel	August	Single reading, Combined Filter Effluent Turbidity
	MO1010225	Drexel	December	Combined Filter Effluent Turbidity
	MO1010301	Garden City	May	Combined Filter Effluent Turbidity
Clark	MO2010875	Wyaconda	4th Quarter	Inadequate DBP Precursor Removal
Harrison	MO1024241	Harrison Co PWS #1	February	Combined Filter Effluent Turbidity
	MO1024241	Harrison Co PWS #1	May	Combined Filter Effluent Turbidity
	MO1024241	Harrison Co PWS #1	March	Combined Filter Effluent Turbidity

<sup>1</sup> System was under boil water order from April 27 to May 3, 2007.

## Appendix A – MCL Violations

### IV. Surface Water MCL Violations

The following systems violated the Surface Water Rule, Treatment Technique for Turbidity or other surface water requirements in the months or annual period indicated

County	ID#	System	Period	Violation
Howell	MO4010853	West Plains	May	Single Reading, Combined Filter Effluent Turbidity
Jefferson	MO6182217	Ameren U E Rush Island	March	Combined Filter Effluent Turbidity
Johnson	MO1010371	Holden	May	Combined Filter Effluent Turbidity
	MO1010371	Holden	July	Combined Filter Effluent Turbidity
Linn	MO2010497	Marceline	4th Quarter	Inadequate DBP Precursor Removal
Montgomery	MO6010848	Wellsville	2nd Quarter	Inadequate DBP Precursor Removal
	MO6010848	Wellsville	3rd Quarter	Inadequate DBP Precursor Removal
	MO6010848	Wellsville	4th Quarter	Inadequate DBP Precursor Removal
Pettis	MO3010728	Sedalia	4th Quarter	Inadequate DBP Precursor Removal
St Francois	MO4240120	S F Scout Ranch	July	Combined Filter Effluent Turbidity
	MO4240120	S F Scout Ranch	August	Single Reading, Combined Filter Effluent Turbidity
St Louis	MO6010716	Mo American St Louis Co St Charles	August	Single Reading, Combined Filter Effluent Turbidity
Wayne	MO4010640	Piedmont	April	Combined Filter Effluent Turbidity

## Appendix B

### I. Chronic Major Monitoring Violations

The following systems had three or more major violations of the Total Coliform Rule in 2007 and were listed in news releases for chronic monitoring violations.

County	System Name	ID#	Month(s)
Barry	Country Diner	MO5212453	April
			May
			June
			December
	Fuel Express	MO5291633	September
			October
			November
			December
Benton	Sun Valley Subdivision	MO3031366	January
			February
			March
			April
			August
			September
			October

**Appendix B**

**I. Chronic Major Monitoring Violations**

<b>County</b>	<b>System Name</b>	<b>ID#</b>	<b>Month(s)</b>
			November
			December
Boone	Blue Acres MHP	MO2041563	August
			September
			October
			November
			December
Camden	Alhonna Resort	MO3190682	March
			July
			October
			November
	Backwater Jacks Bar & Grill	MO3212294	April
			May
			June
			October
	Bambooze Bar And Grill	MO5212617	March
			July
			September
			November
	Donnas Ice House	MO5212747	April
			May
			June
			August
	Knoockers	MO3282315	March
			April
			May
			June
			July
	Little Willies Cafe	MO3212614	January
			April
			May
			June
			July
			August
			September
	Mariners Pier 31 Yacht Club	MO3212445	May
			June
			July
			September
Christian	Cowboy Corral	MO5291585	January

**Appendix B**  
**I. Chronic Major Monitoring Violations**

County	System Name	ID#	Month(s)
			February
			July
Franklin	Charmwood Subdivision	MO6030106	January
			February
			March
			April
			May
			June
			July
			August
			September
			October
			November
	Delta Motel	MO6191037	June
			July
			September
			November
			December
	Native Experience Campground	MO6240129	April
			May
			June
			August
			September
			October
Greene	Cody's #22	MO5258072	August
			September
			October
			November
			December
	Compass Plaza	MO5292838	April
			May
			June
			October
	Dalmas Feed Bunk Cafe	MO5282587	February
			June
			October
			November
			December
	Strafford Sports Complex	MO5218058	May
			July

**Appendix B**  
**I. Chronic Major Monitoring Violations**

County	System Name	ID#	Month(s)
			September
Hickory	Nemo Bridge Resort	MO5192686	April
			May
			June
			July
Jasper	Downhome Bar & Grill	MO5212510	January
			April
			May
			June
			August
			September
			November
			December
	Royal Oaks Arena	MO5218143	February
			July
			August
			December
Johnson	Hazel Hill MHP	MO1041466	January
			March
			April
			May
Lawrence	Baumers Food Mart	MO5292361	September
			October
			November
			December
	Hungry House Cafe	MO5212682	March
			September
			October
			December
	Youngberg Estates MHP	MO5041314	January
			February
			March
			April
			May
			June
			July
Maries	Morelands Restaurant And Lounge	MO3211025	February
			July
			November
			December

**Appendix B**

**I. Chronic Major Monitoring Violations**

County	System Name	ID#	Month(s)			
Mcdonald	Dass Liquor	MO5292748	July			
			August			
			September			
			October			
			November			
			December			
Miller	Pizza Hut Of Lake Ozark 023458	MO3212450	June			
			July			
			September			
			October			
			November			
			December			
	Sunset MHP	MO5031430	May			
			November			
			December			
	Village Marina	MO3231730	January			
			February			
			May			
Mississippi	Merryweather Meadows	MO4048066	June			
			October			
			November			
Morgan	Frogs	MO3212300	May			
			June			
			July			
			August			
				Painted Pony	MO3211305	April
						May
October						
	Smoked On The Water	MO3212568	April			
			May			
			June			
			August			
				Three Pigs Bar B Q And Grill	MO3212457	June
July						
September						
October						
	Uncle Sams Ice Cream & Deli	MO3212560	May			
			June			
			July			
			August			

## Appendix B

### I. Chronic Major Monitoring Violations

County	System Name	ID#	Month(s)
			September
Newton	Loves Travel Stop #282	MO5292463	April
			July
			November
			December
	Rapid Roberts #122	MO5218063	September
			October
			December
Polk	Cases Corner Llc	MO5258125	January
			June
			July
			August
			September
			November
Pulaski	The Point Steakhouse	MO3211505	February
			July
			November
	Old Plantation Motel	MO5212121	February
			March
			June
			November
St Louis	Concord Village Youth Sports Complex	MO6201026	April
			May
			June
			July
			August
Stone	Cape Fair Mobile Home Park	MO5241195	July
			August
			September
	Cross Roads Store	MO5292589	August
			November
			December
	Pizza World	MO5258136	July
			August
			October
	Show Me Shores	MO5262776	June
			September
			October
	Starlight Village	MO5030473	January
			February

**Appendix B**

**I. Chronic Major Monitoring Violations**

<b>County</b>	<b>System Name</b>	<b>ID#</b>	<b>Month(s)</b>
			March
			April
			May
			June
			July
			August
			September
			October
			November
			December
	Starrlite Village 4th Addition	MO5258070	January
			February
			May
			July
			December
	Stormy Point Cmpgrnd & Resort	MO5240128	April
			May
			June
			July
			August
			September
			October
Taney	Branson Log Homes	MO5282768	February
			June
			September
			October
			November
			December
	Parkview Lodge	MO5191005	May
			July
			August
Washington	Ozark Freeze Restaurant	MO4212819	March
			April
			July
			December
Webster	Country Quik Stop Inc	MO5292475	July
			August
			September
			October

## Appendix B

### I. Chronic Major Monitoring Violations

County	System Name	ID#	Month(s)
	Tinys Steak Ranch Inc	MO5210234	August
			September
			October
			November
			December

## Appendix C

### 1. Major Repeat Monitoring Violations

The following systems had major repeat monitoring violations for the months listed. A major repeat monitoring violation occurs when a routine sample tests positive for total coliform bacteria and that system fails to submit any follow-up, or repeat, samples as required.

County	ID#	System Name	Month(s)
Barry	MO5031105	Needles Eye Beach	August
	MO5071306	Dell Apartments	January
Camden	MO3211098	54 Diner	December
	MO3212540	Possum Holler	July
	MO5031533	Green Acres Mobile Home Park	July
Cape	MO4030275	Country Village Estates Subdivision	December
Greene	MO5258164	Crossroads Convenience Store	December
Jackson	MO1010320	Grain Valley	July
Jasper	MO5218143	Royal Oaks Arena	June
Jefferson	MO6048200	A & H Country Estates Inc	August
	MO6202305	Deer Creek Golf Club	August
Laclede	MO5212472	Elson Inc Db a Midway Restaurant	December
Lawrence	MO5010641	Pierce City	September
Lincoln	MO6282339	Knights Of Columbus-troy	May
	MO6291625	Castles Grocery And Cafe	December
Montgomery	MO3281053	Loutre Shore Country Club	April
Morgan	MO3218211	The Dummy Restaurant And Bar	September
Newton	MO5010678	Redings Mill	November
	MO5048269	Quail Meadows MHP	September
	MO5170238	Jesus Name Pentacostal Church	November
	MO5211145	Undercliff	June
Nodaway	MO1010173	Clearmont	October
Ozark	MO5030209	Sundown Village Of	January
	MO5202448	Theodosia Country Club	July
Pettis	MO3190893	Budget Host Super 7 Motel	July
St Charles	MO6202782	Broemmelsiek Park	September
St Clair	MO5212121	Old Plantation Motel	September

## Appendix C

### 1. Major Repeat Monitoring Violations

The following systems had major repeat monitoring violations for the months listed. A major repeat monitoring violation occurs when a routine sample tests positive for total coliform bacteria and that system fails to submit any follow-up, or repeat, samples as required.

	MO5212121	Old Plantation Motel	April
St Francois	MO4210857	Shamrock Rest & Lounge	June
Stone	MO5210593	Colonial Mountain Inn	September
	MO5282512	Kimberling Area Senior Center	September
Taney	MO5191757	Lake Shore Resort	October

## Appendix D

### Significant Non-Compliers

The following systems have been deemed Significant Non-Compliers for 2007. These are the systems with serious violations that potentially affect public health or with multiple monitoring violations.

County	ID#	System Name	Regulation(s) Violated
Barry	MO5031340	Sweetwater Beach Subd	Consumer Confidence Report
Barry	MO5071306	Dell Apartments	Total Coliform Rule
Barry	MO5212453	Country Diner	Total Coliform Rule
Bates	MO1024031	Bates Co PWSD #2	Stage 1 DBP Rule
Benton	MO1041486	Grateful Valley MHP & Rv Camp	Lead and Copper Rule
Benton	MO1212779	Valley Bar And Grill	Total Coliform Rule
Benton	MO3031366	Sun Valley Subdivision	Consumer Confidence Report
Benton	MO3031366	Sun Valley Subdivision	Total Coliform Rule
Benton	MO3262156	Hidden Valley MHP	Consumer Confidence Report
Boone	MO2041563	Blue Acres MHP	Lead and Copper Rule
Boone	MO3036153	Bon Gor Lake Estates	Consumer Confidence Report
Butler	MO4040680	Whites Trailer Court	Consumer Confidence Report
Callaway	MO2041558	Seges Mobile Home Park	Lead and Copper Rule
Camden	MO3024090	Camden Co PWSD #1	Consumer Confidence Report
Camden	MO3031133	Arrow Ridge Shores	Consumer Confidence Report
Camden	MO3041122	Country Meadows Estates	Consumer Confidence Report
Camden	MO3048141	Southway Terrace MHP	Consumer Confidence Report
Camden	MO3212614	Little Willies Cafe	Total Coliform Rule
Camden	MO3218004	Paradise Restaurant	Chemical Monitoring, Nitrates
Camden	MO3301348	Windgate On The Lake Condos	Lead and Copper Rule
Camden	MO5021546	Timberlake Terrace	Lead and Copper Rule
Camden	MO5212764	Its Twelve O'clock Somewhere	Total Coliform Rule
Cape Girardeau	MO4010211	Delta	Consumer Confidence Report
Cape Girardeau	MO4036038	Brandco Utilities	Consumer Confidence Report

**Appendix D**  
**Significant Non-Compliers**

<b>County</b>	<b>ID#</b>	<b>System Name</b>	<b>Regulation(s) Violated</b>
Cape Girardeau	MO4048083	Parkwood Lake Estates	Consumer Confidence Report
Cass	MO1010225	Drexel	Stage 1 DBP Rule
Cass	MO1010225	Drexel	Surface Water Treatment Rule
Cass	MO1010301	Garden City	Stage 1 DBP Rule
Cass	MO1010649	Pleasant Hill	Consumer Confidence Report
Christian	MO5036054	Sunset Heights 2nd Addition	Consumer Confidence Report
Clay	MO1024147	Clay Co PWSD #7	Consumer Confidence Report
Cooper	MO3020007	Cooper County PWSD #3	Consumer Confidence Report
Daviess	MO1036130	Daviess Co PWSD #3	Stage 1 DBP Rule
Dekalb	MO1010510	Maysville	Stage 1 DBP Rule
Dent	MO4048230	Teris Country Homes	Consumer Confidence Report
Franklin	MO6010708	St Clair	Consumer Confidence Report
Franklin	MO6030106	Charmwood Subdivision	Total Coliform Rule
Franklin	MO6048106	Circle C Mobile Home Park	Consumer Confidence Report
Franklin	MO6240129	Native Experience Campground	Total Coliform Rule
Gasconade	MO6010302	Gasconade	Consumer Confidence Report
Gentry	MO1070639	Middle Fork Water Co	Stage 1 DBP Rule
Greene	MO5048082	Acres Of Shade MHP	Consumer Confidence Report
Greene	MO5182849	Jm & N Investments	Lead and Copper Rule
Greene	MO5258164	Crossroads Convenience Store	Total Coliform Rule
Grundy	MO2010753	Spickard	Consumer Confidence Report
Harrison	MO1024242	Harrison Co PWSD #2	Stage 1 DBP Rule
Hickory	MO5192686	Nemo Bridge Resort	Total Coliform Rule
Hickory	MO5208303	Whiteside Hidden Acres	Consumer Confidence Report
Howell	MO4024264	Howell Co PWSD #1	Consumer Confidence Report
Iron	MO4010402	Ironton	Interim Enhanced Surface Wtr Trtment
Jasper	MO5010606	Oronogo	Consumer Confidence Report
Jasper	MO5212510	Downhome Bar & Grill	Total Coliform Rule
Jasper	MO5218143	Royal Oaks Arena	Total Coliform Rule
Jasper	MO5292829	Star Pump And Pantry	Total Coliform Rule
Jefferson	MO6036161	Fairways Water And Sewer Association	Consumer Confidence Report
Jefferson	MO6048052	Sycamore Green Acres MHP	Consumer Confidence Report
Jefferson	MO6048142	D & J MHP	Consumer Confidence Report
Johnson	MO1041466	Hazel Hill MHP	Total Coliform Rule
Lafayette	MO1010846	Wellington	Consumer Confidence Report
Lawrence	MO5041314	Youngberg Estates MHP	Consumer Confidence Report
Lawrence	MO5041314	Youngberg Estates MHP	Total Coliform Rule

**Appendix D**  
**Significant Non-Compliers**

<b>County</b>	<b>ID#</b>	<b>System Name</b>	<b>Regulation(s) Violated</b>
Lawrence	MO5292361	Baumers Food Mart	Total Coliform Rule
Lawrence	MO5292588	Kcs Enterprises Inc	Total Coliform Rule
Lewis	MO2010440	Lagrange	Consumer Confidence Report
Lincoln	MO6010902	Silex	Consumer Confidence Report
Lincoln	MO6041229	Autumn Hills MHP	Radionuclide Rule
Linn	MO2010112	Bucklin	Stage 1 DBP Rule
Madison	MO4010501	Marquand	Consumer Confidence Report
Mcdonald	MO5292748	Dass Liquor	Total Coliform Rule
Mercer	MO2010750	South Lineville Water Association	Consumer Confidence Report
Miller	MO3202344	Eagle Lanes	Chemical Monitoring, Nitrates
Miller	MO3212450	Pizza Hut Of Lake Ozark 023458	Total Coliform Rule
Miller	MO3231548	Lake Village Subd Well Owners Assn	Total Coliform Rule
Miller	MO5031430	Sunset MHP	Consumer Confidence Report
Moniteau	MO3024395	Moniteau Co PWSD #1	Consumer Confidence Report
Moniteau	MO3036043	Hickory Hills Water & Sewer	Consumer Confidence Report
Montgomery	MO3281053	Loutre Shore Country Club	Total Coliform Rule
Montgomery	MO6010848	Wellsville	Stage 1 DBP Rule
Morgan	MO3250819	Cool Valley Association	Lead and Copper Rule
Morgan	MO5031454	Bendco Cove	Total Coliform Rule
Morgan	MO5041552	Shady Acres	Lead and Copper Rule
New Madrid	MO4024418	New Madrid Co PWSD #4	Consumer Confidence Report
Newton	MO5010217	Diamond	Consumer Confidence Report
Newton	MO5048974	Tee Pee Reservation MHP	Total Coliform Rule
Newton	MO5048995	Park Place MHP Joplin	Consumer Confidence Report
Oregon	MO4024433	Oregon Co PWSD #2	Consumer Confidence Report
Ozark	MO5030209	Sundown Village Of	Consumer Confidence Report
Pemiscot	MO4010830	Wardell	Consumer Confidence Report
Pettis	MO3036105	Monsees Lake Estates	Consumer Confidence Report
Pettis	MO3048155	Missouri Utilities Co	Consumer Confidence Report
Pettis	MO3048254	Crestview MHP	Consumer Confidence Report
Pettis	MO3048289	Meadowlark Acres MHP	Consumer Confidence Report
Pettis	MO3069089	Stoney Ridge Village	Consumer Confidence Report
Phelps	MO3048123	Stately Mansion Mobile Villa	Consumer Confidence Report
Polk	MO5041146	Valley View Acres	Consumer Confidence Report
Polk	MO5048268	Brookside MHP	Consumer Confidence Report
Polk	MO5069073	Home Court Advantage	Chemical Monitoring, Nitrates
Polk	MO5069073	Home Court Advantage	Consumer Confidence Report
Polk	MO5258125	Cases Corner Llc	Total Coliform Rule
Saline	MO2024555	Saline Co PWSD #1	Consumer Confidence Report

**Appendix D**  
**Significant Non-Compliers**

<b>County</b>	<b>ID#</b>	<b>System Name</b>	<b>Regulation(s) Violated</b>
St Clair	MO5010020	Appleton City	Consumer Confidence Report
St Clair	MO5212121	Old Plantation Motel	Total Coliform Rule
St Francois	MO4010270	Farmington	Radionuclide Rule
Stoddard	MO4024583	Stoddard Co PWSD #3	Consumer Confidence Report
Stone	MO5030473	Starlight Village	Chemical Monitoring, Nitrates
Stone	MO5030473	Starlight Village	Consumer Confidence Report
Stone	MO5030473	Starlight Village	Total Coliform Rule
Stone	MO5031473	Honey Locust Ridge Subdivision	Consumer Confidence Report
Stone	MO5040355	Rocky Top Mobile Home Court	Consumer Confidence Report
Stone	MO5240128	Stormy Point Cmpgrnd & Resort	Total Coliform Rule
Stone	MO5241195	Cape Fair Mobile Home Park	Consumer Confidence Report
Stone	MO5258070	Starrlite Village 4th Addition	Consumer Confidence Report
Stone	MO5261253	Lakeview Acres Grocery MHP & Rv	Consumer Confidence Report
Sullivan	MO2010389	Humphreys	Consumer Confidence Report
Taney	MO5021379	Savannah Place Third Addition	Lead and Copper Rule
Taney	MO5282768	Oakmont Hills Pws	Total Coliform Rule
Washington	MO4041275	L & M Mobile Home Park	Consumer Confidence Report
Washington	MO6010659	Potosi	Radionuclide Rule
Wayne	MO4036040	Missionary Acres	Consumer Confidence Report
Webster	MO5010734	Seymour	Consumer Confidence Report
Wright	MO5218161	Mountain Grove Christian Academy	Lead and Copper Rule