

STATE OF MISSOURI  
DEPARTMENT OF NATURAL RESOURCES  
MISSOURI CLEAN WATER COMMISSION



## MISSOURI STATE OPERATING PERMIT

In compliance with the Missouri Clean Water Law, (Chapter 644 R.S. Mo. as amended, hereinafter, the Law), and the Federal Water Pollution Control Act (Public Law 92-500, 92<sup>nd</sup> Congress) as amended,

Permit No. MO-0126951

Owner: Monroe County PWSD #2  
Address: 23504 Highway 24, Paris, MO 65275

Continuing Authority: Same as above  
Address: Same as above

Facility Name: Monroe County PWSD #2, Holliday WWTF  
Facility Address: ¼ mile southeast of Highway A & Reid Street intersection, Holliday, MO 65258

Legal Description: SW ¼, SW ¼, SE ¼, Sec. 3, T54N, R11W, Monroe County  
UTM Coordinates: X=575302, Y=4371505

Receiving Stream: Unnamed tributary to Briar Creek (U)  
First Classified Stream and ID: Elk Fork Salt River (C) (00131)  
USGS Basin & Sub-watershed No.: (07110006-0307)

is authorized to discharge from the facility described herein, in accordance with the effluent limitations and monitoring requirements as set forth herein:

### FACILITY DESCRIPTION

Permitted Feature I #001 – POTW – Domestic Wastewater, No-discharge System – SIC #4952  
The use or operation of this facility shall be by or under the supervision of, at a minimum, a **Certified “D” Operator**.  
Three-cell lagoon / spray irrigation/land application/ sludge is retained in lagoon.  
Design population equivalent is 200.  
Design flow is 24,300 gallons per day (1-in-10-year design including net rainfall minus evaporation).  
Average design flow is 20,000 gallons per day (dry weather flows).  
Actual flow is 14,300 gallons per day.  
Design sludge production is 3.0 dry tons per year.

This permit authorizes only wastewater discharges under the Missouri Clean Water Law and the National Pollutant Discharge Elimination System; it does not apply to other regulated areas. This permit may be appealed in accordance with Section 644.051.6 of the Law.

June 12, 2013                      November 20, 2014  
Effective Date                      Modification Date

Sara Parker Pauley, Director, Department of Natural Resources

June 30, 2017  
Expiration Date

John Madras, Director, Water Protection Program

**FACILITY DESCRIPTION** (continued)

Permitted Feature #001 – Monroe County PWSD #2, Holliday WWTF

**Receiving Stream Watershed:** a gaining stream setting that flows into Briar Creek (an unclassified stream), which then flows into the Elk Form Salt River (C) (00131)

**Facility Type:**

No-discharge Storage and Irrigation System for annual flows into gaining stream

<b><u>Design Basis:</u></b>	<b><u>Avg Annual</u></b>
Design dry weather flows	20,000 gpd
Design with 1-in-10 year flows	24,300 gpd
Design PE	200

**Storage Basin/Tank:**

	<u>Cell #1</u>	<u>Cell #2</u>	<u>Cell #3</u>	<u>Total</u>
Freeboard for basin: two (2) feet				
Storage volume (min to max water levels, in gallons)	~1,450,000	~485,000	~250,000	~2,185,000

**Storage Capacity (in Days):**

Design for Dry weather Flows:	~109 days
Design with 1-in 10 year flows:	~90 days

Permitted Feature #002 – Land Application to Private Agricultural Land


Legal Description:	SW ¼, NW ¼, SE ¼ and NW ¼, SW ¼, SE ¼, Sec. 3, T54N, R11W, Monroe County
UTM Coordinates:	X= 575330, Y= 4371720 (approximate center of application field)
Receiving Stream:	Unnamed tributary to Briar Creek (U)
First Classified Stream and ID:	Elk Fork Salt River (C) (00131)
USGS Basin & Sub-watershed No.:	(07110006-0307)

**Land Application:**

Irrigation Volume/year:	~7,986,000 gallons at design loading (including 1-in-10 year flows)
Irrigation areas:	7.4 acres at design loading (8.2 acres total available)
Application rates:	0.1 inch/hour; 1.0 inch/day; 3.0 inches/week; 40.0 inches/year
Field slopes:	less than eight (8) percent
Equipment type:	fixed sprinklers
Vegetation:	hay grass
Application rate is based on:	hydraulic loading rate


LAGOON PROFILE

Cell #1

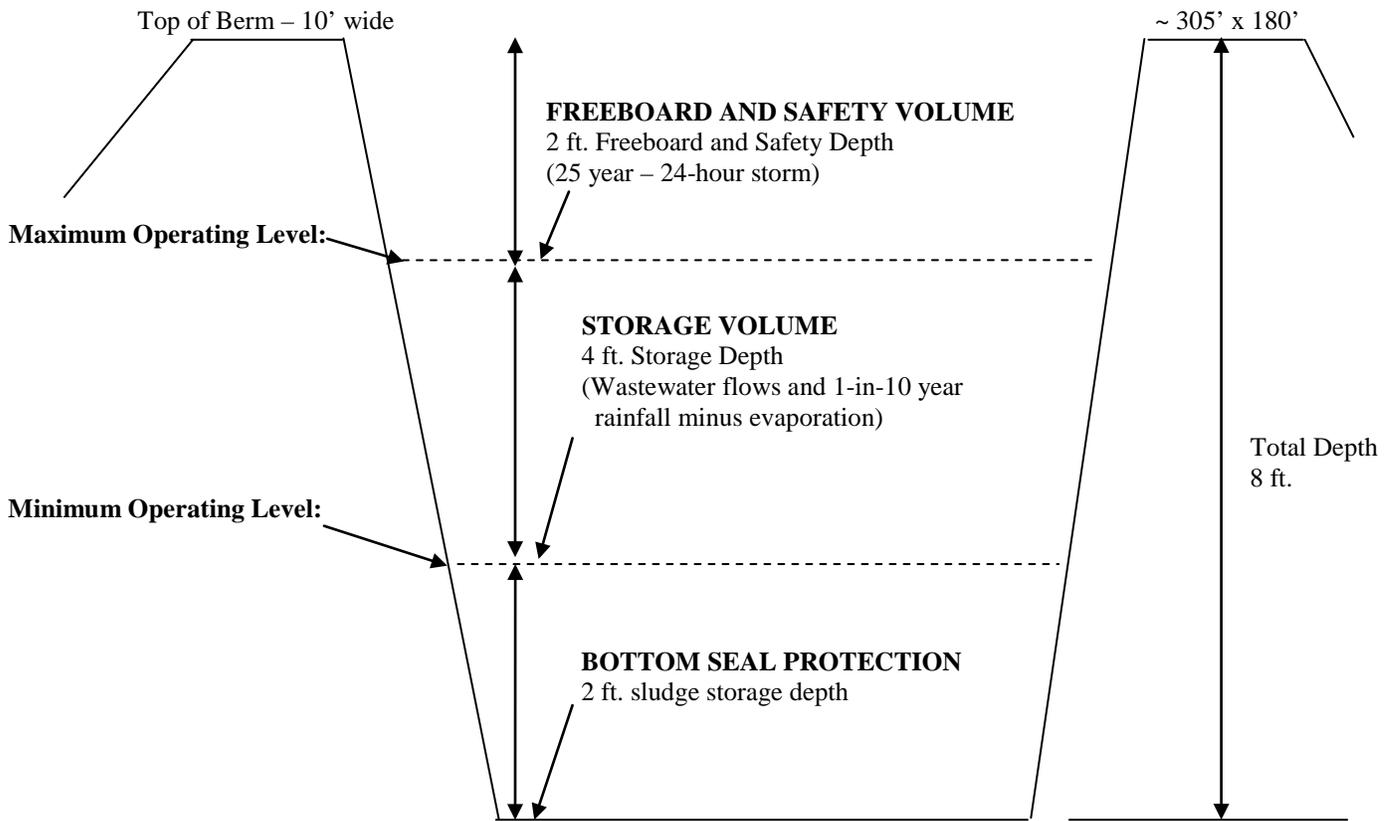


LAGOON PROFILE

Cell #2

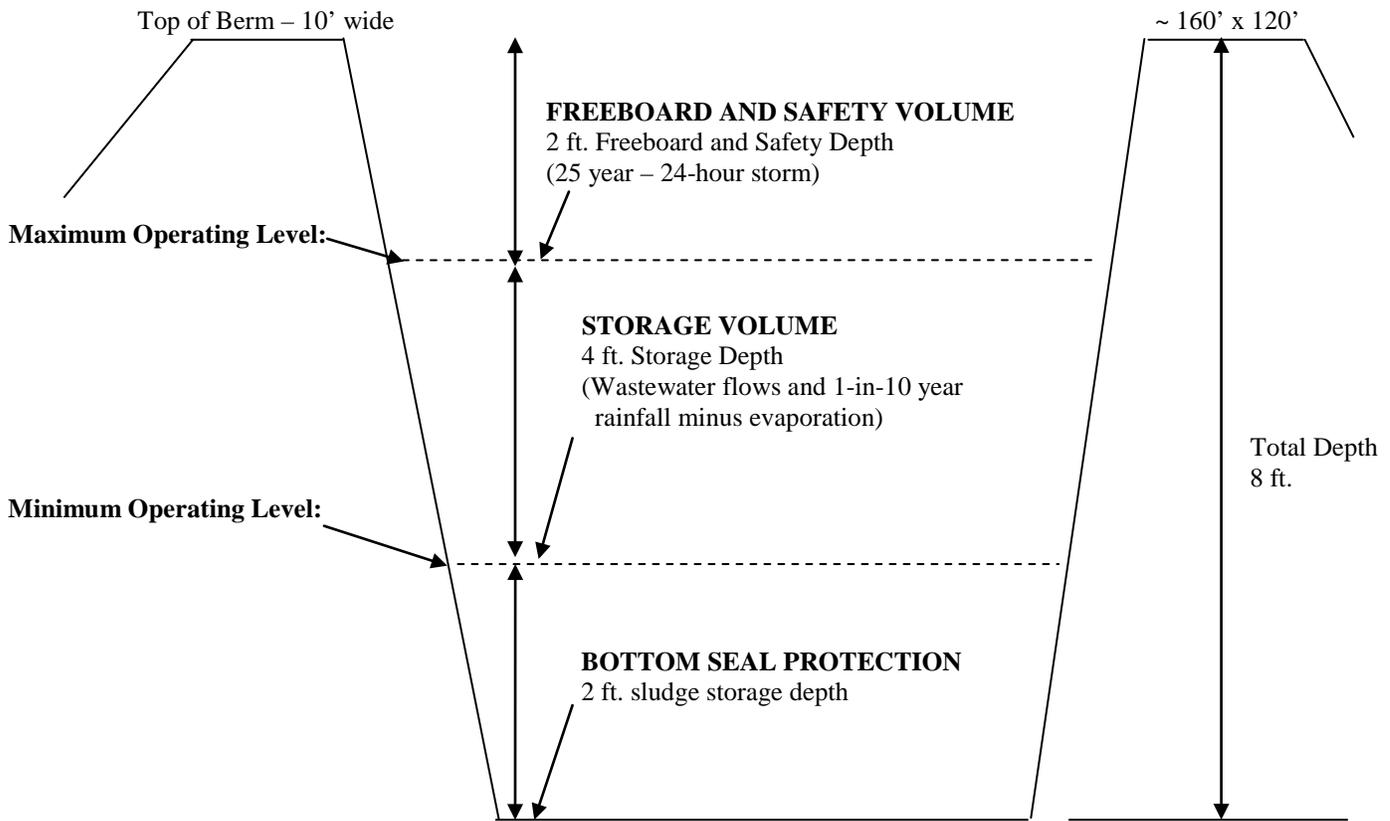

LAGOON PROFILE

Cell #3

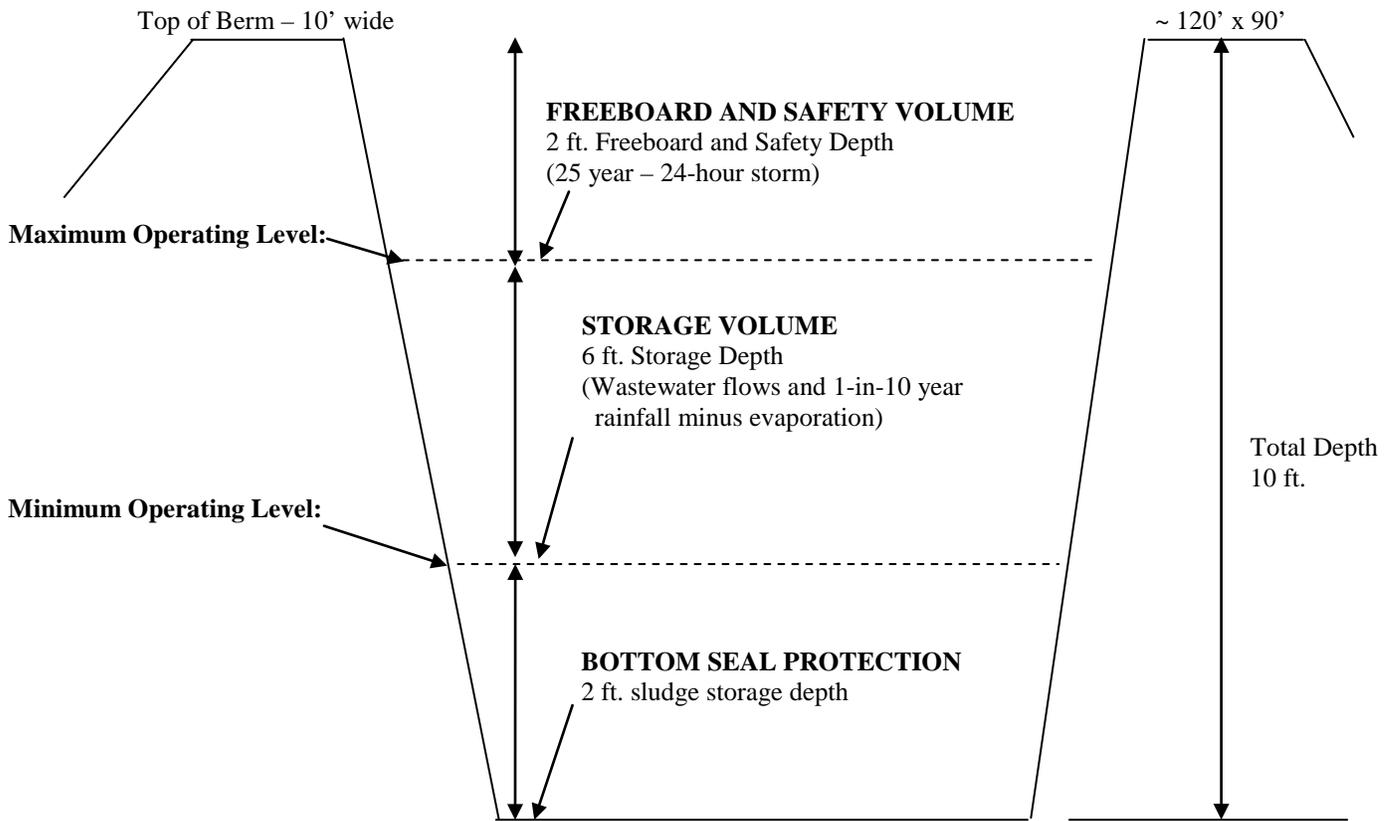

<b>A. IRRIGATED WASTEWATER LIMITATIONS AND MONITORING REQUIREMENTS</b>	PAGE NUMBER 6 of 11
	PERMIT NUMBER MO-0126951

The permittee is authorized to conduct land application of wastewater as specified in the application for this permit. The final limitations shall become effective upon issuance and remain in effect until expiration of the permit. The land application of wastewater shall be controlled, limited and monitored by the permittee as specified below:

OUTFALL NUMBER AND IRRIGATED WASTEWATER PARAMETER(S)	UNITS	FINAL LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
<u>Permitted Feature #001 – Storage Basin Operational Monitoring (Notes 1 &amp; 2)</u>						
Lagoon Freeboard (Note 3)	feet	*			once/month	measured
Rainfall	inches	*			daily	total

MONITORING REPORTS SHALL BE SUBMITTED ANNUALLY; THE FIRST REPORT IS DUE JANUARY 28, 2015.

<u>Permitted Feature #002 - Land Application Operational Monitoring (Note 2 and 4)</u>						
Irrigation Period	hours	*			daily	total
Volume Irrigated	gallons	*			daily	total
Application Area	acres	*			daily	total
Application Rate	inches	*			daily	total

MONITORING REPORTS SHALL BE SUBMITTED ANNUALLY; THE FIRST REPORT IS DUE JANUARY 28, 2015.

**B. STANDARD CONDITIONS**

IN ADDITION TO SPECIFIED CONDITIONS STATED HEREIN, THIS PERMIT IS SUBJECT TO THE ATTACHED Parts I, II & III STANDARD CONDITIONS DATED October 1, 1980 and August 15, 1994, AND HEREBY INCORPORATED AS THOUGH FULLY SET FORTH HEREIN.

**A. IRRIGATED WASTEWATER LIMITATIONS AND MONITORING REQUIREMENTS (continued)**

- \* Monitoring requirement only.
- \*\* See table below for quarterly sampling

Minimum Sampling Requirements			
Quarter	Months	Parameters	Report is Due
First	January, February, March	Sample at least once during any month of the quarter	April 28 <sup>th</sup>
Second	April, May, June	Sample at least once during any month of the quarter	July 28th
Third	July, August, September	Sample at least once during any month of the quarter	October 28th
Fourth	October, November, December	Sample at least once during any month of the quarter	January 28th

Note 1 - **No-discharge facility requirements.** Wastewater shall be stored and land applied during suitable conditions so that there is no discharge from the lagoon or irrigation site. An emergency discharge may occur when excess wastewater has accumulated above feasible irrigation rates due to precipitation exceeding the 1-in-10-year, 365-day rainfall or the 25-year, 24-hour storm event.

Note 2 - Records shall be maintained and summarized into an annual operating report, which shall be submitted by January 28th of each year for the previous calendar year period using report forms approved by the Department. The summarized annual report is in addition to the reporting requirements listed in Table A. The summarized annual report shall include the following:

- a. Record of maintenance and repairs performed during the year, average number of times per month the facility is checked to see if it is operating properly, and description of any unusual operating conditions encountered during the year;
- b. The number of days the lagoon has discharged during the year, the discharge flow, the reasons discharge occurred and effluent analysis performed; and
- c. A summary of the irrigation operations including freeboard at the start and end of the irrigation season, the number of days of irrigation for each month, the total gallons irrigated, the total acres used, crops grown, crop yields per acre, the application rate in inches per day and for the year, the monthly and annual precipitation received at the facility, and a summary of all testing results obtained throughout the year for wastewater and soils.

Note 3 - Lagoon freeboard shall be reported as lagoon water level in feet below the overflow level. See Special Conditions for Wastewater Irrigation System requirements.

Note 4 - Wastewater that is irrigated shall be sampled at the irrigation pump or wet well. If irrigation did not occur during the report period, report as "No Irrigation".

C. INFLUENT MONITORING REQUIREMENTS			
The facility is required to meet a removal efficiency of 65% or more. The monitoring requirements shall become effective upon issuance and remain in effect until expiration of the permit. To determine removal efficiencies, the influent wastewater shall be monitored by the permittee as specified below:			
SAMPLING LOCATION AND PARAMETER(S)	UNITS	MONITORING REQUIREMENTS	
		MEASUREMENT FREQUENCY	SAMPLE TYPE
<u>Influent</u>			
Biochemical Oxygen Demand <sub>5</sub>	mg/L	once/year**	grab
Total Suspended Solids	mg/L	once/year**	grab

MONITORING REPORTS SHALL BE SUBMITTED ANNUALLY; THE FIRST REPORT IS DUE JANUARY 28, 2015.

**C. INFLUENT MONITORING REQUIREMENTS (continued)**

- \*\* Sample the influent for the parameters listed in Table C only if an emergency discharge occurs during the sampling year (October 1st – September 30<sup>th</sup> of each year). If no discharge occurs during the sampling year, report no-discharge.

**D. SPECIAL CONDITIONS**

1. **Emergency Discharge.** An emergency discharge from wastewater storage structures may only occur if rainfall exceeds the 1 in 10 year (Data taken from the Missouri Climate Atlas) or the 24 hour, 25 year (Data taken from NRCS Urban Hydrology for Small Watersheds) rainfall events. **Discharge for any other reason shall constitute a permit violation and shall be reported in accordance with Standard Conditions, Part 1, Section B.2.b.** Monitoring shall take place once per day while discharging from the storage basin or from the land application fields. Test results are due on the 28<sup>th</sup> day of the month after the sampling of the discharge. Permittee shall monitor for the following constituents:

Constituent	Units
Flow	MGD
Biochemical Oxygen Demand <sub>5</sub>	mg/L
Total Suspended Solids	mg/l
Total Ammonia Nitrogen	mg/L
pH – Units	SU
Oil & Grease	mg/L

2. Permittee will cease discharge by connection to a facility with an area-wide management plan per 10 CSR 20-6.010(3)(B)1. or 2. within 90 days of notice of its availability. The permittee shall obtain department approval for closure or alternate use of the facility.
3. This permit may be reopened and modified, or alternatively revoked and reissued, to:
  - (a) Comply with any applicable effluent standard or limitation issued or approved under Sections 301(b)(2)(C) and (D), 304(b)(2), and 307(a) (2) of the Clean Water Act, if the effluent standard or limitation so issued or approved:
    - (1) contains different conditions or is otherwise more stringent than any effluent limitation in the permit; or
    - (2) controls any pollutant not limited in the permit.
  - (b) Incorporate new or modified effluent limitations or other conditions, if the result of a waste load allocation study, toxicity test or other information indicates changes are necessary to assure compliance with Missouri’s Water Quality Standards.
  - (c) Incorporate new or modified effluent limitations or other conditions if, as the result of a watershed analysis, a Total Maximum Daily Load (TMDL) limitation is developed for the receiving waters which are currently included in Missouri’s list of waters of the state not fully achieving the state’s water quality standards, also called the 303(d) list.

The permit as modified or reissued under this paragraph shall also contain any other requirements of the Clean Water Act then applicable.

4. **Water Quality Standards**
  - (a) Discharges to waters of the state shall not cause a violation of water quality standards rule under 10 CSR 20-7.031, including both specific and general criteria.
  - (b) General Criteria. The following general water quality criteria shall be applicable to all waters of the state at all times including mixing zones. No water contaminant, by itself or in combination with other substances, shall prevent the waters of the state from meeting the following conditions:
    - (1) Waters shall be free from substances in sufficient amounts to cause the formation of putrescent, unsightly or harmful bottom deposits or prevent full maintenance of beneficial uses;
    - (2) Waters shall be free from oil, scum and floating debris in sufficient amounts to be unsightly or prevent full maintenance of beneficial uses;
    - (3) Waters shall be free from substances in sufficient amounts to cause unsightly color or turbidity, offensive odor or prevent full maintenance of beneficial uses;
    - (4) Waters shall be free from substances or conditions in sufficient amounts to result in toxicity to human, animal or aquatic life;
    - (5) There shall be no significant human health hazard from incidental contact with the water;
    - (6) There shall be no acute toxicity to livestock or wildlife watering;
    - (7) Waters shall be free from physical, chemical or hydrologic changes that would impair the natural biological community;
    - (8) Waters shall be free from used tires, car bodies, appliances, demolition debris, used vehicles or equipment and solid waste as defined in Missouri’s Solid Waste Law, section 260.200, RSMo, except as the use of such materials is specifically permitted pursuant to section 260.200-260.247.

D. SPECIAL CONDITIONS (continued)

5. Sludge and Biosolids Use For Domestic Wastewater Treatment Facilities
  - (a) Permittee shall comply with the pollutant limitations, monitoring, reporting, and other requirements in accordance with the attached permit Standard Conditions.
  - (b) If sludge is not removed by a contract hauler, permittee is authorized to land apply biosolids. Permit Standard Conditions, Part III shall apply to the land application of biosolids. Permittee shall notify the department at least 180 days prior to the planned removal of biosolids. The department may require submittal of a biosolids management plan for department review and approval as determined appropriate on a case-by-case basis.
6. Lagoons and earthen basins shall have a liner that is designed, constructed, and maintained. If operating records indicate excessive percolation, the department may require corrective action as necessary to eliminate excess leakage.
7. Wastewater Irrigation System.
  - (a) Discharge Reporting. Any unauthorized discharge from the storage basin(s) or irrigation system shall be reported to the Department as soon as possible but always within 24 hours. Discharge is allowed only as described in the Facility Description and Effluent Limitations sections of this permit.
  - (b) Storage Basin Operating Levels - No-discharge Systems. The minimum and maximum operating water levels for the storage basin(s) shall be clearly marked. Each storage basin shall be operated so that the maximum water elevation does not exceed two feet below the Emergency Spillway except due to exceedances of the 1-in-10 year, 365-day or 25-year, 24-hour storm events according to National Weather Service data. Wastewater shall be land applied whenever feasible based on soil and weather conditions and permit requirements. Storage basin(s) shall be lowered to the minimum operating level prior to each winter by November 30.
  - (c) Emergency Spillway. Lagoons and earthen storage basins should have an emergency spillway to protect the structural integrity of earthen structures during operation at near full water levels and in the event of overflow conditions. The spillway shall be at least one foot below top of berm.
  - (d) General Irrigation Requirements. The wastewater irrigation system shall be operated so as to provide uniform distribution of irrigated wastewater over the entire irrigation site. A complete ground cover of vegetation shall be maintained on the irrigation site unless the system is approved for row crop irrigation. **Wastewater shall be land applied only during daylight hours.** The wastewater irrigation system shall be capable of irrigating the annual design flow during an application period of less than 100 days or 800 hours per year.
  - (e) Saturated/Frozen Conditions. There shall be no irrigation during ground frost, frozen, snow covered, or saturated soil conditions, or when precipitation is imminent or occurring.
  - (f) Buffer Zones. There shall be no irrigation within 300 feet of any down gradient pond, lake, sinkhole, losing stream or water supply withdrawal; 100 feet of gaining streams or tributaries; 150 feet of dwelling or public use areas; or 50 feet of the property line.
  - (g) Public Access Restrictions. Public access shall not be allowed to public use area irrigation sites when application is occurring.
  - (h) Irrigated Wastewater Disinfection. Wastewater shall be disinfected prior to land application (not storage) to public use areas.
  - (i) Nitrogen Loading Rates. Wastewater irrigation rates shall not exceed a nitrogen application rate of 150 pounds total nitrogen per acre per year, and the applied wastewater shall not exceed ten (10) mg/l of nitrate nitrogen as N. Hydraulic application rates exceeding 60 inches per acre per year shall calculate nitrogen loading rates and include results in the annual report. The calculation procedures are as follows:  $(\text{Total N}) \times (0.226) \times (\text{inches per acre irrigated}) = \text{pounds total N per acre}$ . Where  $\text{Total N} = [\text{Total Kjeldahl Nitrogen (TKN) as N}] + [\text{Nitrate Nitrogen as N}]$ . If the applied wastewater exceeds 150 pounds total nitrogen per acre/year, the permittee must reduce the application rates or submit a revised permit application to request use of the Plant Available Nitrogen (PAN) method based on crop nitrogen requirements for harvested crops, along with calculations to show the amount of plant-available nitrogen provided and the amount of nitrogen that will be utilized by the vegetation to be grown. PAN availability factors for surface application are:  $[\text{Ammonia N} \times 0.6] + [\text{Nitrate N} \times 0.9] + [\text{Organic N} \times 0.6] = \text{PAN}$ . If the applied wastewater exceeds ten (10) mg/l of nitrate nitrogen as N, then the facility shall submit a revised permit application to request use of the Plant Available Nitrogen (PAN) method based on crop nitrogen requirements for harvested crops, along with calculations to show the amount of plant-available nitrogen provided and the amount of nitrogen that will be utilized by the vegetation to be grown.
  - (j) Equipment Checks during Irrigation. The irrigation system and application site shall be visually inspected at least once/day during wastewater irrigation to check for equipment malfunctions and runoff from the irrigation site.
8. Land Application Sites. To add additional land application sites or convert any of the land to public use areas, a construction permit and permit modification may be required. The facility shall contact the Department for a written determination. Additionally, the O&M Manual shall be updated to include the additional land application site(s), and a copy of the updated sections of the O&M Manual shall be submitted to the Northeast Regional Office in accordance with Special Condition #15.

D. SPECIAL CONDITIONS (continued)

9. It is a violation of the Missouri Clean Water Law to fail to pay fees associated with this permit (644.055 RSMo).
10. The permittee shall comply with any applicable requirements listed in 10 CSR 20-9, unless the facility has received written notification that the Department has approved a modification to the requirements. The monitoring frequencies contained in this permit shall not be construed by the permittee as a modification of the monitoring frequencies listed in 10 CSR 20-9. If a modification of the monitoring frequencies listed in 10 CSR 20-9 is needed, the permittee shall submit a written request to the department for review and, if deemed necessary, approval.
11. The permittee shall develop and implement a program for maintenance and repair of the collection system. The permittee shall submit a report **annually in January** with the Discharge and Monitoring reports which address measures taken to locate and eliminate sources of infiltration and inflow into the collection system serving the facility.
12. Outfalls must be clearly marked in the field. The outfalls and land application fields shall also be marked on the aerial or topographic site map that is submitted with the permit application.
13. Bypasses are not authorized at this facility and are subject to 40 CFR 122.41(m). If a bypass occurs, the permittee shall report in accordance to 40 CFR 122.41(m)(3)(i), and with Standard Condition Part I, Section B, subsection 2.b. Bypasses are to be reported to the Northeast Regional Office. Any release from storage structures not associated with the designed land application system shall be reported as a bypass within 24 hours, whether or not the permittee believes such discharges reach waters of the state.
14. The permittee shall comply with the following requirements.
  - (a) The facility must be fenced sufficiently to restrict entry by children, livestock and unauthorized persons as well as to protect the facility from vandalism. The fence shall be a minimum of five feet (5') in height. Fences shall be located far enough back from all treatment processes to permit easy access for operation and maintenance and for access of mowing equipment, sludge trucks and similar equipment.
  - (b) A least one gate must be provided to access the lagoon system and provide for maintenance and mowing. The gate shall remain locked except when opened by the permittee to perform operational monitoring, sampling, maintenance, mowing, or for inspections by the Department.
  - (c) At least one (1) warning sign shall be placed on each side of the facility enclosure in such positions as to be clearly visible from all directions of approach. There shall also be one (1) sign placed for every five hundred feet (500') (150 m) of the perimeter fence. A sign shall also be placed on each gate. Minimum wording shall be SEWAGE TREATMENT FACILITY—KEEP OUT. Signs shall be made of durable materials with characters at least two inches (2") high and shall be securely fastened to the fence, equipment or other suitable locations.
  - (d) The inner and outer slopes of the lagoon berms shall not be steeper than three to one (3:1). Inner berm slopes shall not be flatter than four to one (4:1). Consideration may be given to steeper inner slopes provided special attention is given to stabilizing the slope with rip-rap, concrete, or other rigid materials.
  - (e) The berms of storage basins shall be mowed and kept free of any deep-rooted vegetation, animal dens, or other potential sources of damage to the berms.
  - (f) An all-weather access road shall be provided from a public right-of-way to the treatment facility. Sufficient room shall be provided at the site to permit turning vehicles around. Gravel roads to be used by heavy vehicles shall have a minimum depth of six inches (6") of crushed rock material with a bottom layer of four inches (4") of two to three inch (2–3") size material and a top layer two inches (2") thick of three-fourths inch (3/4") size material. In general, the grade of the access road shall not exceed twelve percent (12%).
  - (g) A minimum of two (2) feet of freeboard must be maintained in the lagoon cells.
  - (h) The facility shall ensure that adequate provisions are provided to prevent surface water intrusion into the lagoon and to divert stormwater runoff around the lagoon and protect embankments from erosion.
15. The permittee shall develop, maintain and implement an Operation and Maintenance (O&M) Manual that includes all necessary items to ensure the operation and integrity of the waste handling and land application systems, including key operating procedures, an aerial or topographic site map with the permitted features, land application fields, and irrigation buffer zones marked, and a brief summary of the operation of the facility. The O & M manual shall be made available to the operator. The O&M Manual shall be reviewed and updated at least every five years.

PERMIT TRANSFER

This permit may be transferred to a new owner by submitting an “Application for Transfer of Operating Permit” signed by the seller and buyer of the facility, along with the appropriate modification fee.

PERMIT RENEWAL REQUIREMENTS

Unless this permit is terminated, the permittee shall submit an application for the renewal of this permit no later than six (6) months prior to the permit’s expiration date. Failure to apply for renewal may result in termination of this permit and enforcement action to compel compliance with this condition and the Missouri Clean Water Law.

TERMINATION

In order to terminate this permit, the permittee shall notify the department by submitting Form J, included with the State Operating Permit. The permittee shall complete Form J and mail it to the department at the address noted in the cover letter of this permit. Proper closure of any storage structure is required prior to permit termination. A closure plan shall be submitted to the department and approved prior to initiating closure activities.

DUTY OF COMPLIANCE

The permittee shall comply with all conditions of this permit. Any noncompliance with this permit constitutes a violation of Chapter 644, Missouri Clean Water Law, and 10 CSR 20-6. Noncompliance may result in enforcement action, termination of this authorization, or denial of the permittee's request for renewal. This permit authorizes only the activities described in this permit.



**MISSOURI DEPARTMENT OF NATURAL RESOURCES  
 FACT SHEET  
 FOR THE PURPOSE OF MODIFICATION OF  
 MO-0126951  
 MONROE COUNTY PWSD #2, HOLLIDAY WWTF**

The Federal Water Pollution Control Act ("Clean Water Act" Section 402 Public Law 92-500 as amended) established the National Pollution Discharge Elimination System (NPDES) permit program. This program regulates the discharge of pollutants from point sources into the waters of the United States, and the release of storm water from certain point sources. All such discharges are unlawful without a permit (Section 301 of the "Clean Water Act"). After a permit is obtained, a discharge not in compliance with all permit terms and conditions is unlawful. Missouri State Operating Permits (MSOPs) are issued by the Director of the Missouri Department of Natural Resources (Department) under an approved program, operating in accordance with federal and state laws (Federal "Clean Water Act" and "Missouri Clean Water Law" Section 644 as amended). MSOPs are issued for a period of five (5) years unless otherwise specified.

As per [40 CFR Part 124.8(a)] and [10 CSR 20-6.020(1)2.] a Factsheet shall be prepared to give pertinent information regarding the applicable regulations, rationale for the development of effluent limitations and conditions, and the public participation process for the Missouri State Operating Permit (operating permit) listed below.

A Factsheet is not an enforceable part of an operating permit.

This Factsheet is for a Major , Minor , Industrial Facility ; Variance ; Master General Permit ; General Permit Covered Facility ; and/or permit with widespread public interest .

**Part I – Facility Information**

Facility Type: POTW  
 Facility SIC Code(s): 4952

**Facility Description:**

A three-cell lagoon with land application to an approximately eight-acre field. Sludge is retained in the lagoon.

Have any changes occurred at this facility or in the receiving water body that effects effluent limit derivation?

- Yes. This facility is being converted to a no-discharge, land application facility.

Application Date: October 17, 2011  
 Expiration Date: June 5, 2013  
 Last Inspection: March 3, 2008 Non-Compliance

The department conducted a routine compliance inspection of the facility on March 3, 2008. The facility was found to be in non-compliance at the time of inspection due to failing to collect and submit influent monitoring data and failing to carry out operational monitoring. No water quality violations were discovered during the inspection. No effluent reporting violations were observed.

**OUTFALL(S) TABLE:**

PERMITTED FEATURE	DESIGN FLOW (GPD)	TREATMENT LEVEL	EFFLUENT TYPE	DISTANCE TO CLASSIFIED SEGMENT (MI)
#001	20,000	No discharge	Municipal / Domestic	~ 4.6
#002	N/A	Land Application	Municipal / Domestic	~ 4.6

Permitted Feature #001 – Irrigation pump house at old outfall, for emergency discharges only

Legal Description: SW ¼, SW ¼, SE ¼, Sec. 3, T54N, R11W, Monroe County

UTM Coordinates: X= 575302.811, Y= 4371505.242

Receiving Stream: Unnamed tributary to Briar Creek (U)

First Classified Stream and ID: Elk Fork Salt River (C) (00131)

USGS Basin & Sub-watershed No.: (07110006-0307)

Permitted Feature #002 – land application field

Legal Description: SW ¼, NW ¼, SE ¼ and NW ¼, SW ¼, SE ¼, Sec. 3, T54N, R11W, Monroe County

UTM Coordinates: X= 575330, Y= 4371720

Receiving Stream: Unnamed tributary to Briar Creek (U)

First Classified Stream and ID: Elk Fork Salt River (C) (00131)

USGS Basin & Sub-watershed No.: (07110006-0307)

Receiving Water Body's Water Quality & Facility Performance History:

This facility is being converted to a no-discharge, land application system. The discharge is being eliminated.

A stream survey for this facility was most recently conducted by department staff on September 13, 2011. The inspector found no impact to the stream's beneficial uses.

Letters of Warning were most recently sent on August 23 and July 20, 2011, as well as on December 17, 2010, for effluent limit violations. In addition, a letter was sent on October 7, 2009, reminding the district to submit the infiltration and inflow report required by Special Condition #9; in the attached draft permit, this is now condition #13.

On January 30, 2007, a Municipal Sanitary Sewer Overflow Compliance Survey Visit was conducted for the Village of Rush Hill. A report was sent to the district on February 15, 2007.

Modification Rational:

This facility is being converted to a no-discharge, land application facility by adding a pump station, forcemain, and fixed sprinkler heads.

**Part IIA – Operator Certification Requirements**

As per [10 CSR 20-6.010(8) Terms and Conditions of a Permit], permittees shall operate and maintain facilities to comply with the Missouri Clean Water Law and applicable permit conditions and regulations. Operators or supervisors of operations at regulated wastewater treatment facilities shall be certified in accordance with [10 CSR 20-9.020(2)] and any other applicable state law or regulation. As per [10 CSR 20-9.010(2)(A)], requirements for operation by certified personnel shall apply to all wastewater treatment systems, if applicable, as listed below:

- Owned or operated by or for:
  - Public Water Supply Districts:

Each of the above entities are only applicable if they have a Population Equivalent greater than two hundred (200) and/or fifty (50) or more service connections.

This facility currently requires an operator with a D Certification Level. Please see **Appendix #1 - Classification Worksheet**. Modifications made to the wastewater treatment facility may cause the classification to be modified.

Operator's Name: Roger W. Shatzer      Certification Number: 4919      Certification Level: D

The listing of the operator above only signifies that staff drafting this operating permit have reviewed appropriate Department records and determined that the name listed on the operating permit application has the correct and applicable Certification Level.

**Part IIB– Operational Monitoring**

As per [10 CSR 20-9.010(4)], the facility is required to conduct operational monitoring.

**Part III – Receiving Stream Information**

**APPLICABLE DESIGNATIONS OF WATERS OF THE STATE:**

As per Missouri’s Effluent Regulations [10 CSR 20-7.015], the waters of the state are divided into the below listed seven (7) categories. Each category lists effluent limitations for specific parameters, which are presented in each outfall’s Effluent Limitation Table and further discussed in the Derivation & Discussion of Limits section.

- Missouri or Mississippi River [10 CSR 20-7.015(2)]:
- Lake or Reservoir [10 CSR 20-7.015(3)]:
- Losing [10 CSR 20-7.015(4)]:
- Metropolitan No-Discharge [10 CSR 20-7.015(5)]:
- Special Stream [10 CSR 20-7.015(6)]:
- Subsurface Water [10 CSR 20-7.015(7)]:
- All Other Waters [10 CSR 20-7.015(8)]:

10 CSR 20-7.031 Missouri Water Quality Standards, the Department defines the Clean Water Commission water quality objectives in terms of "water uses to be maintained and the criteria to protect those uses." The receiving stream and/or 1<sup>st</sup> classified receiving stream’s beneficial water uses to be maintained are located in the Receiving Stream Table located below in accordance with [10 CSR 20-7.031(3)].

**RECEIVING STREAM(S) TABLE:**

WATERBODY NAME	CLASS	WBID	DESIGNATED USES*	8-DIGIT HUC	EDU**
Unnamed tributary to Briar Creek	U	N/A	General Criteria	07110006	Central Plains/ Cuivre/ Salt
Elk Fork Salt River	C	00131	AQL, LWW, SCR, WBC(B)***		

\* - Irrigation (IRR), Livestock & Wildlife Watering (LWW), Protection of Warm Water Aquatic Life and Human Health-Fish Consumption (AQL), Cool Water Fishery(CLF), Cold Water Fishery (CDF), Whole Body Contact Recreation (WBC), Secondary Contact Recreation (SCR), Drinking Water Supply (DWS), Industrial (IND), Groundwater (GRW).

\*\* - Ecological Drainage Unit

\*\*\* - UAA conducted in July 2005 and in October 2007. No decision is listed as approving or disapproving these UAAs. See the following website: <http://dnr.mo.gov/env/wpp/wqstandards/uaa/pdf/0131-complete-uaa-07.pdf>.

Mixing Zone: Not Allowed [10 CSR 20-7.031(4)(A)4.B.(I)(a)].

Zone of Initial Dilution: Not Allowed [10 CSR 20-7.031(4)(A)4.B.(I)(b)].

**RECEIVING STREAM MONITORING REQUIREMENTS:**

No receiving water monitoring requirements recommended at this time.

**Part IV – Rationale and Derivation of Effluent Limitations & Permit Conditions**

**ALTERNATIVE EVALUATIONS FOR NEW FACILITIES:**

As per [10 CSR 20-7.015(4)(A)], discharges to losing streams shall be permitted only after other alternatives including land application, discharges to a gaining stream and connection to a regional wastewater treatment facility have been evaluated and determined to be unacceptable for environmental and/or economic reasons.

Not Applicable ; The facility does not discharge to a Losing Stream as defined by [10 CSR 20-2.010(36)] & [10 CSR 20-7.031(1)(N)], or is an existing facility.

**ANTI-BACKSLIDING:**

A provision in the Federal Regulations [CWA §303(d)(4); CWA §402(c); 40 CFR Part 122.44(I)] that requires a reissued permit to be as stringent as the previous permit with some exceptions.

- Limitations in this operating permit for the reissuance of this permit conform to the anti-backsliding provisions of Section 402(o) of the Clean Water Act, and 40 CFR Part 122.44. This facility is being converted to a no-discharge, land application facility. The discharge is being eliminated, therefore the effluent limits are being removed. Emergency discharges are still being monitored.

**ANTIDegradation:**

In accordance with Missouri's Water Quality Standard [10 CSR 20-7.031(2)], the Department is to document by means of Antidegradation Review that the use of a water body's available assimilative capacity is justified. Degradation is justified by documenting the socio-economic importance of a discharging activity after determining the necessity of the discharge.

- The discharge is being eliminated. No further review necessary.

**AREA-WIDE WASTE TREATMENT MANAGEMENT & CONTINUING AUTHORITY:**

As per [10 CSR 20-6.010(3)(B)], an applicant may utilize a lower preference continuing authority by submitting, as part of the application, a statement waiving preferential status from each existing higher preference authority, providing the waiver does not conflict with any area-wide management plan approved under section 208 of the Federal Clean Water Act or any other regional sewage service and treatment plan approved for higher preference authority by the Department.

**BIOSOLIDS, SLUDGE, & SEWAGE SLUDGE:**

Bio-solids are solid materials resulting from wastewater treatment that meet federal and state criteria for beneficial uses (i.e. fertilizer). Sludge is any solid, semi-solid, or liquid waste generated from a municipal, commercial, or industrial wastewater treatment plant, water supply treatment plant, or air pollution control facility or any other such waste having similar characteristics and effect. Sewage sludge is solids, semi-solids, or liquid residue generated during the treatment of domestic sewage in a treatment works; including but not limited to, domestic septage; scum or solids removed in primary, secondary, or advanced wastewater treatment process; and a material derived from sewage sludge. Sewage sludge does not include ash generated during the firing of sewage sludge in a sewage sludge incinerator or grit and screening generated during preliminary treatment of domestic sewage in a treatment works. Additional information regarding biosolids and sludge is located at the following web address: <http://dnr.mo.gov/env/wpp/pub/index.html>, items WQ422 through WQ449.

- Sludge/biosolids are removed by contract hauler or are stored in the lagoon.

**COMPLIANCE AND ENFORCEMENT:**

Enforcement is the action taken by the Water Protection Program (WPP) to bring an entity into compliance with the Missouri Clean Water Law, its implementing regulations, and/or any terms and conditions of an operating permit. The primary purpose of the enforcement activity in the WPP is to resolve violations and return the entity to compliance.

Not Applicable ; The permittee/facility is not currently under Water Protection Program enforcement action.

**PRETREATMENT PROGRAM:**

The reduction of the amount of pollutants, the elimination of pollutants, or the alteration of the nature of pollutant properties in wastewater prior to or in lieu of discharging or otherwise introducing such pollutants into a Publicly Owned Treatment Works [40 CFR Part 403.3(q)].

Not Applicable ; The permittee, at this time, is not required to have a Pretreatment Program or does not have an approved pretreatment program.

**REASONABLE POTENTIAL ANALYSIS (RPA):**

Federal regulation [40 CFR Part 122.44(d)(1)(i)] requires effluent limitations for all pollutants that are or may be discharged at a level that will cause or have the reasonable potential to cause or contribute to an in-stream excursion above narrative or numeric water quality standard.

Not Applicable ; A RPA was not conducted for this facility.

**REMOVAL EFFICIENCY:**

Removal efficiency is a method by which the Federal Regulations define Secondary Treatment and Equivalent to Secondary Treatment, which applies to Biochemical Oxygen Demand 5-day (BOD<sub>5</sub>) and Total Suspended Solids (TSS) for Publicly Owned Treatment Works (POTWs)/municipals. Please see the United States Environmental Protection Agency's (EPA) website for interpretation of percent removal requirements for National Pollutant Discharge Elimination System Permit Application Requirements for Publicly Owned Treatment Works and Other Treatment Works Treating Domestic Sewage @ [www.epa.gov/fedrgstr/EPA-WATER/1999/August/Day-04/w18866.htm](http://www.epa.gov/fedrgstr/EPA-WATER/1999/August/Day-04/w18866.htm).

Applicable ; Equivalent to Secondary Treatment is 65% removal [40 CFR Part 133.105(a)(3) & (b)(3)]; only when discharging.

**SANITARY SEWER OVERFLOWS (SSO) AND INFLOW AND INFILTRATION (I&I):**

Sanitary Sewer Overflows (SSOs) are defined as an untreated or partially treated sewage release are considered bypassing under state regulation [10 CSR 20-2.010(11)] and should not be confused with the federal definition of bypass. SSO's have a variety of causes including blockages, line breaks, and sewer defects that allow excess storm water and ground water to (1) enter and overload the collection system, and (2) overload the treatment facility. Additionally, SSO's can be also be caused by lapses in sewer system operation and maintenance, inadequate sewer design and construction, power failures, and vandalism. SSOs also include overflows out of manholes and onto city streets, sidewalks, and other terrestrial locations.

Additionally, Missouri RSMo §644.026.1 mandates that the Department require proper maintenance and operation of treatment facilities and sewer systems and proper disposal of residual waste from all such facilities.

- In accordance with Missouri RSMo §644.026.1.(15) and 40 CFR Part 122.41(e), the permittee is required to develop and/or implement a program for maintenance and repair of the collection system and shall be required in this operating permit by either means of a Special Condition or Schedule of Compliance. In addition, the Department considers the development of this program as an implementation of this condition. Additionally, 40 CFR Part 403.3(o) defines a POTW to include any device and systems used in the storage, treatment, recycling and reclamation of municipal sewage or industrial wastes of liquid nature. It also includes sewers, pipes, and other conveyances only if they convey wastewater to a POTW Treatment Plant.

At this time, the Department recommends the US EPA's Guide for Evaluating Capacity, Management, Operation and Maintenance (CMOM) Programs At Sanitary Sewer Collection Systems (Document # EPA 305-B-05-002). The CMOM identifies some of the criteria used by the EPA to evaluate a collection system's management, operation, and maintenance and was intended for use by the EPA, state, regulated community, and/or third party entities. The CMOM is applicable to small, medium, and large systems; both public and privately owned; and both regional and satellite collection systems. The CMOM does not substitute for the Clean Water Act, the Missouri Clean Water Law, and both federal and state regulations, as it is not a regulation.

**SCHEDULE OF COMPLIANCE (SOC):**

A schedule of remedial measures included in a permit, including an enforceable sequence of interim requirements (actions, operations, or milestone events) leading to compliance with the Missouri Clean Water Law, its implementing regulations, and/or the terms and conditions of an operating permit.

Not Applicable ; This permit does not contain a SOC.

**STORM WATER POLLUTION PREVENTION PLAN (SWPPP):**

In accordance with 40 CFR 122.44(k) *Best Management Practices (BMPs)* to control or abate the discharge of pollutants when:  
(1) Authorized under section 304(e) of the Clean Water Act (CWA) for the control of toxic pollutants and hazardous substances from ancillary industrial activities; (2) Authorized under section 402(p) of the CWA for the control of storm water discharges; (3) Numeric effluent limitations are infeasible; or (4) the practices are reasonably necessary to achieve effluent limitations and standards or to carry out the purposes and intent of the CWA.

Not Applicable ; At this time, the permittee is not required to develop and implement a SWPPP.

**VARIANCE:**

As per the Missouri Clean Water Law § 644.061.4, variances shall be granted for such period of time and under such terms and conditions as shall be specified by the commission in its order. The variance may be extended by affirmative action of the commission. In no event shall the variance be granted for a period of time greater than is reasonably necessary for complying with the Missouri Clean Water Law §§644.006 to 644.141 or any standard, rule or regulation promulgated pursuant to Missouri Clean Water Law §§644.006 to 644.141.

Not Applicable ; This operating permit is not drafted under premises of a petition for variance.

**WASTELOAD ALLOCATIONS (WLA) FOR LIMITS:**

As per [10 CSR 20-2.010(78)], the amount of pollutant each discharger is allowed by the Department to release into a given stream after the Department has determined total amount of pollutant that may be discharged into that stream without endangering its water quality.

Not Applicable ; Wasteload allocations were not calculated.

**WLA MODELING:**

There are two general types of effluent limitations, technology-based effluent limits (TBELs) and water quality based effluent limits (WQBELs). If TBELs do not provide adequate protection for the receiving waters, then WQBEL must be used.

Not Applicable ; A WLA study was either not submitted or determined not applicable by Department staff.

**WATER QUALITY STANDARDS:**

Per [10 CSR 20-7.031(3)], General Criteria shall be applicable to all waters of the state at all times including mixing zones. Additionally, [40 CFR 122.44(d)(1)] directs the Department to establish in each NPDES permit to include conditions to achieve water quality established under Section 303 of the Clean Water Act, including State narrative criteria for water quality.

**WHOLE EFFLUENT TOXICITY (WET) TEST:**

A WET test is a quantifiable method of determining if a discharge from a facility may be causing toxicity to aquatic life by itself, in combination with or through synergistic responses when mixed with receiving stream water.

Not Applicable ; At this time, the permittee is not required to conduct WET test for this facility.

**40 CFR 122.41(M) - BYPASSES:**

The federal Clean Water Act (CWA), Section 402 prohibits wastewater dischargers from “bypassing” untreated or partially treated sewage (wastewater) beyond the headworks. A bypass, is defined as an intentional diversion of waste streams from any portion of a treatment facility, [40 CFR 122.41(m)(1)(i)]. Additionally, Missouri regulation 10 CSR 20-2.010(11) defines a bypass as the diversion of wastewater from any portion of wastewater treatment facility or sewer system to waters of the state. Only under exceptional and specified limitations do the federal regulations allow for a facility to bypass some or all of the flow from its treatment process. Bypasses are prohibited by the CWA unless a permittee can meet all of the criteria listed in 40 CFR 122.41(m)(4)(i)(A), (B), & (C). Any bypasses from this facility are subject to the reporting required in 40 CFR 122.41(l)(6) and per Missouri’s Standard Conditions I, Section B, part 2.b. Additionally, Anticipated Bypasses include bypasses from peak flow basins or similar.

- Not Applicable, this facility does not bypass.

**303(d) LIST & TOTAL MAXIMUM DAILY LOAD (TMDL):**

Section 303(d) of the federal Clean Water Act requires that each state identify waters that are not meeting water quality standards and for which adequate water pollution controls have not been required. Water quality standards protect such beneficial uses of water as whole body contact (such as swimming), maintaining fish and other aquatic life, and providing drinking water for people, livestock and wildlife. The 303(d) list helps state and federal agencies keep track of waters that are impaired but not addressed by normal water pollution control programs.

A TMDL is a calculation of the maximum amount of a given pollutant that a body of water can absorb before its water quality is affected. If a water body is determined to be impaired as listed on the 303(d) list, then a watershed management plan will be developed that shall include the TMDL calculation

Not Applicable ; This facility does not discharge to a 303(d) listed stream.

**Part V – Effluent Limits Determination**

**Permitted Feature #001** – Main Facility Outfall for emergency discharges resulting from rainfall exceeding the 1-in-10-year, 365-day rainfall totals or a 25-year, 24-hour storm event.

**EFFLUENT LIMITATIONS TABLE:**

PARAMETER	UNIT	BASIS FOR LIMITS	DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MODIFIED	PREVIOUS PERMIT LIMITATIONS
<b><u>Storage Basin Operational Monitoring</u></b>							
Lagoon Freeboard	Feet	9	*			N/A	**
Rainfall	Inches	9	*			N/A	**
<b><u>Emergency Discharges</u></b>							
Flow	MGD	9	*			N/A	**
Biochemical Oxygen Demand <sub>5</sub> (effluent)	mg/L	9	*			N/A	**
Biochemical Oxygen Demand <sub>5</sub> (influent)	mg/L	9	*			N/A	**
Biochemical Oxygen Demand <sub>5</sub> (percent removal)	%	1	65			NO	S
Total Suspended Solids (effluent)	mg/L	9	*			N/A	**
Total Suspended Solids (influent)	mg/L	9	*			N/A	**
Total Suspended Solids (percent removal)	%	1	65			NO	S
pH	SU	9	*			N/A	**
Ammonia as N	mg/L	9	*			N/A	**
Oil & Grease (mg/L)	mg/L	9	*			N/A	**
MONITORING FREQUENCY	Please see Minimum Sampling and Reporting Frequency Requirements in the Derivation and Discussion Section below.						

- \* Monitoring requirement only.
- \*\* Parameter not previously established in previous state operating permit.
- N/A Not applicable
- S Same as previous operating permit

**Basis for Limitations Codes:**

- |  |                                    |
|--|------------------------------------|
| 1. State or Federal Regulation/Law       | 7. Antidegradation Policy          |
| 2. Water Quality Standard (includes RPA) | 8. Water Quality Model             |
| 3. Water Quality Based Effluent Limits   | 9. Best Professional Judgment      |
| 4. Lagoon Policy                         | 10. TMDL or Permit in lieu of TMDL |
| 5. Ammonia Policy                        | 11. WET Test Policy                |
| 6. Dissolved Oxygen Policy               | 12. Antidegradation Review         |

**Permitted Feature #001 – DERIVATION AND DISCUSSION OF LIMITS:**

- **Lagoon Freeboard and Rainfall.** Monitoring only. This is being required as a regulatory check to ensure the permittee is providing sufficient operations and maintenance. In addition, emergency discharges are considered violations unless extreme conditions are present, such as the chronic and catastrophic rain events. This information will assist the department in determining compliance.
- **Flow, Biochemical Oxygen Demand<sub>5</sub> (influent, effluent, and percent removal), Total Suspended Solids (influent, effluent, and percent removal), Total Ammonia Nitrogen, pH, Oil & Grease.** Monitoring only. This data is being required to monitor the effluent discharges during emergency discharge events. A discharge is considered a bypass and is a violation unless the discharge occurred as a result of excess wastewater accumulating above feasible irrigation rates due to precipitation exceeding the 1-in-10-year, 365-day rainfall or the 25 year, 24-hour storm event.
- **Minimum Sampling and Reporting Frequency Requirements.**

PARAMETER	SAMPLING FREQUENCY	REPORTING FREQUENCY
Lagoon Freeboard	once/month	annually in January
Rainfall	daily	annually in January
Flow	once per day	monthly †
Biochemical Oxygen Demand <sub>5</sub> (effluent)	once per day	monthly †
Biochemical Oxygen Demand <sub>5</sub> (influent)	once per day	monthly †
Biochemical Oxygen Demand <sub>5</sub> (percent removal)	once per year	annually †
Total Suspended Solids (effluent)	once per day	monthly †
Total Suspended Solids (influent)	once per day	monthly †
Total Suspended Solids (percent removal)	once per year	annually †
pH	once per day	monthly †
Ammonia as N	once per day	monthly †
Oil & Grease (mg/L)	once per day	monthly †

† Only if a discharge occurs.

**Permitted Feature #002 – Land application operational monitoring**

**EFFLUENT LIMITATIONS TABLE:**

PARAMETER	UNIT	BASIS FOR LIMITS	DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MODIFIED	PREVIOUS PERMIT LIMITATIONS
Irrigation Period	Hours	9	*			N/A	**
Volume Irrigated	Gallons	9	*			N/A	**
Application Area	Acres	9	*			N/A	**
Application Rate	Inches	9	*			N/A	**
MONITORING FREQUENCY	Please see Minimum Sampling and Reporting Frequency Requirements in the Derivation and Discussion Section below.						

- \* Monitoring requirement only.
- \*\* Parameter not previously established in previous state operating permit.
- N/A Not applicable
- S Same as previous operating permit

**Basis for Limitations Codes:**

- |  |                                    |
|--|------------------------------------|
| 1. State or Federal Regulation/Law       | 7. Antidegradation Policy          |
| 2. Water Quality Standard (includes RPA) | 8. Water Quality Model             |
| 3. Water Quality Based Effluent Limits   | 9. Best Professional Judgment      |
| 4. Lagoon Policy                         | 10. TMDL or Permit in lieu of TMDL |
| 5. Ammonia Policy                        | 11. WET Test Policy                |
| 6. Dissolved Oxygen Policy               | 12. Antidegradation Review         |

**PERMITTED FEATURE #002 – DERIVATION AND DISCUSSION OF LIMITS:**

- **Irrigation Period, Volume Irrigated, Application Area, Application Rate.** Monitoring only. This data is being required to monitor the irrigation at this facility. An emergency discharge is considered a bypass and is a violation unless the discharge occurred as a result of excess wastewater accumulating above feasible irrigation rates due to precipitation exceeding the 1-in-10-year, 365-day rainfall or the 25 year, 24-hour storm event.
- **Minimum Sampling and Reporting Frequency Requirements.**

PARAMETER	SAMPLING FREQUENCY	REPORTING FREQUENCY
Irrigation Period	daily	annually in January
Volume Irrigated	daily	annually in January
Application Area	daily	annually in January
Application Rate	daily	annually in January

**PART VI: Finding of Affordability**

Pursuant to Section 644.145, RSMo., the Department is required to determine whether a permit or decision is affordable and makes a finding of affordability for certain permitting and enforcement decisions. This requirement applies to discharges from combined or separate sanitary sewer systems or publically-owned treatment works.

Applicable; The Department is required to determine findings of affordability because the permit applies to a **combined or separate sanitary sewer system for a publically-owned treatment works.**

**Finding of affordability** - The department has made a reasonable search for empirical data indicating the permit is affordable. The search consisted of a review of department records that might contain economic data on the community, a review of information provided by the applicant as part of the application, and public comments received in response to public notices of this draft permit. If the empirical cost data was used by the permit writer, this data may consist of median household income, any other ongoing projects that the Department has knowledge, and other demographic financial information that the community provided as contemplated by Section 644. 145.3.

**The department is hereby making a finding based from the following facts:**

1. A Preliminary Engineering Report (sealed April 30, 2009) listed costs for each alternative and included a section on how the project could be financed.
2. The permit action is taken at the discretion of the system itself (e.g., in order to comply with a permit issued prior to July 11, 2011).
3. The department is not aware of any significant economic impacts this permit would cause on distressed populations.
4. No comments indicating such impact were received during the public comment period on the draft permit.
5. The department is not aware of any other more cost effective wastewater treatment options that would achieve the required effluent quality on a long-term basis.
6. The proposed project includes the elimination of the discharge and therefore the elimination of testing parameters unless an emergency discharge occurs. This is a reduction in requirements for the system.

Based on the above facts, it is assumed that the draft operating permit is affordable for the community.

**Part VII – Administrative Requirements**

Based on preliminary staff review and the application of applicable standards and regulations, the Department, as administrative agent for the Missouri Clean Water Commission, proposes to issue a permit(s) subject to certain effluent limitations, schedules, and special conditions contained herein and within the operating permit. The proposed determinations are tentative pending public comment.

**PUBLIC NOTICE:**

The Department shall give public notice that a draft permit has been prepared and its issuance is pending. Additionally, public notice will be issued if a public hearing is to be held because of a significant degree of interest in and water quality concerns related to a draft permit. No public notice is required when a request for a permit modification or termination is denied; however, the requester and permittee must be notified of the denial in writing.

The Department must issue public notice of a pending operating permit or of a new or reissued statewide general permit. The public comment period is the length of time not less than 30 days following the date of the public notice which interested persons may submit written comments about the proposed permit.

For persons wanting to submit comments regarding this proposed operating permit, then please refer to the Public Notice page located at the front of this draft operating permit. The Public Notice page gives direction on how and where to submit appropriate comments.

- The Public Notice period for this operating permit is tentatively scheduled to begin on January 6 to February 6, 2012.

**DATE OF FACT SHEET:** NOVEMBER 29, 2011

Submitted by

Scott Adams, E.I.  
Environmental Engineer  
Northeast Regional Office  
(660) 385-8000  
[scott.adams@dnr.mo.gov](mailto:scott.adams@dnr.mo.gov)

Reviewed by

Brant Farris  
Environmental Specialist  
Northeast Regional Office  
(660) 385-8000  
[brant.farris@dnr.mo.gov](mailto:brant.farris@dnr.mo.gov)

**UPDATED:** JANUARY 3, 2012

This permit was originally intended to be put on public notice on December 30, 2011. Due to threat of objection by the U.S. EPA, the language of certain special conditions had been changed prior to public notice. EPA had concerns about changes that had been made in the language protecting Missouri's Narrative Water Quality Standards. The change had been made in an attempt to accommodate recent changes in Missouri's Statutes. EPA found the new language deficient. This permit was therefore modified, pre-public notice, with the previous version of the Narrative Criteria protection. The public notice is now tentatively scheduled for January 6, 2012.

**FINALIZED:** 8/28/14, Todd Blanc

**Part VIII – Appendices**

**APPENDIX #1 - CLASSIFICATION WORKSHEET:**

ITEM	POINTS POSSIBLE	POINTS ASSIGNED
Maximum Population Equivalent (P.E.) served (Max 10 pts.)	1 pt./10,000 PE or major fraction thereof.	0
Maximum: 10 pt Design Flow (avg. day) or peak month; use greater (Max 10 pts.)	1 pt. / MGD or major fraction thereof.	0
<b>EFFLUENT DISCHARGE RECEIVING WATER SENSITIVITY:</b>		
Missouri or Mississippi River	0	
All other stream discharges except to losing streams and stream reaches supporting whole body contact	1	
Discharge to lake or reservoir outside of designated whole body contact recreational area	2	
Discharge to losing stream, or stream, lake or reservoir area supporting whole body contact recreation	3	3
<b>PRELIMINARY TREATMENT - Headworks</b>		
Screening and/or comminution	3	
Grit removal	3	
Plant pumping of main flow (lift station at the headworks)	3	
<b>PRIMARY TREATMENT</b>		
Primary clarifiers	5	
Combined sedimentation/digestion	5	
Chemical addition (except chlorine, enzymes)	4	
<b>REQUIRED LABORATORY CONTROL – performed by plant personnel (highest level only)</b>		
Push – button or visual methods for simple test such as pH, Settleable solids	3	
Additional procedures such as DO, COD, BOD, titrations, solids, volatile content	5	5
More advanced determinations such as BOD seeding procedures, fecal coliform, nutrients, total oils, phenols, etc.	7	
Highly sophisticated instrumentation, such as atomic absorption and gas chromatograph	10	
<b>ALTERNATIVE FATE OF EFFLUENT</b>		
Direct reuse or recycle of effluent	6	
Land Disposal – low rate	3	
High rate	5	5
Overland flow	4	
<b>Total from page ONE (1)</b>	----	13

**APPENDIX #1 - CLASSIFICATION WORKSHEET (CONTINUED):**

ITEM	POINTS POSSIBLE	POINTS ASSIGNED
<b>VARIATION IN RAW WASTE (highest level only) (DMR exceedances and Design Flow exceedances)</b>		
Variation do not exceed those normally or typically expected	0	
Recurring deviations or excessive variations of 100 to 200 % in strength and/or flow	2	
Recurring deviations or excessive variations of more than 200 % in strength and/or flow	4	
Raw wastes subject to toxic waste discharge	6	
<b>SECONDARY TREATMENT</b>		
Trickling filter and other fixed film media with secondary clarifiers	10	
Activated sludge with secondary clarifiers (including extended aeration and oxidation ditches)	15	
Stabilization ponds without aeration	5	5
Aerated lagoon	8	
Advanced Waste Treatment Polishing Pond	2	
Chemical/physical – without secondary	15	
Chemical/physical – following secondary	10	
Biological or chemical/biological	12	
Carbon regeneration	4	
<b>DISINFECTION</b>		
Chlorination or comparable	5	
Dechlorination	2	
On-site generation of disinfectant (except UV light)	5	
UV light	4	
<b>SOLIDS HANDLING - SLUDGE</b>		
Solids Handling Thickening	5	
Anaerobic digestion	10	
Aerobic digestion	6	
Evaporative sludge drying	2	
Mechanical dewatering	8	
Solids reduction (incineration, wet oxidation)	12	
Land application	6	
Total from page <b>TWO (2)</b>	----	5
Total from page <b>ONE (1)</b>	---	13
<b>Grand Total</b>	---	18

- A: 71 points and greater
- B: 51 points – 70 points
- C: 26 points – 50 points
- D: 0 points – 25 points

**STANDARD CONDITIONS FOR NPDES PERMITS  
ISSUED BY  
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES  
MISSOURI CLEAN WATER COMMISSION**

**Revised  
October 1, 1980**

**PART I - GENERAL CONDITIONS  
SECTION A - MONITORING AND REPORTING**

1. **Representative Sampling**
  - a. Samples and measurements taken as required herein shall be representative of the nature and volume, respectively, of the monitored discharge. All samples shall be taken at the outfall(s), and unless specified, before the effluent joins or is diluted by any other body of water or substance.
  - b. Monitoring results shall be recorded and reported on forms provided by the Department, postmarked no later than the 28th day of the month following the completed reporting period. Signed copies of these, and all other reports required herein, shall be submitted to the respective Department Regional Office, the Regional Office address is indicated in the cover letter transmitting the permit.
2. **Schedule of Compliance**

No later than fourteen (14) calendar days following each date identified in the "Schedule of Compliance", the permittee shall submit to the respective Department Regional Office as required therein, either a report of progress or, in the case of specific actions being required by identified dates, a written notice of compliance or noncompliance. In the latter case, the notice shall include the cause of noncompliance, any remedial actions taken, and the probability of meeting the next scheduled requirements, or if there are no more scheduled requirements, when such noncompliance will be corrected. The Regional Office address is indicated in the cover letter transmitting the permit.
3. **Definitions**

Definitions as set forth in the Missouri Clean Water Law and Missouri Clean Water Commission Definition Regulation 10 CSR 20-2.010 shall apply to terms used herein.
4. **Test Procedures**

Test procedures for the analysis of pollutant shall be in accordance with the Missouri Clean Water Commission Effluent Regulation 10 CSR 20-7015.
5. **Recording of Results**
  - a. For each measurement or sample taken pursuant to the requirements of this permit, the permittee shall record the following information:
    - (i) the date, exact place, and time of sampling or measurements;
    - (ii) the individual(s) who performed the sampling or measurements;
    - (iii) the date(s) analyses were performed;
    - (iv) the individual(s) who performed the analyses;
    - (v) the analytical techniques or methods used; and
    - (vi) the results of such analyses.
  - b. The Federal Clean Water Act provides that any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under this permit shall, upon conviction, be punished by a fine of not more than \$10,000 per violation, or by imprisonment for not more than six (6) months per violation, or both.
  - c. Calculations for all limitations which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified by the Director in the permit.
6. **Additional Monitoring by Permittee**

If the permittee monitors any pollutant at the location(s) designated herein more frequently than required by this permit, using approved analytical methods as specified above, the results of such monitoring shall be included in the calculation and reporting of the values required in the Monitoring Report Form. Such increased frequency shall also be indicated.

7. **Records Retention**

The permittee shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recording for continuous monitoring instrumentation, copies of all reports required by this permit, and records of all data used to complete the application for this permit, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Department at any time.

**SECTION B - MANAGEMENT REQUIREMENTS**

1. **Change in Discharge**
  - a. All discharges authorized herein shall be consistent with the terms and conditions of this permit. The discharge of any pollutant not authorized by this permit or any pollutant identified in this permit more frequently than or at a level in excess of that authorized shall constitute a violation of the permit.
  - b. Any facility expansions, production increases, or process modifications which will result in new, different, or increased discharges of pollutants shall be reported by submission of a new NPDES application at least sixty (60) days before each such change, or, if they will not violate the effluent limitations specified in the permit, by notice to the Department at least thirty (30) days before such changes.
2. **Noncompliance Notification**
  - a. If, for any reason, the permittee does not comply with or will be unable to comply with any daily maximum effluent limitation specified in this permit, the permittee shall provide the Department with the following information, in writing within five (5) days of becoming aware of such conditions:
    - (i) a description of the discharge and cause of noncompliance, and
    - (ii) the period of noncompliance, including exact dates and times or, if not corrected, the anticipated time the noncompliance is expected to continue, and steps being taken to reduce, eliminate and prevent recurrence of the noncomplying discharge.
  - b. Twenty-four hour reporting. The permittee shall report any noncompliance which may endanger health or the environment. Any information shall be provided orally with 24 hours from the time the permittee becomes aware of the circumstances. A written submission shall also be provided with five (5) days of the time the permittee becomes aware of the circumstances. The Department may waive the written report on a case-by-case basis if the oral report has been received within 24 hours.
3. **Facilities Operation**

Permittees shall operate and maintain facilities to comply with the Missouri Clean Water Law and applicable permit conditions. Operators or supervisors of operations at publicly owned or publicly regulated wastewater treatment facilities shall be certified in accordance with 10 CSR 209.020(2) and any other applicable law or regulation. Operators of other wastewater treatment facilities, water contaminant source or point sources, shall, upon request by the Department, demonstrate that wastewater treatment equipment and facilities are effectively operated and maintained by competent personnel.
4. **Adverse Impact**

The permittee shall take all necessary steps to minimize any adverse impact to waters of the state resulting from noncompliance with any effluent limitations specified in this permit or set forth in the Missouri Clean Water Law and Regulations (hereinafter the Law and Regulations), including such accelerated or additional monitoring as necessary to determine the nature and impact of the noncomplying discharge.

- a. Any bypass or shut down of a wastewater treatment facility and tributary sewer system or any part of such a facility and sewer system that results in a violation of permit limits or conditions is prohibited except:
    - (i) where unavoidable to prevent loss of life, personal injury, or severe property damages; and
    - (ii) where unavoidable excessive storm drainage or runoff would catastrophically damage any facilities or processes necessary for compliance with the effluent limitations and conditions of this permit;
    - (iii) where maintenance is necessary to ensure efficient operation and alternative measures have been taken to maintain effluent quality during the period of maintenance.
  - b. The permittee shall notify the Department in writing of all bypasses or shut down that result in a violation of permit limits or conditions. This section does not excuse any person from liability, unless such relief is otherwise provided by the statute.
6. **Removed Substances**  
Solids, sludges, filter backwash, or any other pollutants removed in the course of treatment or control of wastewaters shall be disposed of in a manner such as to prevent any pollutants from entering waters of the state unless permitted by the Law, and a permanent record of the date and time, volume and methods of removal and disposal of such substances shall be maintained by the permittee.
  7. **Power Failures**  
In order to maintain compliance with the effluent limitations and other provisions of this permit, the permittee shall either:
    - a. in accordance with the "Schedule of Compliance", provide an alternative power source sufficient to operate the wastewater control facilities; or,
    - b. if such alternative power source is not in existence, and no date for its implementation appears in the Compliance Schedule, halt or otherwise control production and all discharges upon the reduction, loss, or failure of the primary source of power to the wastewater control facilities.
  8. **Right of Entry**  
For the purpose of inspecting, monitoring, or sampling the point source, water contaminant source, or wastewater treatment facility for compliance with the Clean Water Law and these regulations, authorized representatives of the Department, shall be allowed by the permittee, upon presentation of credentials and at reasonable times;
    - a. to enter upon permittee's premises in which a point source, water contaminant source, or wastewater treatment facility is located or in which any records are required to be kept under terms and conditions of the permit;
    - b. to have access to, or copy, any records required to be kept under terms and conditions of the permit;
    - c. to inspect any monitoring equipment or method required in the permit;
    - d. to inspect any collection, treatment, or discharge facility covered under the permit; and
    - e. to sample any wastewater at any point in the collection system or treatment process.
  9. **Permits Transferable**
    - a. Subject to Section (3) of 10 CSR 20-6.010 an operating permit may be transferred upon submission to the Department of an application to transfer signed by a new owner. Until such time as the permit is officially transferred, the original permittee remains responsible for complying with the terms and conditions of the existing permit.
    - b. The Department, within thirty (30) days of receipt of the application shall notify the new permittee of its intent to revoke and reissue or transfer the permit.
  10. **Availability of Reports**  
Except for data determined to be confidential under Section 308 of the Act, and the Law and Missouri Clean Water Commission Regulation for Public Participation, Hearings and Notice to Governmental Agencies 10 CSR 20-6.020, all reports prepared in accordance with the terms of this permit shall be available for public inspection at the offices of the Department. As required by statute, effluent data shall not be considered confidential. Knowingly making any false statement on any such report shall be subject to the imposition of criminal penalties as provided in Section 204.076 of the Law.
  - a. Subject to compliance with statutory requirements of the Law and Regulations and applicable Court Order, this permit may be modified, suspended, or revoked in whole or in part during its term for cause including, but not limited to, the following:
    - (i) violation of any terms or conditions of this permit or the Law;
    - (ii) having obtained this permit by misrepresentation or failure to disclose fully any relevant facts;
    - (iii) a change in any circumstances or conditions that requires either a temporary or permanent reduction or elimination of the authorized discharge, or
    - (iv) any reason set forth in the Law and Regulations.
  - b. The filing of a request by the permittee for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance, does not stay any permit condition.
12. **Permit Modification - Less Stringent Requirements**  
If any permit provisions are based on legal requirements which are lessened or removed, and should no other basis exist for such permit provisions, the permit shall be modified after notice and opportunity for a hearing.
  13. **Civil and Criminal Liability**  
Except as authorized by statute and provided in permit conditions on "Bypassing" (Standard Condition B-5) and "Power Failures" (Standard Condition B-7) nothing in this permit shall be construed to relieve the permittee from civil or criminal penalties for noncompliance.
  14. **Oil and Hazardous Substance Liability**  
Nothing in this permit shall be construed to preclude the institution of any legal action or relieve the permittee from any responsibilities, liabilities, or penalties to which the permittee is or may be subject under Section 311 of the Act, and the Law and Regulations. Oil and hazardous materials discharges must be reported in compliance with the requirements of the Federal Clean Water Act.
  15. **State Laws**  
Nothing in this permit shall be construed to preclude the institution of any legal action or relieve the permittee from any responsibilities, liabilities, or penalties established pursuant to any applicable state statute or regulations.
  16. **Property Rights**  
The issuance of this permit does not convey any property rights in either real or personal property, or any exclusive privileges, nor does it authorize any injury to private property or any invasion of personal rights, nor any infringement of or violation of federal, state or local laws or regulations.
  17. **Duty to Reapply**  
If the permittee wishes to continue an activity regulated by this permit after the expiration date of this permit, the permittee must apply for a new permit 180 days prior to expiration of this permit.
  18. **Toxic Pollutants**  
If a toxic effluent standard, prohibition, or schedule of compliance is established, under Section 307(a) of the Federal Clean Water Act for a toxic pollutant in the discharge of permittee's facility and such standard is more stringent than the limitations in the permit, then the more stringent standard, prohibition, or schedule shall be incorporated into the permit as one of its conditions, upon notice to the permittee.
  19. **Signatory Requirement**  
All reports, or information submitted to the Director shall be signed (see 40 CFR-122.6).
  20. **Rights Not Affected**  
Nothing in this permit shall affect the permittee's right to appeal or seek a variance from applicable laws or regulations as allowed by law.
  21. **Severability**  
The provisions of this permit are severable, and if any provisions of this permit, or the application of any provision of this permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.

**STANDARD CONDITIONS FOR NPDES PERMITS  
ISSUED BY  
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES  
MISSOURI CLEAN WATER COMMISSION  
Revised  
October 1, 1980**

**PART II - SPECIAL CONDITIONS - PUBLICLY OWNED  
TREATMENT WORKS  
SECTION A - MAJOR CONTRIBUTING INDUSTRY**

**1. Definitions**

Definitions as set forth in the Missouri Clean Water Laws and Missouri Clean Water Commission Definition Regulation 10 CSR 20-2.010 shall apply to terms used herein, in addition to the following:

- a. A "major contributing industry" to a publicly owned treatment facility is a wastewater source that meets any one of the following criteria:
  - (1) has a flow of 50,000 gallons or more per average workday;
  - (2) has an average daily flow greater than five percent (5%) of the flow carried by the system receiving the waste;
  - (3) has in its waste a toxic pollutant in toxic amounts as defined in standards issued under Section 307(a) of the Federal Water Pollution Control Act (hereinafter the Act), or
  - (4) has significant impact, either singly or in combination with other contributing industries, on the treatment works or in the quality of its effluent.
- b. "Compatible pollutants" are biochemical oxygen demand, suspended solids, pH, and fecal coliform bacteria, plus additional pollutants, e.g., nitrogen or phosphorus, identified in the NPDES permit, if the publicly owned treatment facility was designed to treat such pollutants, approved by the Department and in fact does remove such pollutants to design specifications.
- c. An "incompatible pollutant" is any pollutant which is not a compatible pollutant as defined above.

**2. Industrial Effluent Monitoring**

The permittee shall establish and implement a procedure to periodically or regularly obtain monitoring data on the quality and quantity of all effluents introduced by each major contributing industry. Frequency of monitoring shall be subject to approval by the Department.

**3. Industrial Users Report**

Each permittee which has a major contributing industry shall also submit to the permit-issuing authority semi-annual reports summarizing all major contributing industries subject to the pretreatment requirements of the Missouri Clean Water Law and Regulations (hereinafter the Law and Regulations), or Section 307 of the Act. These reports must be filed with the Department of Natural Resources, PO Box 176, 205 Jefferson Street, Jefferson City,

Missouri 65102 by January 1 and July 1 of each year. Such a report shall include at least the following information:

- a. name and number of major contributing industries using the treatment works and the waste type, raw materials usage (lbs/day or kg/day), and average daily flow for each industry;
- b. summary of monitoring data obtained in accordance with Standard Conditions Part II, Section A.2 above, detailing the quality and quantity of all effluents introduced by each major contributing industry, and the frequency of monitoring performed;
- c. number of major contributing industries in full compliance with the requirements of the Law and Regulations and Section 307 of the Act or not subject to these requirements (e.g., discharge only compatible pollutants), and
- d. a list identifying by name those major contributing industries presently in violation of the requirements of the Law and Regulations and Section 307 of the Act (e.g., discharges pollutant which interferes with, passes through or is incompatible with the municipal treatment works).

**4. Report on Pollutant Introduction**

The permittee shall give notice to the department of any new introduction of pollutants or any substantial change in the character or volume of pollutants already being introduced. Such notice shall include:

- a. the origin, quality, and quantity of pollutants to be introduced into the publicly owned treatment works; and
- b. any anticipated impact on the quality and quantity of the effluent to be discharged by such treatment works;
- c. any anticipated impact on the quality of sludge produced by such treatment works causing the sludge to be hazardous under Federal and State Law.

**5. Industrial Users Compliance Schedules**

The permittee shall identify any introduction of pollutants into the facility subject to pretreatment standards under Section 307(b) of the Federal Clean Water Act. In addition, the permittee shall require any industrial user of such treatment works to comply with the requirements of Section 204(b), 307, and 308 of the Federal Clean Water Act. As a means of compliance from each industrial user, subject to the requirements of Section 307 of the Federal Clean Water Act and shall forward to the Department a copy of periodic notice, over intervals not to exceed nine (9) months, of progress towards full compliance with Section 307 requirements.

**STANDARD CONDITIONS FOR NPDES PERMITS  
ISSUED BY  
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES  
MISSOURI CLEAN WATER COMMISSION  
AUGUST 15, 1994**

**PART III – SLUDGE & BIOSOLIDS FROM DOMESTIC WASTEWATER TREATMENT FACILITIES**

**SECTION A – GENERAL REQUIREMENTS**

1. This permit pertains to sludge requirements under the Missouri Clean Water Law and regulation and incorporates applicable federal sludge disposal requirements under 40 CFR 503. The Environmental Protection Agency (EPA) has principal authority for permitting and enforcement of the federal sludge regulations under 40 CFS 503 until such time as Missouri is delegated the new EPA sludge program. EPA has reviewed and accepted these standard sludge conditions. EPA may choose to issue a separate sludge addendum to this permit or a separate federal sludge permit at their discretion to further address federal requirements.
2. These PART III Standard Conditions apply only to sludge and biosolids generated at domestic wastewater treatment facilities, including public owned treatment works (POTW) and privately owned facilities.
3. Sludge and Biosolids Use and Disposal Practices.
  - a. Permittee is authorized to operate the sludge and biosolids treatment, storage, use, and disposal facilities listed in the facility description of this permit.
  - b. Permittee shall not exceed the design sludge volume listed in the facility description and shall not use sludge disposal methods that are not listed in the facility description, without prior approval of the permitting authority.
  - c. Permittee is authorized to operate the storage, treatment or generating sites listed in the Facility Description section of this permit.
  - d. A separate operating permit is required for each operating location where sludge or biosolids are generated, stored, treated, or disposed, unless specifically exempted in this permit or in 10 CSR 20, Chapter 6 regulations. For land application, see section H, subsection 3 of these standard conditions.
4. Sludge Received From Other Facilities
  - a. Permittees may accept domestic wastewater sludge from other facilities including septic tank pumpings from residential sources as long as the design sludge volume is not exceeded and the treatment facility performance is not impaired.
  - b. The permittee shall obtain a signed statement from the sludge generator or hauler that certifies the type and source of the sludge.
  - c. Sludge received from out-of-state generators shall receive prior approval of the permitting authority and shall be listed in the facility description or special conditions section of the permit.
5. These permit requirements do not supersede nor remove liability for compliance with county and other local ordinances.
6. These permit requirements do not supersede nor remove liability for compliance with other environmental regulations such as odor emissions under the Missouri Air Pollution Control Law and regulations.
7. This permit may (after du process) be modified, or alternatively revoked and reissued, to comply with any applicable sludge disposal standard or limitation issued or approved under Section 405(d) of the Clean Water Act or under Chapter 644 RsMo.
8. In addition to the STANDARD CONDITIONS, the department may include sludge limitations in the special conditions portion or other sections of this permit.
9. Alternate Limits in Site Specific Permit.

Where deemed appropriate, the department may require an individual site specific permit in order to authorize alternate limitations:

  - a. An individual permit must be obtained for each operating location, including application sites.
  - b. To request a site specific permit, an individual permit application, permit fees, and supporting documents shall be submitted for each operating location. This shall include a detailed sludge/biosolids management plan or engineering report.
10. Exceptions to these Standard Conditions may be authorized on a case-by-case basis by the department, as follows:
  - a. The department will prepare a permit modification and follow permit public notice provisions as applicable under 10 CSR 20-6.020, 40 CFR 124.10, and 40 CFR 501.15(a)(2)(ix)(E). This includes notification of the owners of property located adjacent to each land application site, where appropriate.
  - b. Exceptions cannot be granted where prohibited by the federal sludge regulations under 40 CFR 503.
11. Compliance Period  
Compliance shall be achieved as expeditiously as possible but no later than the compliance dates under 40 CFR 503.2.

## **SECTION B – DEFINITIONS**

1. Biosolids means an organic fertilizer or soil amendment produced by the treatment of domestic wastewater sludge. Untreated sludge or sludge that does not conform to the pollutants and pathogen treatment requirements in this permit is not considered biosolids.
2. Biosolids land application facility is a facility where biosolids are spread onto the land at agronomic rates for production of food or fiber. The facility includes any structures necessary to store the biosolids until soil, weather, and crop conditions are favorable for land application.
3. Class A biosolids means a material that has met the Class A pathogen reduction requirements or equivalent treatment by a Process to Further Reduce Pathogens (PFRP) in accordance with 40 CFR 503.
4. Class B biosolids means a material that has met the Class B pathogen reduction requirements or equivalent treatment by a Process to Significantly Reduce Pathogens (PFRP) in accordance with 40 CFR 503.
5. Domestic wastewater means wastewater originating from the sanitary conveniences of residences, commercial buildings, factories and institutions; or co-mingled sanitary and industrial wastewater processed by a public owned treatment works (POTW) or privately owned facility.
6. Mechanical treatment plants are wastewater treatment facilities that use mechanical devices to treat wastewater, including septic tanks, extended aeration, activated sludge, contact stabilization, trickling filters, rotating biological discs, and other similar facilities. It does not include unaerated wastewater treatment lagoons and constructed wetlands for wastewater treatment.
7. Operating location as defined in 10 CSR 20-2.010 is all contiguous lands owned, operated or controlled by one (1) person or by two (2) or more persons jointly or as tenants in common.
8. Plant Available Nitrogen (PAN) is the nitrogen that will be available to plants during the next growing season after biosolids application.
9. Sinkhole is a depression in the land surface into which surface water flows to join an underground drainage system.
10. Site Specific Permit is a permit that has alternate limits developed to address specific site conditions for each land application site or storage site.
11. Sludge is the solid, semisolid, or liquid residue removed during the treatment of wastewater. Sludge includes septage removed from septic tanks.
12. Sludge lagoon is an earthen basin that receives sludge that has been removed from a wastewater treatment facility. It does not include a wastewater treatment lagoon or sludge treatment units that are not a part of a mechanical wastewater treatment facility.
13. Wetlands are those areas that are inundated or saturated by surface or groundwater at a frequency and duration sufficient to support, and that under normal circumstances do support, a prevalence of vegetation typically adapted for life in saturated soil conditions. Wetlands generally include swamp, marshes, bogs, and similar areas. Wetlands do not include constructed wetlands used for wastewater treatment.

## **SECTION C – MECHANICAL WASTEWATER TREATMENT FACILITIES**

1. Sludge shall be routinely removed from the wastewater treatment facilities and handled according to the permit facility description and sludge conditions in this permit.
2. The permittee shall operate the facility so that there is no sludge loss into the discharged effluent in excess of permit limits, no sludge bypassing, and no discharge of sludge to waters of the state.
3. Mechanical treatment plants shall have separate sludge storage compartments in accordance with 10 CSR 20, Chapter 8. Failure to remove sludge from these storage compartments on the required design schedule is a violation of this permit.

## **SECTION D – SLUDGE DISPOSED AT OTHER TREATMENT FACILITY OR CONTRACT HAULER**

1. This section applies to permittees that haul sludge to another treatment facility for disposal or use contract haulers to remove and dispose of sludge.
2. Permittees that use contract haulers are responsible for compliance with all the terms of this permit including final disposal, unless the hauler has a separate permit for sludge or biosolids disposal issued by the department; or the hauler transports the sludge to another permitted treatment facility.
3. The permittee shall require documentation from the contractor of the disposal methods used and permits obtained by the contractor.
4. Testing of sludge, other than total solids content, is not required if sludge is hauled to a municipal wastewater treatment facility or other permitted wastewater treatment facility.

## **SECTION E – WASTEWATER TREATMENT LAGOONS AND STORMWATER RETENTION BASINS**

1. Sludge that is retained within a wastewater treatment lagoon is subject to sludge disposal requirements when the sludge is removed from the lagoon or when the lagoon ceases to receive and treat wastewater.
2. If sludge is removed during the year, an annual sludge report must be submitted.
3. Storm water retention basins or other earthen basins, which have been used as sludge storage for a mechanical treatment system is considered a sludge lagoon and must comply with Section G of this permit.

## **SECTION F – INCINERATION OF SLUDGE**

1. Sludge incineration facilities shall comply with the requirements of 40 CFR 503 Subpart E; air pollution control regulations under 10 CSR 10; and solid waste management regulations under 10 CSR 80.
2. Permittee may be authorized under the facility description of this permit to store incineration ash in lagoons or ash ponds. This permit does not authorize the disposal of incineration ash. Incineration ash shall be disposed in accordance with 10 CSR 80; or if the ash is determined to be hazardous waste, shall be disposed in accordance with 10 CSR 25.
3. In addition to normal sludge monitoring, incineration facilities shall report the following as part of the annual report, quantity of sludge incinerated, quantity of ash generated, quantity of ash stored; and ash use or disposal method, quantity, and location. Permittee shall also provide the name of the disposal facility and the applicable permit number.
4. Additional limitations, monitoring, and reporting requirements may be addressed in the Special Conditions sections of this permit.

## **SECTION G – SURFACE DISPOSAL SITES AND SLUDGE LAGOONS**

1. Surface disposal sites shall comply with the requirements in 40 CFR 503 Subpart C, and solid waste disposal regulations under 10 CSR 80.
2. Additional limitations, monitoring, and reporting requirements may be addressed in the Special Conditions section of this permit.
3. Effective February 19, 1995, a sludge lagoon that has been in use for more than two years without removal of accumulated sludge, or that has not been properly closed shall comply with one of the following options:
  - a. Permittee shall obtain a site specific permit to address surface disposal requirements under 40 CFR 503, ground water quality regulations under 10 CSR 20, Chapter 7 and 8, and solid waste management regulations under 10 CSR 80;
  - b. Permittee shall clean out the sludge lagoon to remove any sludge over two years old and shall continue to remove accumulated sludge at least every two years or an alternate schedule approved under 40 CFR 503.20(b). In order to avoid damage to the lagoon seal during cleaning, the permittee may leave a layer of sludge on the bottom of the lagoon, upon prior approval of the department; or
  - c. Permittee shall close the lagoon in accordance with Section 1.

## **SECTION H – LAND APPLICATION**

1. The permittee shall not land apply sludge or biosolids unless land application is authorized in the Facility Description or special conditions section of the permit.
2. This permit replaces and terminates all previous sludge management plan approvals by the department for land application of sludge or biosolids.
3. Land application sites within a 20 mile radius of the wastewater treatment facility are authorized under this permit when biosolids are applied for beneficial use in accordance with these standard conditions unless a site specific permit is required under Section A, Subsection 9.
4. Biosolids shall not be applied unless authorized in this permit or exempted under 10 CSR 20, Chapter 6.
  - a. This permit does not authorize the land application of sludge except when sludge meets the definition of biosolids.
  - b. This permit authorizes “Class A or B” biosolids derived from domestic wastewater sludges to be land applied onto grass land, crop land, timber land or other similar agricultural or silviculture lands at rates suitable for beneficial use as organic fertilizer and soil conditioner.
5. Public Contact Sites.  
Permittees who wish to apply Class A biosolids to public contact sites must obtain approval from the department. Applications for approval shall be in the form of an engineering report and shall address priority pollutants and dioxin concentrations. Authorization for land applications must be provided in the special conditions section of this permit or in a separate site-specific permit.

6. Agricultural and Silvicultural Sites.

In addition to specified conditions herein, this permit is subject to the attached Water Quality Guides numbers WQ 422 through 426 published by the University of Missouri, and hereby incorporated as though fully set forth herein. The guide topics are as follows:

WQ 422	Land Application of Septage
WQ 423	Monitoring Requirements for Biosolids Land Application
WQ 424	Biosolids Standards for Pathogens and Vectors
WQ 425	Biosolids Standards for Metals and Other Trace Substances
WQ 426	Best Management Practices for Biosolids Land Applications

## **SECTION I – CLOSURE REQUIREMENTS**

1. This section applies to all wastewater treatment facilities (mechanical and lagoons) and sludge or biosolids storage and treatment facilities and incineration ash ponds. It does not apply to land application sites.
2. Permittees who plan to cease operation must obtain department approval of a closure plan which addresses proper removal and disposal of all residues, including sludge, biosolids, and ash. Permittee must maintain this permit until the facility is properly closed per 10 CSR 20-6.010 and 10 CSR 20-6.015.
3. Residuals that are left in place during closure of a lagoon or earthen structure shall not exceed the agricultural loading rates as follows:
  - a. Residuals shall meet the monitoring and land application limits for agricultural rates as referenced in Section H of these standard conditions.
  - b. If a wastewater treatment lagoon has been in operation for 15 years or more, the sludge in the lagoon qualifies for Class B with respect to pathogens (see WQ 424, Table 3), and testing for fecal coliform is not required. For other lagoons, testing for fecal coliform is required to show compliance with Class B limitations. See WQ 423 and 424.
  - c. The allowable nitrogen loading that may be left in the lagoon shall be based on the plant available nitrogen (PAN) loading. See WQ 426 for calculation procedures. For a grass cover crop, the allowable PAN is 300 pounds/acre.
4. When closing a wastewater treatment lagoon with a design treatment capacity equal or less than 150 persons, the residuals are considered “septage” under the similar treatment works” definition. See WQ 422. Under the septage category, residuals may be left in place as follows:
  - a. Testing for metals or fecal coliform is not required.
  - b. If the wastewater treatment lagoon has been in use for less than 15 years, mix lime with the sludge at the rate of 50 pounds of hydrated lime per 1000 gallons (134 cubic feet) of sludge.
  - c. The amount of sludge that may be left in the lagoon shall be based on the plant available nitrogen (PAN) loading. 100 dry tons/acre of sludge may be left in the basin without testing for nitrogen. If more than 100 dry tons/acre will be left in the lagoon, test for nitrogen and determine the PAN in accordance with WQ 426. Allowable PAN loading is 300 pounds/acre.
5. Residuals left within the lagoon shall be mixed with soil on at least a 1 to 1 ratio, the lagoon berms shall be demolished, and the site shall be graded and vegetated so as to avoid ponding of storm water and provide adequate surface water drainage without creating erosion.
6. Lagoon closure activities shall obtain a storm water permit for land disturbance activities that equal or exceed five acres in accordance with 10 CSR 20-6.200.
7. If sludge exceeds agricultural loading rates under Section H or I, a landfill permit or solid waste disposal permit shall be obtained to authorize on-site sludge disposal under the Missouri Solid Waste Management Law and regulations per 10 CSR 80, and the permittee must comply with the surface disposal requirements under 40 CFR 503, Subpart C.

## **SECTION J – MONITORING FREQUENCY**

1. At a minimum, sludge or biosolids shall be tested for volume and percent total solids on a frequency that will accurately represent sludge quantities produced and disposed.
2. Testing for land application is listed under Section H, Subsection 6 of these standard conditions (see WQ 423). Once per year is the minimum test frequency. Additional testing shall be performed for each 100 dry tons of sludge generated or stored during the year.
3. Additional testing may be required in the special conditions or other sections of the permit. Permittees receiving industrial wastewater may be required to conduct additional testing upon request from the department.
4. Monitoring requirements shall be performed in accordance with, “POTW Sludge Sampling and Analysis Guidance Document”, United States Environmental Protection Agency, August 1989, and subsequent revisions.

## SECTION K – RECORD KEEPING AND REPORTING REQUIREMENTS

1. The permittee shall maintain records on file at the facility for at least five years for the items listed in these Standard Conditions and any additional items in the Special Conditions section of this permit. This shall include dates when the sludge facility is checked for proper operation, records of maintenance and repairs and other relevant information.
2. Reporting Period
  - a. By January 28<sup>th</sup> of each year, an annual report shall be submitted for the previous calendar year period for all mechanical wastewater treatment facilities, sludge lagoons, and sludge or biosolids disposal facilities.
  - b. Permittees with wastewater treatment lagoons shall submit the above annual report only when sludge or biosolids are removed from the lagoon during the report period or when the lagoon is closed.
3. Report Forms. The annual report shall be submitted on report forms provided by the department or equivalent forms approved by the department.
4. Report shall be submitted as follows:  
Major facilities (those serving 10,000 persons or 1 million gallons per day) shall report to both the department and EPA. Other facilities need to report only to the department. Reports shall be submitted to the addresses listed as follows:

DNR regional office listed in your permit  
(See cover letter of permit)

EPA Region VII  
Water Compliance Branch (WACM)  
Sludge Coordinator  
901 N 5<sup>th</sup> Street  
Kansas City, KS 66101

5. Annual Report Contents. The annual report shall include the following:
  - a. Sludge/biosolids testing performed. Include a copy or summary of all test results, even if not required by this permit.
  - b. Sludge or Biosolids quantity shall be reported as dry tons for quantity generated by the wastewater treatment facility, the quantity stored on site at end of year, and the quantity used or disposed.
  - c. Gallons and % solids data used to calculate the dry ton amounts.
  - d. Description of any unusual operating conditions.
  - e. Final disposal method, dates, and location, and person responsible for hauling and disposal.
    - (1) This must include the name, address and permit number for the hauler and the sludge facility. If hauled to a municipal wastewater treatment facility, sanitary landfill, or other approved treatment facility, give the name and permit number of that facility.
    - (2) Include a description of the type of hauling equipment used and the capacity in tons, gallons, or cubic feet.
  - f. Contract Hauler Activities.  
If contract hauler, provide a copy of a signed contract or billing receipts from the contractor. Permittee shall require the contractor to supply information required under this permit for which the contractor is responsible. The permittee shall submit a signed statement from the contractor that he has complied with the standards contained in this permit, unless the contract hauler has a separate sludge disposal or biosolids use permit.
  - g. Land Application Sites.
    - (1) Report the location of each application site, the annual and cumulative dry tons/acre for each site, and the landowners name and address. The location for each spreading site shall be given as legal description for nearest ¼, ¼, Section, Township, Range, and County, or as latitude and longitude.
    - (2) If biosolids application exceeds 2 dry tons/acre/year, report biosolids nitrogen results. Plant Available Nitrogen (PAN) in pounds/acre, crop nitrogen requirement, available nitrogen in the soil prior to biosolids application, and PAN calculations for each site.
    - (3) If the “Low Metals” criteria is exceeded, report the annual and cumulative pollutant loading rates in pounds per acre for each applicable pollutant, and report the percent of cumulative loading which has been reached at each site.
    - (4) Report the method used for compliance with pathogen and vector attraction requirements.
    - (5) Report soil test results for pH, CEC, and phosphorus. If none was tested during the year, report the last date when tested and results.