

STATE OF MISSOURI
DEPARTMENT OF NATURAL RESOURCES

MISSOURI CLEAN WATER COMMISSION



MISSOURI STATE OPERATING PERMIT

In compliance with the Missouri Clean Water Law, (Chapter 644 R.S. Mo. as amended, hereinafter, the Law), and the Federal Water Pollution Control Act (Public Law 92-500, 92nd Congress) as amended

Permit No.: MO0135364

Owner: Enclave Lake Devco, LLC
Owner's Address: P.O. Box 1118NS, Granite City, Il 62040

Continuing Authority: Enclave Lake Property Owners Association
Continuing Authority's Address: P.O. Box 1118NS, Granite City, Il 62040

Facility Name: The Enclave Lake Estates
Facility Address: County Road 325, Gordonville, MO 63701

Legal Description: Landgrant 231, Cape Girardeau County
UTM Coordinates: X=794474, Y=4135455

Receiving Stream: Unnamed Tributary to Hubble Creek (U)
First Classified Stream and ID: Hubble Creek (P) (2197)
USGS Basin & Sub-watershed No.: (07140107-0602)

is authorized to discharge from the facility described herein, in accordance with the effluent limitations and monitoring requirements as set forth herein:

FACILITY DESCRIPTION

Outfall #001 - Subdivision-SIC 6531 – **The use or operation of this facility does not require a Certified Operator**
STEP/Recirculating Pea Gravel Filter/Chlorination/Dechlorination/sludge disposal by contract hauler
Design population equivalent is 258.
Design flow is 25,800 gallons per day.
Design sludge production is 5.7 dry tons/year.

This permit authorizes only wastewater discharges under the Missouri Clean Water Law and the National Pollutant Discharge Elimination System; it does not apply to other regulated areas. This permit may be appealed in accordance with Section 644.051.6 of the Law.

December 1, 2015
Effective Date

Sara Parker Pauley, Director, Department of Natural Resources

December 31, 2017
Expiration Date

John Madros, Director, Water Protection Program

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS					PAGE NUMBER 2 of 4	
					PERMIT NUMBER MO0135364	
The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The final effluent limitations shall become effective upon issuance and remain in effect until expiration of the permit. Such discharges shall be controlled, limited and monitored by the permittee as specified below:						
OUTFALL NUMBER AND EFFLUENT PARAMETER(S)	UNITS	FINAL EFFLUENT LIMITATIONS			MONITORING REQUIREMENTS	
		DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MEASUREMENT FREQUENCY	SAMPLE TYPE
Outfall #001						
Flow	MGD	*		*	once/quarter**	24 hr. total
Biochemical Oxygen Demand ₅	mg/L		45	30	once/quarter**	grab
Total Suspended Solids	mg/L		45	30	once/quarter**	grab
pH – Units	SU	***		***	once/quarter**	grab
Ammonia as N	mg/L				once/quarter**	grab
(Apr 1 – Sept 30)		4.0		1.6		
(Oct 1 – Mar 31)		7.8		3.0		
Temperature	°C	*		*	once/quarter**	grab
E. Coli (Note 1)	#/100 ml	1030		206	once/quarter**	grab
Total Residual Chlorine (Note 2)	mg/L	0.017 (0.13ML)		0.008 (0.13ML)	once/quarter**	grab
MONITORING REPORTS SHALL BE SUBMITTED <u>QUARTERLY</u> ; THE FIRST REPORT IS DUE <u>April 28, 2016</u> . THERE SHALL BE NO DISCHARGE OF FLOATING SOLIDS OR VISIBLE FOAM IN OTHER THAN TRACE AMOUNTS.						
B. STANDARD CONDITIONS						
IN ADDITION TO SPECIFIED CONDITIONS STATED HEREIN, THIS PERMIT IS SUBJECT TO THE ATTACHED <u>Parts I & III</u> STANDARD CONDITIONS DATED <u>October 1, 1980 and August 15, 1994</u> , AND HEREBY INCORPORATED AS THOUGH FULLY SET FORTH HEREIN.						

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS (continued)

* Monitor and report.

**

Sample discharge at least once for the months of:	Report is due:
January, February, March (1 st Quarter)	April 28
April, May, June (2 nd Quarter)	July 28
July, August, September (3 rd Quarter)	October 28
October, November, December (4 th Quarter)	January 28

*** pH is measured in pH units and is not to be averaged. The pH is limited to the range of 6.5-9.0 pH units.

Note 1 - Final limitations and monitoring requirements for E. Coli are applicable only during the recreational season from April 1 through October 31. The Monthly Average Limit for E. Coli is expressed as a geometric mean.

Note 2 - This permit contains a Total Residual Chlorine (TRC) limit.

- (a) This effluent limit is below the minimum quantification level (ML) of the most common and practical EPA approved CLTRC methods. The department has determined the current acceptable ML for total residual chlorine to be 0.13 mg/L when using the DPD Colorimetric Method #4500 – CL G. from Standard Methods for the Examination of Waters and Wastewater. The permittee will conduct analyses in accordance with this method, or equivalent, and report actual analytical values. Measured values greater than or equal to the minimum quantification level of 0.13 mg/L will be considered violations of the permit and values less than the minimum quantification level of 0.13 mg/L will be considered to be in compliance with the permit limitation. The minimum quantification level does not authorize the discharge of chlorine in excess of the effluent limits stated in the permit.

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS (continued)

- (b) Disinfection is required year-round unless the permit specifically states that "Final limitations and monitoring requirements for E. Coli are applicable only during the recreational season from April 1 through October 31." If your permit does not require disinfection during the non-recreational months, do not chlorinate in those months.
- (c) Do not chemically dechlorinate **if it is not needed to meet the limits in your permit.**
- (d) If no chlorine was used in a given sampling period, an actual analysis is not necessary. Simply report as "0 mg/L" TRC.

C. SPECIAL CONDITIONS

1. This permit may be reopened and modified, or alternatively revoked and reissued, to:
 - (a) Comply with any applicable effluent standard or limitation issued or approved under Sections 301(b)(2)(C) and (D), 304(b)(2), and 307(a) (2) of the Clean Water Act, if the effluent standard or limitation so issued or approved:
 - (1) contains different conditions or is otherwise more stringent than any effluent limitation in the permit; or
 - (2) controls any pollutant not limited in the permit.
 - (b) Incorporate new or modified effluent limitations or other conditions, if the result of a waste load allocation study, toxicity test or other information indicates changes are necessary to assure compliance with Missouri's Water Quality Standards.
 - (c) Incorporate new or modified effluent limitations or other conditions if, as the result of a watershed analysis, a Total Maximum Daily Load (TMDL) limitation is developed for the receiving waters which are currently included in Missouri's list of waters of the state not fully achieving the state's water quality standards, also called the 303(d) list.
 - (d) Address any situation where the discharge prevents full maintenance of the beneficial or designated uses of the receiving stream. This includes violations of General Criteria, which are applicable at all times including mixing zones.The permit as modified or reissued under this paragraph shall also contain any other requirements of the Clean Water Act then applicable.
2. All outfalls must be clearly marked in the field.
3. Permittee will cease discharge by connection to a facility with an area-wide management plan per 10 CSR 20-6.010(3)(B) within 90 days of notice of its availability.
4. There shall be no discharge of toxic pollutants at levels which would cause an exceedance of water quality standards.
5. Changes in Discharges of Toxic Substances

The permittee shall notify the Director as soon as it knows or has reason to believe:

 - (a) That any activity has occurred or will occur which would result in the discharge of any toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following "notification levels:"
 - (1) One hundred micrograms per liter (100 µg/L);
 - (2) Two hundred micrograms per liter (200 µg/L) for acrolein and acrylonitrile; five hundred micrograms per liter (500 µg/L) for 2,5 dinitrophenol and for 2-methyl-4, 6-dinitrophenol; and one milligram per liter (1 mg/L) for antimony;
 - (3) Five (5) times the maximum concentration value reported for the pollutant in the permit application;
 - (4) The level established in Part A of the permit by the Director.
 - (b) That they have begun or expect to begin to use or manufacture as an intermediate or final product or byproduct any toxic pollutant, which was not reported in the permit application.
6. Report as no-discharge when a discharge does not occur during the report period.
7. The discharge of any pollutant not documented in the application for this permit is prohibited. This includes any chemical, biological material, radiological material, or any other material that may affect the ability of the receiving stream to fully support its beneficial and designated uses.
8. There shall be no discharge of a solid waste to waters of the state.
9. It is a violation of the Missouri Clean Water Law to fail to pay fees associated with this permit (644.055 RSMo).

C. SPECIAL CONDITIONS (continued)

10. The permittee shall comply with any applicable requirements listed in 10 CSR 20-9, unless the facility has received written notification that the Department has approved a modification to the requirements. The monitoring frequencies contained in this permit shall not be construed by the permittee as a modification of the monitoring frequencies listed in 10 CSR 20-9. If a modification of the monitoring frequencies listed in 10 CSR 20-9 is needed, the permittee shall submit a written request to the department for review and, if deemed necessary, approval.
11. Bypasses are not authorized at this facility and are subject to 40 CFR 122.41(m). If a bypass occurs, the permittee shall report in accordance to 40 CFR 122.41(m)(3)(i), and with Standard Condition Part I, Section B, subsection 2.b. Bypasses are to be reported to the Southeast Regional Office. Blending, which is the practice of combining a partially-treated wastewater process stream with a fully-treated wastewater process stream prior to discharge, is not considered a form of bypass. If the permittee wishes to utilize blending, the permittee shall file an application to modify this permit to facilitate the inclusion of appropriate monitoring conditions.
12. The facility must be fenced sufficiently to restrict entry by children, livestock and unauthorized persons as well as to protect the facility from vandalism. The fence shall be a minimum of five feet (5') in height. Fences shall be located far enough back from all treatment processes to permit easy access for operation and maintenance and for access of mowing equipment, sludge trucks and similar equipment.
13. At least one (1) warning sign shall be placed on each side of the facility enclosure in such positions as to be clearly visible from all directions of approach. There shall also be one (1) sign placed for every five hundred feet (500') (150 m) of the perimeter fence. A sign shall also be placed on each gate. Minimum wording shall be "SEWAGE TREATMENT FACILITY – KEEP OUT". Signs shall be made of durable material with characters at least two inches (2") high and shall be securely fastened to the fence, equipment or other suitable locations.
14. An Operation and Maintenance (O & M) manual shall be maintained by the permittee and made available to the operator. The O & M manual shall include key operating procedures and a brief summary of the operation of the facility.
15. An all-weather access road shall be provided from a public right-of-way to the treatment facility. Sufficient room shall be provided at the site to permit turning vehicles around. Gravel roads to be used by heavy vehicles shall have a minimum depth of six inches (6") of crushed rock material with a bottom layer of four inches (4") of two to three inch (2-3") size material and a top layer two inches (2") thick of three-fourths inch (3/4") size material. In general, the grade of the access road shall not exceed twelve percent (12%).

Missouri Department of Natural Resources
FACT SHEET
FOR THE PURPOSE OF ISSUANCE
OF
MO0135364
THE ENCLAVE LAKE ESTATES

The Federal Water Pollution Control Act ("Clean Water Act" Section 402 Public Law 92-500 as amended) established the National Pollution Discharge Elimination System (NPDES) permit program. This program regulates the discharge of pollutants from point sources into the waters of the United States, and the release of storm water from certain point sources. All such discharges are unlawful without a permit (Section 301 of the "Clean Water Act"). After a permit is obtained, a discharge not in compliance with all permit terms and conditions is unlawful. Missouri State Operating Permits (MSOPs) are issued by the Director of the Missouri Department of Natural Resources (department) under an approved program, operating in accordance with federal and state laws (Federal "Clean Water Act" and "Missouri Clean Water Law" Section 644 as amended). MSOPs are issued for a period of five (5) years unless otherwise specified.

As per [40 CFR Part 124.8(a)] and [10 CSR 20-6.020(1)2.] a Factsheet shall be prepared to give pertinent information regarding the applicable regulations, rationale for the development of effluent limitations and conditions, and the public participation process for the Missouri State Operating Permit (operating permit) listed below.

A Factsheet is not an enforceable part of an operating permit.

This Factsheet is for a Major , Minor , Industrial Facility ; Variance ;
Master General Permit ; General Permit Covered Facility ; and/or permit with widespread public interest .

Part I – Facility Information

Facility Type: NON-POTW
Facility SIC Code(s): 6531

Facility Description:

STEP/Recirculating Pea Gravel Filter/Chlorination/Dechlorination/sludge disposal by contract hauler

Have any changes occurred at this facility or in the receiving water body that effects effluent limit derivation?
, - No.

Application Date: N/A
Expiration Date: N/A
Last Inspection: N/A In Compliance ; Non-Compliance

OUTFALL(S) TABLE:

OUTFALL	DESIGN FLOW (CFS)	TREATMENT LEVEL	EFFLUENT TYPE	DISTANCE TO CLASSIFIED SEGMENT (MI)
001	0.034	Secondary	Domestic	0.58

Outfall #001

Legal Description: Landgrant 231, Cape Girardeau County
UTM Coordinates: X=794474, Y=4135455

Receiving Stream: Unnamed Tributary to Hubble Creek (U)
First Classified Stream and ID: Hubble Creek (P) (2197)
USGS Basin & Sub-watershed No.: (07140107-0602)

Water Quality History:

N/A

Comments:

None.

Part II – Operator Certification Requirements

As per [10 CSR 20-6.010(8) Terms and Conditions of a Permit], permittees shall operate and maintain facilities to comply with the Missouri Clean Water Law and applicable permit conditions and regulations. Operators or supervisors of operations at regulated wastewater treatment facilities shall be certified in accordance with [10 CSR 20-9.020(2)] and any other applicable state law or regulation. As per [10 CSR 20-9.020(2)(A)], requirements for operation by certified personnel shall apply to all wastewater treatment systems, if applicable, as listed below:

Check boxes below that are applicable to the facility;

Not Applicable ; This facility is not required to have a certified operator.

Part III – Receiving Stream Information

APPLICABLE DESIGNATIONS OF WATERS OF THE STATE:

As per Missouri’s Effluent Regulations [10 CSR 20-7.015], the waters of the state are divided into the below listed seven (7) categories. Each category list effluent limitations for specific parameters, which are presented in each outfall’s Effluent Limitation Table and further discussed in the Derivation & Discussion of Limits section.

- Missouri or Mississippi River [10 CSR 20-7.015(2)]:
- Lake or Reservoir [10 CSR 20-7.015(3)]:
- Losing [10 CSR 20-7.015(4)]:
- Metropolitan No-Discharge [10 CSR 20-7.015(5)]:
- Special Stream [10 CSR 20-7.015(6)]:
- Subsurface Water [10 CSR 20-7.015(7)]:
- All Other Waters [10 CSR 20-7.015(8)]:

10 CSR 20-7.031 Missouri Water Quality Standards, the department defines the Clean Water Commission water quality objectives in terms of "water uses to be maintained and the criteria to protect those uses." The receiving stream and/or 1st classified receiving stream’s beneficial water uses to be maintained are located in the Receiving Stream Table located below in accordance with [10 CSR 20-7.031(3)].

RECEIVING STREAM(S) TABLE:

WATERBODY NAME	CLASS	WBID	DESIGNATED USES*	8-DIGIT HUC	EDU**
Unnamed Trib to Hubble Creek	U		General Criteria	07140107	OUSFC
Hubble Creek	P	2197	LWW, AQL, WBC(B)		

* - Irrigation (IRR), Livestock & Wildlife Watering (LWW), Protection of Warm Water Aquatic Life and Human Health-Fish Consumption (AQL), Cool Water Fishery(CLF), Cold Water Fishery (CDF), Whole Body Contact Recreation (WBC), Secondary Contact Recreation (SCR), Drinking Water Supply (DWS), Industrial (IND), Groundwater (GRW).

** - Ecological Drainage Unit

RECEIVING STREAM(S) LOW-FLOW VALUES TABLE:

RECEIVING STREAM	LOW-FLOW VALUES (CFS)		
	1Q10	7Q10	30Q10
Unnamed Trib to Hubble Creek (U)	-	-	-

MIXING CONSIDERATIONS TABLE:

Mixing Zone: Not Allowed [10 CSR 20-7.031(4)(A)4.B.(I)(a)].

Zone of Initial Dilution: Not Allowed [10 CSR 20-7.031(4)(A)4.B.(I)(b)].

RECEIVING STREAM MONITORING REQUIREMENTS:

No receiving water monitoring requirements recommended at this time.

Part IV – Rationale and Derivation of Effluent Limitations & Permit Conditions

ALTERNATIVE EVALUATIONS FOR NEW FACILITIES:

As per [10 CSR 20-7.015(4)(A)], discharges to losing streams shall be permitted only after other alternatives including land application, discharges to a gaining stream and connection to a regional wastewater treatment facility have been evaluated and determined to be unacceptable for environmental and/or economic reasons.

Not Applicable ;

The facility does not discharge to a Losing Stream as defined by [10 CSR 20-2.010(36)] & [10 CSR 20-7.031(1)(N)].

ANTI-BACKSLIDING:

A provision in the Federal Regulations [CWA §303(d)(4); CWA §402(c); 40 CFR Part 122.44(I)] that requires a reissued permit to be as stringent as the previous permit with some exceptions.

- New facility, backsliding does not apply.

ANTIDegradation:

In accordance with Missouri's Water Quality Standard [10 CSR 20-7.031(2)], the Department is to document by means of Antidegradation Review that the use of a water body's available assimilative capacity is justified. Degradation is justified by documenting the socio-economic importance of a discharging activity after determining the necessity of the discharge.

- New and/or expanded discharge, originally applied and public noticed prior to Antidegradation implementation.

AREA-WIDE WASTE TREATMENT MANAGEMENT & CONTINUING AUTHORITY:

As per [10 CSR 20-6.010(3)(B)], ...An applicant may utilize a lower preference continuing authority by submitting, as part of the application, a statement waiving preferential status from each existing higher preference authority, providing the waiver does not conflict with any area-wide management plan approved under section 208 of the Federal Clean Water Act or any other regional sewage service and treatment plan approved for higher preference authority by the Department.

BIOSOLIDS & SEWAGE SLUDGE:

Biosolids are solid materials resulting from domestic wastewater treatment that meet federal and state criteria for beneficial uses (i.e. fertilizer). Sewage sludge is solids, semi-solids, or liquid residue generated during the treatment of domestic sewage in a treatment works; including but not limited to, domestic septage; scum or solids removed in primary, secondary, or advanced wastewater treatment process; and a material derived from sewage sludge. Sewage sludge does not include ash generated during the firing of sewage sludge in a sewage sludge incinerator or grit and screening generated during preliminary treatment of domestic sewage in a treatment works. Additional information regarding biosolids and sludge is located at the following web address: <http://dnr.mo.gov/env/wpp/pub/index.html>, items WQ422 through WQ449.

Not applicable;

This condition is not applicable to the permittee for this facility.

COMPLIANCE AND ENFORCEMENT:

Enforcement is the action taken by the Water Protection Program (WPP) to bring an entity into compliance with the Missouri Clean Water Law, its implementing regulations, and/or any terms and conditions of an operating permit. The primary purpose of the enforcement activity in the WPP is to resolve violations and return the entity to compliance.

Not Applicable ;

The permittee/facility is not currently under Water Protection Program enforcement action.

PRETREATMENT PROGRAM:

The reduction of the amount of pollutants, the elimination of pollutants, or the alteration of the nature of pollutant properties in wastewater prior to or in lieu of discharging or otherwise introducing such pollutants into a Publicly Owned Treatment Works [40 CFR Part 403.3(q)].

Pretreatment programs are required at any POTW (or combination of POTW operated by the same authority) and/or municipality with a total design flow greater than 5.0 MGD and receiving industrial wastes that interfere with or pass through the treatment works or are otherwise subject to the pretreatment standards. Pretreatment programs can also be required at POTWs/municipals with a design flow less than 5.0 MGD if needed to prevent interference with operations or pass through.

Several special conditions pertaining to the permittee's pretreatment program may be included in the permit, and are as follows:

- Implementation and enforcement of the program,
- Annual pretreatment report submittal,
- Submittal of list of industrial users,
- Technical evaluation of need to establish local limitations, and
- Submittal of the results of the evaluation

Not Applicable ;

The permittee, at this time, is not required to have a Pretreatment Program or does not have an approved pretreatment program.

REASONABLE POTENTIAL ANALYSIS (RPA):

Federal regulation [40 CFR Part 122.44(d)(1)(i)] requires effluent limitations for all pollutants that are or may be discharged at a level that will cause or have the reasonable potential to cause or contribute to an in-stream excursion above narrative or numeric water quality standard.

In accordance with [40 CFR Part 122.44(d)(iii)] if the permit writer determines that any give pollutant has the reasonable potential to cause, or contribute to an in-stream excursion above the WQS, the permit must contain effluent limits for that pollutant.

Not Applicable ;

A RPA was not conducted for this facility.

REMOVAL EFFICIENCY:

Removal efficiency is a method by which the Federal Regulations define Secondary Treatment and Equivalent to Secondary Treatment, which applies to Biochemical Oxygen Demand 5-day (BOD₅) and Total Suspended Solids (TSS) for Publicly Owned Treatment Works (POTWs)/municipals.

Not Applicable ;

Influent monitoring is not being required to determine percent removal.

SANITARY SEWER OVERFLOWS (SSO) AND INFLOW AND INFILTRATION (I&I):

Sanitary Sewer Overflows (SSOs) are defined as an untreated or partially treated sewage release are considered bypassing under state regulation [10 CSR 20-2.010(11)] and should not be confused with the federal definition of bypass. SSO's have a variety of causes including blockages, line breaks, and sewer defects that allow excess storm water and ground water to (1) enter and overload the collection system, and (2) overload the treatment facility. Additionally, SSO's can be also be caused by lapses in sewer system operation and maintenance, inadequate sewer design and construction, power failures, and vandalism. SSOs also include overflows out of manholes and onto city streets, sidewalks, and other terrestrial locations.

Additionally, Missouri RSMo §644.026.1 mandates that the Department require proper maintenance and operation of treatment facilities and sewer systems and proper disposal of residual waste from all such facilities.

- Not applicable. This facility is not required to develop or implement a program for maintenance and repair of the collection system; however, it is a violation of Missouri State Environmental Laws and Regulations to allow untreated wastewater to discharge to waters of the state.

SCHEDULE OF COMPLIANCE (SOC):

A schedule of remedial measures included in a permit, including an enforceable sequence of interim requirements (actions, operations, or milestone events) leading to compliance with the Missouri Clean Water Law, its implementing regulations, and/or the terms and conditions of an operating permit.

Not Applicable ;

This permit does not contain a SOC.

STORM WATER POLLUTION PREVENTION PLAN (SWPPP):

In accordance with 40 CFR 122.44(k) *Best Management Practices (BMPs)* to control or abate the discharge of pollutants when:
(1) Authorized under section 304(e) of the Clean Water Act (CWA) for the control of toxic pollutants and hazardous substances from ancillary industrial activities; (2) Authorized under section 402(p) of the CWA for the control of storm water discharges; (3) Numeric effluent limitations are infeasible; or (4) the practices are reasonably necessary to achieve effluent limitations and standards or to carry out the purposes and intent of the CWA.

In accordance with the EPA's *Developing Your Stormwater Pollution Prevention Plan, A Guide for Industrial Operators*, (Document number EPA 833-B-09-002) [published by the United States Environmental Protection Agency (USEPA) in February 2009], BMPs are measures or practices used to reduce the amount of pollution entering (regarding this operating permit) waters of the state. BMPs may take the form of a process, activity, or physical structure.

Additionally in accordance with the Storm Water Management, a SWPPP is a series of steps and activities to (1) identify sources of pollution or contamination, and (2) select and carry out actions which prevent or control the pollution of storm water discharges.

Not Applicable ;

At this time, the permittee is not required to develop and implement a SWPPP.

VARIANCE:

As per the Missouri Clean Water Law § 644.061.4, variances shall be granted for such period of time and under such terms and conditions as shall be specified by the commission in its order. The variance may be extended by affirmative action of the commission. In no event shall the variance be granted for a period of time greater than is reasonably necessary for complying with the Missouri Clean Water Law §§644.006 to 644.141 or any standard, rule or regulation promulgated pursuant to Missouri Clean Water Law §§644.006 to 644.141.

Not Applicable ;

This operating permit is not drafted under premises of a petition for variance.

WASTELOAD ALLOCATIONS (WLA) FOR LIMITS:

As per [10 CSR 20-2.010(78)], the amount of pollutant each discharger is allowed by the Department to release into a given stream after the Department has determined total amount of pollutant that may be discharged into that stream without endangering its water quality.

Applicable ;

Wasteload allocations were calculated where applicable using water quality criteria or water quality model results and the dilution equation below:

$$C = \frac{(C_s \times Q_s) + (C_e \times Q_e)}{(Q_e + Q_s)} \quad (\text{EPA/505/2-90-001, Section 4.5.5})$$

Where C = downstream concentration
Cs = upstream concentration
Qs = upstream flow
Ce = effluent concentration
Qe = effluent flow

Chronic wasteload allocations were determined using applicable chronic water quality criteria (CCC: criteria continuous concentration) and stream volume of flow at the edge of the mixing zone (MZ). Acute wasteload allocations were determined using applicable water quality criteria (CMC: criteria maximum concentration) and stream volume of flow at the edge of the zone of initial dilution (ZID).

Water quality based maximum daily and average monthly effluent limitations were calculated using methods and procedures outlined in USEPA's "Technical Support Document For Water Quality-based Toxics Control" (EPA/505/2-90-001).

Number of Samples “n”:

Additionally, in accordance with the TSD for water quality-based permitting, effluent quality is determined by the underlying distribution of daily values, which is determined by the Long Term Average (LTA) associated with a particular Wasteload Allocation (WLA) and by the Coefficient of Variation (CV) of the effluent concentrations. Increasing or decreasing the monitoring frequency does not affect this underlying distribution or treatment performance, which should be, at a minimum, be targeted to comply with the values dictated by the WLA. Therefore, it is recommended that the actual planned frequency of monitoring normally be used to determine the value of “n” for calculating the AML. However, in situations where monitoring frequency is once per month or less, a higher value for “n” must be assumed for AML derivation purposes. Thus, the statistical procedure being employed using an assumed number of samples is “n = 4” at a minimum. For Total Ammonia as Nitrogen, “n = 30” is used.

WLA MODELING:

There are two general types of effluent limitations, technology-based effluent limits (TBELs) and water quality based effluent limits (WQBELs). If TBELs do not provide adequate protection for the receiving waters, then WQBEL must be used.

Not Applicable ;

A WLA study was either not submitted or determined not applicable by Department staff.

WATER QUALITY STANDARDS:

Per [10 CSR 20-7.031(3)], General Criteria shall be applicable to all waters of the state at all times including mixing zones. Additionally, [40 CFR 122.44(d)(1)] directs the Department to establish in each NPDES permit to include conditions to achieve water quality established under Section 303 of the Clean Water Act, including State narrative criteria for water quality.

WHOLE EFFLUENT TOXICITY (WET) TEST:

A WET test is a quantifiable method of determining if a discharge from a facility may be causing toxicity to aquatic life by itself, in combination with or through synergistic responses when mixed with receiving stream water.

Applicable ;

Under the federal Clean Water Act (CWA) §101(a)(3), requiring WET testing is reasonably appropriate for site-specific Missouri State Operating Permits for discharges to waters of the state issued under the National Pollutant Discharge Elimination System (NPDES). WET testing is also required by 40 CFR 122.44(d)(1). WET testing ensures that the provisions in the 10 CSR 20-6.010(8)(A)7. and the Water Quality Standards 10 CSR 20-7.031(3)(D),(F),(G),(I)2.A & B are being met. Under [10 CSR 20-6.010(8)(A)4], the Department may require other terms and conditions that it deems necessary to assure compliance with the Clean Water Act and related regulations of the Missouri Clean Water Commission. In addition the following MCWL apply: §§644.051.3 requires the Department to set permit conditions that comply with the MCWL and CWA; 644.051.4 specifically references toxicity as an item we must consider in writing permits (along with water quality-based effluent limits, pretreatment, etc...); and 644.051.5 is the basic authority to require testing conditions. WET test will be required by all facilities meeting the following criteria:

Not Applicable ;

At this time, the permittee is not required to conduct WET test for this facility.

40 CFR 122.41(M) - BYPASSES:

The federal Clean Water Act (CWA), Section 402 prohibits wastewater dischargers from “bypassing” untreated or partially treated sewage (wastewater) beyond the headworks. A bypass is defined as an intentional diversion of waste streams from any portion of a treatment facility, [40 CFR 122.41(m)(1)(i)]. Additionally, Missouri regulation 10 CSR 20-7.015(9)(G) a bypass means the intentional diversion of waste streams from any portion of a treatment facility, except in the case of blending, to waters of the state. Only under exceptional and specified limitations do the federal regulations allow for a facility to bypass some or all of the flow from its treatment process. Bypasses are prohibited by the CWA unless a permittee can meet all of the criteria listed in 40 CFR 122.41(m)(4)(i)(A), (B), & (C). Any bypasses from this facility are subject to the reporting required in 40 CFR 122.41(l)(6) and per Missouri’s Standard Conditions I, Section B, part 2.b. Additionally, Anticipated Bypasses include bypasses from peak flow basins or similar devices designed for peak wet weather flows.

- Not Applicable, this facility does not bypass.

303(d) LIST & TOTAL MAXIMUM DAILY LOAD (TMDL):

Section 303(d) of the federal Clean Water Act requires that each state identify waters that are not meeting water quality standards and for which adequate water pollution controls have not been required. Water quality standards protect such beneficial uses of water as whole body contact (such as swimming), maintaining fish and other aquatic life, and providing drinking water for people, livestock and wildlife. The 303(d) list helps state and federal agencies keep track of waters that are impaired but not addressed by normal water pollution control programs.

A TMDL is a calculation of the maximum amount of a given pollutant that a body of water can absorb before its water quality is affected. If a water body is determined to be impaired as listed on the 303(d) list, then a watershed management plan will be developed that shall include the TMDL calculation

Not Applicable ;

This facility does not discharge to a 303(d) listed stream.

Part V – Effluent Limits Determination

Outfall #001 – Main Facility Outfall

EFFLUENT LIMITATIONS TABLE:

PARAMETER	UNIT	BASIS FOR LIMITS	DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	MODIFIED	PREVIOUS PERMIT LIMITATIONS
FLOW	GPD	1	*		*		N/A
BOD ₅	MG/L	1		45	30		N/A
TSS	MG/L	1		45	30		N/A
pH	SU	1	6.5-9.0		6.5-9.0		N/A
TEMPERATURE	°C	1/8	*		*		N/A
AMMONIA AS N (APR 1 – SEPT 30)	MG/L	2/3/5	4.0		1.6		N/A
AMMONIA AS N (OCT 1 – MAR 31)	MG/L	2/3/5	7.8		3.0		N/A
ESCHERICHIA COLI	**	1/2	1030		206		N/A
CHLORINE, TOTAL RESIDUAL	MG/L	1/2	0.017 (.13ML)		0.008 (.13ML)		N/A
MONITORING FREQUENCY	Please see Minimum Sampling and Reporting Frequency Requirements in the Derivation and Discussion Section below.						

* - Monitoring requirement only

** - # of colonies/100mL; the Monthly Average for Fecal Coliform is a geometric mean.

*** - Parameter not previously established in previous state operating permit.

N/A – Not applicable

Basis for Limitations Codes:

- | | |
|--|------------------------------------|
| 1. State or Federal Regulation/Law | 7. Antidegradation Policy |
| 2. Water Quality Standard (includes RPA) | 8. Water Quality Model |
| 3. Water Quality Based Effluent Limits | 9. Best Professional Judgment |
| 4. Lagoon Policy | 10. TMDL or Permit in lieu of TMDL |
| 5. Ammonia Policy | 11. WET Test Policy |
| 6. Dissolved Oxygen Policy | |

OUTFALL #001 – DERIVATION AND DISCUSSION OF LIMITS:

- **Flow.** In accordance with [40 CFR Part 122.44(i)(1)(ii)] the volume of effluent discharged from each outfall is needed to assure compliance with permitted effluent limitations. If the permittee is unable to obtain effluent flow, then it is the responsibility of the permittee to inform the department, which may require the submittal of an operating permit modification.
- **Biochemical Oxygen Demand (BOD₅).** See Appendix – Water Quality Review Sheet
- **Total Suspended Solids (TSS).** See Appendix – Water Quality Review Sheet
- **pH.** See Appendix – Water Quality Review Sheet; revised to 6.5 per Missouri Clean Water Commission (MCWC) regulation [10 CSR 20-7.015(8)(B)A.]
- **Temperature.** See Appendix – Water Quality Review Sheet
- **Total Ammonia Nitrogen.** See Appendix – Water Quality Review Sheet
- **Escherichia coli (E. coli).** Monthly average of 206 per 100 ml as a geometric mean and Daily Maximum of 1030 during the recreational season (April 1 – October 31), to protect Whole Body Contact Recreation (B) designated use of the receiving stream, as per 10 CSR 20-7.031(4)(C). Daily Maximum effluent variability will be evaluated in development of a future effluent limit. An effluent limit for both monthly average and daily maximum is required by 40 CFR 122.45(d).
- **Total Residual Chlorine (TRC).** See Appendix – Water Quality Review Sheet
- **Minimum Sampling and Reporting Frequency Requirements.**

PARAMETER	SAMPLING FREQUENCY	REPORTING FREQUENCY
FLOW	ONCE/QUARTER	ONCE/QUARTER
BOD ₅	ONCE/QUARTER	ONCE/QUARTER
TSS	ONCE/QUARTER	ONCE/QUARTER
PH	ONCE/QUARTER	ONCE/QUARTER
TEMPERATURE	ONCE/QUARTER	ONCE/QUARTER
AMMONIA AS N (APR 1 – SEPT 30)	ONCE/QUARTER	ONCE/QUARTER
AMMONIA AS N (OCT 1 – MAR 31)	ONCE/QUARTER	ONCE/QUARTER
E. COLI	ONCE/QUARTER	ONCE/QUARTER
CHLORINE, TOTAL RESIDUAL	ONCE/QUARTER	ONCE/QUARTER

Part VI –2013 Water Quality Criteria for Ammonia

Upcoming changes to the Water Quality Standard for ammonia may require significant upgrades to wastewater treatment facilities.

On August 22, 2013, the U.S. Environmental Protection Agency (EPA) finalized new water quality criteria for ammonia, based on toxicity studies of mussels and gill breathing snails. Missouri’s current ammonia criteria are based on toxicity testing of several species, but did not include data from mussels or gill breathing snails. Missouri is home to 69 of North America’s mussel species, which are spread across the state. According to the Missouri Department of Conservation nearly two-thirds of the mussel species in Missouri are considered to be “of conservation concern”. Nine species are listed as federally endangered, with an additional species currently proposed as endangered and another species proposed as threatened.

The adult forms of mussels that are seen in rivers, lakes, and streams are sensitive to pollutants because they are sedentary filter feeders. They vacuum up many pollutants with the food they bring in and cannot escape to new habitats, so they can accumulate toxins in their bodies and die. But very young mussels, called glochidia, are exceptionally sensitive to ammonia in water. As a result of a citizen suit, the EPA was compelled to conduct toxicity testing and develop ammonia water quality criteria that would be protective if young mussels may be present in a waterbody. These new criteria will apply to any discharge with ammonia levels that may pose a reasonable potential to violate the standards. Nearly all discharging domestic wastewater treatment facilities (cities, subdivisions, mobile home parks, etc.), as well as certain industrial and stormwater dischargers with ammonia in their effluent, will be affected by this change in the regulations.

When new water quality criteria are established by the EPA, states must adopt them into their regulations in order to keep their authorization to issue permits under the National Pollutant Discharge Elimination System (NPDES). States are required to review their water quality standards every three years, and if new criteria have been developed they must be adopted. States may be more protective than the Federal requirements, but not less protective. Missouri does not have the resources to conduct the studies necessary for developing new water quality standards, and therefore our standards mirror those developed by the EPA; however, we will utilize any available flexibility based on actual species of mussels that are native to Missouri and their sensitivity to ammonia.

Many treatment facilities in Missouri are currently scheduled to be upgraded to comply with the current water quality standards. But these new ammonia standards may require a different treatment technology than the one being considered by the permittee. It is important that permittees discuss any new and upcoming requirements with their consulting engineers to ensure that their treatment systems are capable of complying with the new requirements. The Department encourages permittees to construct treatment technologies that can attain effluent quality that supports the EPA ammonia criteria.

Ammonia toxicity varies by temperature and by pH of the water. Assuming a stable pH value, but taking into account winter and summer temperatures, Missouri includes two seasons of ammonia effluent limitations. Current effluent limitations in this permit are:

Summer – 4.0 mg/L daily maximum, 1.6 mg/L monthly average.
Winter – 7.8 mg/L daily maximum, 3.0 mg/L monthly average.

Under the new EPA criteria, where mussels of the family Unionidae are present or expected to be present, the estimated effluent limitations for a facility in a location such as this that discharges to a receiving stream with no mixing consideration listed in Part III of the Fact Sheet will be:

Summer – 1.7 mg/L daily maximum, 0.6 mg/L monthly average.
Winter – 5.6 mg/L daily maximum, 2.1 mg/L monthly average.

Part VII: Finding of Affordability

Pursuant to Section 644.145, RSMo., the Department is required to determine whether a permit or decision is affordable and makes a finding of affordability for certain permitting and enforcement decisions. This requirement applies to discharges from combined or separate sanitary sewer systems or publically-owned treatment works.

Not Applicable;

The Department is not required to determine findings of affordability because the facility is not a **combined or separate sanitary sewer system for a publically-owned treatment works.**

Part VIII – Administrative Requirements

On the basis of preliminary staff review and the application of applicable standards and regulations, the Department, as administrative agent for the Missouri Clean Water Commission, proposes to issue a permit(s) subject to certain effluent limitations, schedules, and special conditions contained herein and within the operating permit. The proposed determinations are tentative pending public comment.

PUBLIC NOTICE: The permit was public noticed from December 2, 2011 to January 1, 2012. No comments were received.

DATE OF FACT SHEET: DECEMBER 1, 2011

COMPLETED BY:

**TIM SOUTHARDS, P.E.
ENVIRONMENTAL ENGINEER
SOUTHEAST REGIONAL OFFICE
MISSOURI DEPARTMENT OF NATURAL RESOURCES
(573)840-9750**

FINALIZED ON 11/09/15
BY TODD BLANC, ENVIRONMENTAL SCIENTIST
314-416-2064

Part IX – Appendices

APPENDIX – WATER QUALITY REVIEW SHEET:



**Missouri Department of Natural Resources
 Water Protection Program
 NPDES Permits and Engineering Section**

Water Quality Review Sheet
Determination of Effluent Limits and Monitoring Requirements

FACILITY INFORMATION

FACILITY NAME: Kenwood Lakes Estates WWTF NPDES #: NA

FACILITY TYPE/DESCRIPTION: Facility will be a re-circulating pea gravel filter bed to treat domestic waste from 80 residential units. Design flow will be 0.0222 MGD.

EDU*: Ozark/Upper St. Francis/Castor (OUSFC) 8-DIGIT HUC: 07140107 COUNTY: Cape Girardeau
 * - Ecological Drainage Unit

LEGAL DESCRIPTION: Not available LATITUDE/LONGITUDE: 37.91'14" N / -89.40'21" W

WATER QUALITY HISTORY: No history

OUTFALL	DESIGN FLOW (CFS)	TREATMENT LEVEL	RECEIVING WATERBODY	DISTANCE TO CLASSIFIED SEGMENT (MI)
001	0.034	Secondary	Unnamed Trib to Hubble Creek	0.58

RECEIVING WATERBODY INFORMATION

WATERBODY NAME	CLASS	WBID	LOW-FLOW VALUES (CFS)			DESIGNATED USES**
			1Q10	7Q10	30Q10	
Unnamed Trib to Hubble Creek	U		-	-	-	General Criteria
Hubble Creek	P	2197	0.1	0.1	1.0	LWW, AQL, WBC(B)

** Irrigation (IRR), Livestock & Wildlife Watering (LWW), Protection of Warm Water Aquatic Life and Human Health-Fish Consumption (AQL), Cool Water Fishery (CLF), Cold Water Fishery (CDF), Whole Body Contact Recreation (WBC), Secondary Contact Recreation (SCR), Drinking Water Supply (DWS), Industrial (IND)

COMMENTS: No Geohydrological evaluation was submitted with the request. The engineering firm submitted time of travel for ammonia decay to be used in his review. No Section 303 (d) or TMDL listing for this waterbody or Hubble Creek.

Kenwood Lake Estates WWTF
11/14/07
Page 2

ANTIDegradation POLICY

In accordance with Missouri's Water Quality Standard [10 CSR 20-7.031(2)] and federal antidegradation policy at Title 40 Code of Federal Regulation (CFR) Section 131.12 (a), the department is to develop a statewide antidegradation policy and corresponding procedures to implement the policy. A proposed discharge to a water body will be required to undergo a level of Antidegradation Review which documents that the use of a water body's available assimilative capacity is justified. Effective tentatively August 2008 (depending on the rulemaking process), a facility will be required to use *Missouri's Antidegradation Implementation Procedure*. This procedure will be applicable to new and expanded wastewater facilities.

GENERAL ASSUMPTIONS OF THE WATER QUALITY REVIEW SHEET

1. A Water Quality Review Sheet (WQRS) assumes that [10 CSR 20-6.010(3) Continuing Authorities] has been or will be addressed in a Missouri State Operating Permit or Construction Permit Application.
2. A WQRS does not indicate approval or disapproval of alternative analysis as per [10 CSR 20-7.015(4) Losing Streams], and/or any section of the effluent regulations.
3. Changes to Federal and State Regulations made after the drafting of this WQRS may alter Water Quality Based Effluent Limits (WQBEL).
4. Effluent limitations derived from Federal or Missouri State Regulations (FSR) may be WQBEL or Effluent Limit Guidelines (ELG).
5. WQBEL supercede ELG only when they are more stringent. Mass limits derived from technology based limits are still appropriate.
6. A WQRS does not allow discharges to waters of the state, and shall not be construed as a National Pollution Discharge Elimination System or Missouri State Operating Permit to discharge or a permit to construct, modify, or upgrade.
7. Limitations and other requirements in a WQRS may change as Water Quality Standards, Methodology, and Implementation procedures change.

MIXING CONSIDERATIONS

Mixing Zone (MZ): Not Allowed [10 CSR 20-7.031(4)(A)4.B.(I)(a)].

Zone of Initial Dilution (ZID): Not Allowed [10 CSR 20-7.031(4)(A)4.B.(I)(b)]

PERMIT LIMITS AND INFORMATION

WASTELOAD ALLOCATION
STUDY CONDUCTED (Y OR N):

N

USE ATTAINABILITY
ANALYSIS CONDUCTED (Y OR N):

N

WHOLE BODY CONTACT
USE RETAINED (Y OR N):

Y

OUTFALL #001

WET TEST (Y OR N):

N

FREQUENCY:

NA

AEC:

NA

METHOD:

NA

Kenwood Lake Estates WWTF
 11/14/07
 Page 3

PARAMETER	DAILY MAXIMUM	WEEKLY AVERAGE	MONTHLY AVERAGE	WQBEL (NOTE 2)	MONITORING FREQUENCY
FLOW	*		*	N/A	ONCE/QUARTER
BOD ₅ (MG/L)		45	30	FSR	ONCE/QUARTER
TSS (MG/L)		45	30	FSR	ONCE/QUARTER
PH (S.U.)	6.0 – 9.0		6.0 – 9.0	FSR	ONCE/QUARTER
TEMPERATURE (°C)	*		*	N/A	ONCE/QUARTER
AMMONIA AS N (MG/L) (MAY 1 – OCT 31)	4.0		1.6	Y	ONCE/QUARTER
AMMONIA AS N (MG/L) (NOV 1 – APR 30)	7.8		3.0	Y	ONCE/QUARTER
ESHERICHIA COLIFORM (E. COLI)	Please see the E. coli discussion in the Derivation & Discussion of Limits section of this WQRS below.				
FECAL COLIFORM (NOTE 1)	1000		400**	FSR	ONCE/QUARTER
CHLORINE, TOTAL RESIDUAL (MG/L)	0.017		0.008	Y	ONCE/QUARTER

* - Monitoring requirements only.

** - The Monthly Average for Fecal Coliform shall be reported as a Geometric Mean.

NOTE 1 – COLONIES/100 ML

NOTE 2 – THIS FIELD INFORMS THE APPLICANT IF THE PARAMETER'S EFFLUENT LIMITATION IS A WATER QUALITY BASED EFFLUENT LIMITATION (WQBEL): Y – YES; FSR – FEDERAL/STATE REGULATION; AND N/A – NOT APPLICABLE. ALSO, PLEASE SEE THE GENERAL ASSUMPTIONS OF THE WQRS #4 & #5.

RECEIVING WATER MONITORING REQUIREMENTS

No receiving water monitoring requirements recommended at this time.

DERIVATION AND DISCUSSION OF LIMITS

Wasteload allocations were calculated using water quality criteria or water quality model results and the dilution equation below:

$$C = \frac{(C_s \times Q_s) + (C_e \times Q_e)}{(Q_e + Q_s)} \quad (\text{EPA/505/2-90-001, Section 4.5.5})$$

Where C = downstream concentration

C_s = upstream concentration

Q_s = upstream flow

C_e = effluent concentration

Q_e = effluent flow

Chronic wasteload allocations were determined using applicable chronic water quality criteria (CCC: criteria continuous concentration). Acute wasteload allocations were determined using applicable water quality criteria (CMC: criteria maximum concentration).

Water quality based maximum daily and average monthly effluent limitations were calculated using methods and procedures outlined in USEPA's "Technical Support Document For Water Quality-based Toxics Control" (EPA/505/2-90-001).

Kenwood Lake Estates WWTF
 11/14/07
 Page 4

Outfall #001 – Main Facility Outfall

- **Biochemical Oxygen Demand (BOD₅).** 30 mg/L monthly average, 45 mg/L weekly average [10 CSR 20-7.015(8)(B)1]. Influent monitoring may be required for this facility in its Missouri State Operating Permit.
- **Total Suspended Solids (TSS).** 30 mg/L monthly average, 45 mg/L weekly average [10 CSR 20-7.015(8)(B)1]. Influent monitoring may be required for this facility in its Missouri State Operating Permit.
- **pH.** pH shall be maintained in the range from six to nine (6 – 9) standard units [10 CSR 20-7.015 (8)(B)2.].
- **Temperature.** Monitoring requirement only. Temperature affects the toxicity of Ammonia.
- **Total Ammonia Nitrogen.** Early Life Stages Present Total Ammonia Nitrogen criteria apply [10 CSR 20-7.031(4)(B)7.C. & Table B3]. Background total ammonia nitrogen = 0.01 mg/L

Season	Temp (°C)	pH (SU)	Total Ammonia Nitrogen CCC (mg N/L)	Total Ammonia Nitrogen CMC (mg N/L)
Summer	26	7.8	1.5	12.1
Winter	6	7.8	3.1	12.1

Summer: May 1 – October 31, Winter: November 1 – April 30.

Staff utilized a modified Feed Forward Reaction decay formula to allow degradation for ammonia prior to reaching the first classified water body:

$$[\text{NH}_3\text{N}]_t = [\text{NH}_3\text{N}]_{t=0} * e^{-kt}$$

Where

$[\text{NH}_3\text{N}]_t$ = ammonia concentration at confluence with classified segment.

$[\text{NH}_3\text{N}]_{t=0}$ = ammonia concentration at pipe = C_e

k = NH_3 oxidation per day $(k_{1,20})\Xi_1^{(\text{Temp}-20)}$

$$k_{1,20} = 0.3(\text{day}^{-1})$$

$$\Xi_1 = \text{temperature correction factor} = 1.083$$

t = time for effluent to travel to first classified segment (in days) = 0.23

Travel time was calculated using site-specific data submitted by Strickland Engineering, Inc.

Summer Temp. = 26°C

$$\text{Given } k = (0.3)(1.083)^{(26 - 20)} = 0.4841 \text{ and } t = 0.23 \text{ days; } e^{-kt} = e^{-(0.4841)(0.23)} = 0.89.$$

Which means 89 % of the ammonia concentration remains after leaving the facility and reaching the first classified stream segment.

$$C_e = (1.5 \text{ mg/L}) / 0.89 = 1.7 \text{ mg/L}$$

Kenwood Lake Estates WWTF
 11/14/07
 Page 5

$$LTA_c = 1.7 \text{ mg/L (0.780)} = \mathbf{1.3 \text{ mg/L}} \quad [CV = 0.6, 99^{\text{th}} \text{ Percentile, 30 day average}]$$

$$\begin{aligned} MDL &= 1.3 \text{ mg/L (3.11)} = 4.0 \text{ mg/L} & [CV = 0.6, 99^{\text{th}} \text{ Percentile}] \\ AML &= 1.3 \text{ mg/L (1.19)} = 1.6 \text{ mg/L} & [CV = 0.6, 95^{\text{th}} \text{ Percentile, } n = 30] \end{aligned}$$

Winter Temp. = 6°C

$$\text{Given } k = (0.3)(1.083)^{(6-20)} = 0.0982 \text{ and } t = 0.23 \text{ days; } e^{-kt} = e^{-(0.0982)(0.23)} = 0.98.$$

Which means 98 % of the ammonia concentration remains after leaving the facility and reaching the first classified stream segment.

$$C_e = (3.1 \text{ mg/L}) / 0.98 = 3.2 \text{ mg/L}$$

$$LTA_c = 3.2 \text{ mg/L (0.780)} = \mathbf{2.5 \text{ mg/L}} \quad [CV = 0.6, 99^{\text{th}} \text{ Percentile, 30 day average}]$$

$$\begin{aligned} MDL &= 2.5 \text{ mg/L (3.11)} = 7.8 \text{ mg/L} & [CV = 0.6, 99^{\text{th}} \text{ Percentile}] \\ AML &= 2.5 \text{ mg/L (1.19)} = 3.0 \text{ mg/L} & [CV = 0.6, 95^{\text{th}} \text{ Percentile, } n = 30] \end{aligned}$$

Season	Maximum Daily Limit (mg/l)	Average Monthly Limit (mg/l)
Summer	4.0	1.6
Winter	7.8	3.0

- **Fecal Coliform.** Discharge shall not contain more than a monthly geometric mean of 400 colonies/100 mL and a daily maximum of 1000 colonies/100 mL during the recreational season (April 1 – October 31) [10 CSR 20-7.015(8)(B)4.A.]. Future renewals of the facility operating permit will contain effluent limitations for E. coli that will replace fecal coliform as the applicable bacteria criteria in Missouri's water quality standards when Missouri adopts the implementation of the E. coli standards. Also, please see **GENERAL ASSUMPTIONS OF THE WQRS #7.**
- **Total Residual Chlorine (TRC).** Warm-water Protection of Aquatic Life CCC = 10 µg/L, CMC = 19 µg/L [10 CSR 20-7.031, Table A]. Background TRC = 0.0 µg/L. Mixing considerations not allowed due to facility discharging into an unclassified tributary of Hubble Creek. Therefore, WLA equals the water quality crite

$$C_e = (((Q_e + Q_s) * C) - (Q_s * C_s)) / Q_e$$

$$\begin{aligned} \text{Chronic WLA: } C_e &= 10 \text{ } \mu\text{g/L} \\ \text{Acute WLA: } C_e &= 19 \text{ } \mu\text{g/L} \end{aligned}$$

$$\begin{aligned} LTA_c &= 10 \text{ } \mu\text{g/L (0.527)} = \mathbf{5.3 \text{ } \mu\text{g/L}} & [CV = 0.6, 99^{\text{th}} \text{ Percentile}] \\ LTA_s &= 19 \text{ } \mu\text{g/L (0.321)} = 6.1 \text{ } \mu\text{g/L} & [CV = 0.6, 99^{\text{th}} \text{ Percentile}] \end{aligned}$$

$$\begin{aligned} MDL &= \mathbf{5.3 \text{ } \mu\text{g/L (3.11)}} = 16.5 \text{ } \mu\text{g/L} & [CV = 0.6, 99^{\text{th}} \text{ Percentile}] \\ AML &= \mathbf{5.3 \text{ } \mu\text{g/L (1.55)}} = 8.2 \text{ } \mu\text{g/L} & [CV = 0.6, 95^{\text{th}} \text{ Percentile, } n = 4] \end{aligned}$$

Total Residual Chlorine effluent limits of 0.017 mg/L daily maximum, 0.008 mg/L monthly average are recommended if chlorine is used as a disinfectant. Standard compliance language for TRC, including the minimum level (ML), should be included in the permit.

Kenwood Lake Estates WWTF
11/14/07
Page 6

Reviewer: Todd J. Blanc
Date: 11/14/07
Unit Chief: Refaat Mefrakis

Monitoring and effluent limits contained within this document have been developed in accordance with EPA guidelines using the best available data and are believed to be consistent with Missouri's Water Quality Standards and Effluent Regulations. If additional water quality data or anecdotal information are available that may affect the recommended monitoring and effluent limits, please forward these data and information to the author.

**STANDARD CONDITIONS FOR NPDES PERMITS
ISSUED BY
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION**

**Revised
October 1, 1980**

**PART I - GENERAL CONDITIONS
SECTION A - MONITORING AND REPORTING**

1. **Representative Sampling**
 - a. Samples and measurements taken as required herein shall be representative of the nature and volume, respectively, of the monitored discharge. All samples shall be taken at the outfall(s), and unless specified, before the effluent joins or is diluted by any other body of water or substance.
 - b. Monitoring results shall be recorded and reported on forms provided by the Department, postmarked no later than the 28th day of the month following the completed reporting period. Signed copies of these, and all other reports required herein, shall be submitted to the respective Department Regional Office, the Regional Office address is indicated in the cover letter transmitting the permit.
2. **Schedule of Compliance**

No later than fourteen (14) calendar days following each date identified in the "Schedule of Compliance", the permittee shall submit to the respective Department Regional Office as required therein, either a report of progress or, in the case of specific actions being required by identified dates, a written notice of compliance or noncompliance. In the latter case, the notice shall include the cause of noncompliance, any remedial actions taken, and the probability of meeting the next scheduled requirements, or if there are no more scheduled requirements, when such noncompliance will be corrected. The Regional Office address is indicated in the cover letter transmitting the permit.
3. **Definitions**

Definitions as set forth in the Missouri Clean Water Law and Missouri Clean Water Commission Definition Regulation 10 CSR 20-2.010 shall apply to terms used herein.
4. **Test Procedures**

Test procedures for the analysis of pollutant shall be in accordance with the Missouri Clean Water Commission Effluent Regulation 10 CSR 20-7015.
5. **Recording of Results**
 - a. For each measurement or sample taken pursuant to the requirements of this permit, the permittee shall record the following information:
 - (i) the date, exact place, and time of sampling or measurements;
 - (ii) the individual(s) who performed the sampling or measurements;
 - (iii) the date(s) analyses were performed;
 - (iv) the individual(s) who performed the analyses;
 - (v) the analytical techniques or methods used; and
 - (vi) the results of such analyses.
 - b. The Federal Clean Water Act provides that any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under this permit shall, upon conviction, be punished by a fine of not more than \$10,000 per violation, or by imprisonment for not more than six (6) months per violation, or both.
 - c. Calculations for all limitations which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified by the Director in the permit.
6. **Additional Monitoring by Permittee**

If the permittee monitors any pollutant at the location(s) designated herein more frequently than required by this permit, using approved analytical methods as specified above, the results of such monitoring shall be included in the calculation and reporting of the values required in the Monitoring Report Form. Such increased frequency shall also be indicated.

7. **Records Retention**

The permittee shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recording for continuous monitoring instrumentation, copies of all reports required by this permit, and records of all data used to complete the application for this permit, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Department at any time.

SECTION B - MANAGEMENT REQUIREMENTS

1. **Change in Discharge**
 - a. All discharges authorized herein shall be consistent with the terms and conditions of this permit. The discharge of any pollutant not authorized by this permit or any pollutant identified in this permit more frequently than or at a level in excess of that authorized shall constitute a violation of the permit.
 - b. Any facility expansions, production increases, or process modifications which will result in new, different, or increased discharges of pollutants shall be reported by submission of a new NPDES application at least sixty (60) days before each such change, or, if they will not violate the effluent limitations specified in the permit, by notice to the Department at least thirty (30) days before such changes.
2. **Noncompliance Notification**
 - a. If, for any reason, the permittee does not comply with or will be unable to comply with any daily maximum effluent limitation specified in this permit, the permittee shall provide the Department with the following information, in writing within five (5) days of becoming aware of such conditions:
 - (i) a description of the discharge and cause of noncompliance, and
 - (ii) the period of noncompliance, including exact dates and times or, if not corrected, the anticipated time the noncompliance is expected to continue, and steps being taken to reduce, eliminate and prevent recurrence of the noncomplying discharge.
 - b. Twenty-four hour reporting. The permittee shall report any noncompliance which may endanger health or the environment. Any information shall be provided orally with 24 hours from the time the permittee becomes aware of the circumstances. A written submission shall also be provided with five (5) days of the time the permittee becomes aware of the circumstances. The Department may waive the written report on a case-by-case basis if the oral report has been received within 24 hours.
3. **Facilities Operation**

Permittees shall operate and maintain facilities to comply with the Missouri Clean Water Law and applicable permit conditions. Operators or supervisors of operations at publicly owned or publicly regulated wastewater treatment facilities shall be certified in accordance with 10 CSR 209.020(2) and any other applicable law or regulation. Operators of other wastewater treatment facilities, water contaminant source or point sources, shall, upon request by the Department, demonstrate that wastewater treatment equipment and facilities are effectively operated and maintained by competent personnel.
4. **Adverse Impact**

The permittee shall take all necessary steps to minimize any adverse impact to waters of the state resulting from noncompliance with any effluent limitations specified in this permit or set forth in the Missouri Clean Water Law and Regulations (hereinafter the Law and Regulations), including such accelerated or additional monitoring as necessary to determine the nature and impact of the noncomplying discharge.

- a. Any bypass or shut down of a wastewater treatment facility and tributary sewer system or any part of such a facility and sewer system that results in a violation of permit limits or conditions is prohibited except:
 - (i) where unavoidable to prevent loss of life, personal injury, or severe property damages; and
 - (ii) where unavoidable excessive storm drainage or runoff would catastrophically damage any facilities or processes necessary for compliance with the effluent limitations and conditions of this permit;
 - (iii) where maintenance is necessary to ensure efficient operation and alternative measures have been taken to maintain effluent quality during the period of maintenance.
 - b. The permittee shall notify the Department in writing of all bypasses or shut down that result in a violation of permit limits or conditions. This section does not excuse any person from liability, unless such relief is otherwise provided by the statute.
6. **Removed Substances**
Solids, sludges, filter backwash, or any other pollutants removed in the course of treatment or control of wastewaters shall be disposed of in a manner such as to prevent any pollutants from entering waters of the state unless permitted by the Law, and a permanent record of the date and time, volume and methods of removal and disposal of such substances shall be maintained by the permittee.
 7. **Power Failures**
In order to maintain compliance with the effluent limitations and other provisions of this permit, the permittee shall either:
 - a. in accordance with the "Schedule of Compliance", provide an alternative power source sufficient to operate the wastewater control facilities; or,
 - b. if such alternative power source is not in existence, and no date for its implementation appears in the Compliance Schedule, halt or otherwise control production and all discharges upon the reduction, loss, or failure of the primary source of power to the wastewater control facilities.
 8. **Right of Entry**
For the purpose of inspecting, monitoring, or sampling the point source, water contaminant source, or wastewater treatment facility for compliance with the Clean Water Law and these regulations, authorized representatives of the Department, shall be allowed by the permittee, upon presentation of credentials and at reasonable times;
 - a. to enter upon permittee's premises in which a point source, water contaminant source, or wastewater treatment facility is located or in which any records are required to be kept under terms and conditions of the permit;
 - b. to have access to, or copy, any records required to be kept under terms and conditions of the permit;
 - c. to inspect any monitoring equipment or method required in the permit;
 - d. to inspect any collection, treatment, or discharge facility covered under the permit; and
 - e. to sample any wastewater at any point in the collection system or treatment process.
 9. **Permits Transferable**
 - a. Subject to Section (3) of 10 CSR 20-6.010 an operating permit may be transferred upon submission to the Department of an application to transfer signed by a new owner. Until such time as the permit is officially transferred, the original permittee remains responsible for complying with the terms and conditions of the existing permit.
 - b. The Department, within thirty (30) days of receipt of the application shall notify the new permittee of its intent to revoke and reissue or transfer the permit.
 10. **Availability of Reports**
Except for data determined to be confidential under Section 308 of the Act, and the Law and Missouri Clean Water Commission Regulation for Public Participation, Hearings and Notice to Governmental Agencies 10 CSR 20-6.020, all reports prepared in accordance with the terms of this permit shall be available for public inspection at the offices of the Department. As required by statute, effluent data shall not be considered confidential. Knowingly making any false statement on any such report shall be subject to the imposition of criminal penalties as provided in Section 204.076 of the Law.
 - a. Subject to compliance with statutory requirements of the Law and Regulations and applicable Court Order, this permit may be modified, suspended, or revoked in whole or in part during its term for cause including, but not limited to, the following:
 - (i) violation of any terms or conditions of this permit or the Law;
 - (ii) having obtained this permit by misrepresentation or failure to disclose fully any relevant facts;
 - (iii) a change in any circumstances or conditions that requires either a temporary or permanent reduction or elimination of the authorized discharge, or
 - (iv) any reason set forth in the Law and Regulations.
 - b. The filing of a request by the permittee for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance, does not stay any permit condition.
12. **Permit Modification - Less Stringent Requirements**
If any permit provisions are based on legal requirements which are lessened or removed, and should no other basis exist for such permit provisions, the permit shall be modified after notice and opportunity for a hearing.
 13. **Civil and Criminal Liability**
Except as authorized by statute and provided in permit conditions on "Bypassing" (Standard Condition B-5) and "Power Failures" (Standard Condition B-7) nothing in this permit shall be construed to relieve the permittee from civil or criminal penalties for noncompliance.
 14. **Oil and Hazardous Substance Liability**
Nothing in this permit shall be construed to preclude the institution of any legal action or relieve the permittee from any responsibilities, liabilities, or penalties to which the permittee is or may be subject under Section 311 of the Act, and the Law and Regulations. Oil and hazardous materials discharges must be reported in compliance with the requirements of the Federal Clean Water Act.
 15. **State Laws**
Nothing in this permit shall be construed to preclude the institution of any legal action or relieve the permittee from any responsibilities, liabilities, or penalties established pursuant to any applicable state statute or regulations.
 16. **Property Rights**
The issuance of this permit does not convey any property rights in either real or personal property, or any exclusive privileges, nor does it authorize any injury to private property or any invasion of personal rights, nor any infringement of or violation of federal, state or local laws or regulations.
 17. **Duty to Reapply**
If the permittee wishes to continue an activity regulated by this permit after the expiration date of this permit, the permittee must apply for a new permit 180 days prior to expiration of this permit.
 18. **Toxic Pollutants**
If a toxic effluent standard, prohibition, or schedule of compliance is established, under Section 307(a) of the Federal Clean Water Act for a toxic pollutant in the discharge of permittee's facility and such standard is more stringent than the limitations in the permit, then the more stringent standard, prohibition, or schedule shall be incorporated into the permit as one of its conditions, upon notice to the permittee.
 19. **Signatory Requirement**
All reports, or information submitted to the Director shall be signed (see 40 CFR-122.6).
 20. **Rights Not Affected**
Nothing in this permit shall affect the permittee's right to appeal or seek a variance from applicable laws or regulations as allowed by law.
 21. **Severability**
The provisions of this permit are severable, and if any provisions of this permit, or the application of any provision of this permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.

**STANDARD CONDITIONS FOR NPDES PERMITS
ISSUED BY
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION
AUGUST 15, 1994**

PART III – SLUDGE & BIOSOLIDS FROM DOMESTIC WASTEWATER TREATMENT FACILITIES

SECTION A – GENERAL REQUIREMENTS

1. This permit pertains to sludge requirements under the Missouri Clean Water Law and regulation and incorporates applicable federal sludge disposal requirements under 40 CFR 503. The Environmental Protection Agency (EPA) has principal authority for permitting and enforcement of the federal sludge regulations under 40 CFS 503 until such time as Missouri is delegated the new EPA sludge program. EPA has reviewed and accepted these standard sludge conditions. EPA may choose to issue a separate sludge addendum to this permit or a separate federal sludge permit at their discretion to further address federal requirements.
2. These PART III Standard Conditions apply only to sludge and biosolids generated at domestic wastewater treatment facilities, including public owned treatment works (POTW) and privately owned facilities.
3. Sludge and Biosolids Use and Disposal Practices.
 - a. Permittee is authorized to operate the sludge and biosolids treatment, storage, use, and disposal facilities listed in the facility description of this permit.
 - b. Permittee shall not exceed the design sludge volume listed in the facility description and shall not use sludge disposal methods that are not listed in the facility description, without prior approval of the permitting authority.
 - c. Permittee is authorized to operate the storage, treatment or generating sites listed in the Facility Description section of this permit.
 - d. A separate operating permit is required for each operating location where sludge or biosolids are generated, stored, treated, or disposed, unless specifically exempted in this permit or in 10 CSR 20, Chapter 6 regulations. For land application, see section H, subsection 3 of these standard conditions.
4. Sludge Received From Other Facilities
 - a. Permittees may accept domestic wastewater sludge from other facilities including septic tank pumpings from residential sources as long as the design sludge volume is not exceeded and the treatment facility performance is not impaired.
 - b. The permittee shall obtain a signed statement from the sludge generator or hauler that certifies the type and source of the sludge.
 - c. Sludge received from out-of-state generators shall receive prior approval of the permitting authority and shall be listed in the facility description or special conditions section of the permit.
5. These permit requirements do not supersede nor remove liability for compliance with county and other local ordinances.
6. These permit requirements do not supersede nor remove liability for compliance with other environmental regulations such as odor emissions under the Missouri Air Pollution Control Law and regulations.
7. This permit may (after du process) be modified, or alternatively revoked and reissued, to comply with any applicable sludge disposal standard or limitation issued or approved under Section 405(d) of the Clean Water Act or under Chapter 644 RsMo.
8. In addition to the STANDARD CONDITIONS, the department may include sludge limitations in the special conditions portion or other sections of this permit.
9. Alternate Limits in Site Specific Permit.

Where deemed appropriate, the department may require an individual site specific permit in order to authorize alternate limitations:

 - a. An individual permit must be obtained for each operating location, including application sites.
 - b. To request a site specific permit, an individual permit application, permit fees, and supporting documents shall be submitted for each operating location. This shall include a detailed sludge/biosolids management plan or engineering report.
10. Exceptions to these Standard Conditions may be authorized on a case-by-case basis by the department, as follows:
 - a. The department will prepare a permit modification and follow permit public notice provisions as applicable under 10 CSR 20-6.020, 40 CFR 124.10, and 40 CFR 501.15(a)(2)(ix)(E). This includes notification of the owners of property located adjacent to each land application site, where appropriate.
 - b. Exceptions cannot be granted where prohibited by the federal sludge regulations under 40 CFR 503.
11. Compliance Period
Compliance shall be achieved as expeditiously as possible but no later than the compliance dates under 40 CFR 503.2.

SECTION B – DEFINITIONS

1. Biosolids means an organic fertilizer or soil amendment produced by the treatment of domestic wastewater sludge. Untreated sludge or sludge that does not conform to the pollutants and pathogen treatment requirements in this permit is not considered biosolids.
2. Biosolids land application facility is a facility where biosolids are spread onto the land at agronomic rates for production of food or fiber. The facility includes any structures necessary to store the biosolids until soil, weather, and crop conditions are favorable for land application.
3. Class A biosolids means a material that has met the Class A pathogen reduction requirements or equivalent treatment by a Process to Further Reduce Pathogens (PFRP) in accordance with 40 CFR 503.
4. Class B biosolids means a material that has met the Class B pathogen reduction requirements or equivalent treatment by a Process to Significantly Reduce Pathogens (PFRP) in accordance with 40 CFR 503.
5. Domestic wastewater means wastewater originating from the sanitary conveniences of residences, commercial buildings, factories and institutions; or co-mingled sanitary and industrial wastewater processed by a public owned treatment works (POTW) or privately owned facility.
6. Mechanical treatment plants are wastewater treatment facilities that use mechanical devices to treat wastewater, including septic tanks, extended aeration, activated sludge, contact stabilization, trickling filters, rotating biological discs, and other similar facilities. It does not include unaerated wastewater treatment lagoons and constructed wetlands for wastewater treatment.
7. Operating location as defined in 10 CSR 20-2.010 is all contiguous lands owned, operated or controlled by one (1) person or by two (2) or more persons jointly or as tenants in common.
8. Plant Available Nitrogen (PAN) is the nitrogen that will be available to plants during the next growing season after biosolids application.
9. Sinkhole is a depression in the land surface into which surface water flows to join an underground drainage system.
10. Site Specific Permit is a permit that has alternate limits developed to address specific site conditions for each land application site or storage site.
11. Sludge is the solid, semisolid, or liquid residue removed during the treatment of wastewater. Sludge includes septage removed from septic tanks.
12. Sludge lagoon is an earthen basin that receives sludge that has been removed from a wastewater treatment facility. It does not include a wastewater treatment lagoon or sludge treatment units that are not a part of a mechanical wastewater treatment facility.
13. Wetlands are those areas that are inundated or saturated by surface or groundwater at a frequency and duration sufficient to support, and that under normal circumstances do support, a prevalence of vegetation typically adapted for life in saturated soil conditions. Wetlands generally include swamp, marshes, bogs, and similar areas. Wetlands do not include constructed wetlands used for wastewater treatment.

SECTION C – MECHANICAL WASTEWATER TREATMENT FACILITIES

1. Sludge shall be routinely removed from the wastewater treatment facilities and handled according to the permit facility description and sludge conditions in this permit.
2. The permittee shall operate the facility so that there is no sludge loss into the discharged effluent in excess of permit limits, no sludge bypassing, and no discharge of sludge to waters of the state.
3. Mechanical treatment plants shall have separate sludge storage compartments in accordance with 10 CSR 20, Chapter 8. Failure to remove sludge from these storage compartments on the required design schedule is a violation of this permit.

SECTION D – SLUDGE DISPOSED AT OTHER TREATMENT FACILITY OR CONTRACT HAULER

1. This section applies to permittees that haul sludge to another treatment facility for disposal or use contract haulers to remove and dispose of sludge.
2. Permittees that use contract haulers are responsible for compliance with all the terms of this permit including final disposal, unless the hauler has a separate permit for sludge or biosolids disposal issued by the department; or the hauler transports the sludge to another permitted treatment facility.
3. The permittee shall require documentation from the contractor of the disposal methods used and permits obtained by the contractor.
4. Testing of sludge, other than total solids content, is not required if sludge is hauled to a municipal wastewater treatment facility or other permitted wastewater treatment facility.

SECTION E – WASTEWATER TREATMENT LAGOONS AND STORMWATER RETENTION BASINS

1. Sludge that is retained within a wastewater treatment lagoon is subject to sludge disposal requirements when the sludge is removed from the lagoon or when the lagoon ceases to receive and treat wastewater.
2. If sludge is removed during the year, an annual sludge report must be submitted.
3. Storm water retention basins or other earthen basins, which have been used as sludge storage for a mechanical treatment system is considered a sludge lagoon and must comply with Section G of this permit.

SECTION F – INCINERATION OF SLUDGE

1. Sludge incineration facilities shall comply with the requirements of 40 CFR 503 Subpart E; air pollution control regulations under 10 CSR 10; and solid waste management regulations under 10 CSR 80.
2. Permittee may be authorized under the facility description of this permit to store incineration ash in lagoons or ash ponds. This permit does not authorize the disposal of incineration ash. Incineration ash shall be disposed in accordance with 10 CSR 80; or if the ash is determined to be hazardous waste, shall be disposed in accordance with 10 CSR 25.
3. In addition to normal sludge monitoring, incineration facilities shall report the following as part of the annual report, quantity of sludge incinerated, quantity of ash generated, quantity of ash stored; and ash use or disposal method, quantity, and location. Permittee shall also provide the name of the disposal facility and the applicable permit number.
4. Additional limitations, monitoring, and reporting requirements may be addressed in the Special Conditions sections of this permit.

SECTION G – SURFACE DISPOSAL SITES AND SLUDGE LAGOONS

1. Surface disposal sites shall comply with the requirements in 40 CFR 503 Subpart C, and solid waste disposal regulations under 10 CSR 80.
2. Additional limitations, monitoring, and reporting requirements may be addressed in the Special Conditions section of this permit.
3. Effective February 19, 1995, a sludge lagoon that has been in use for more than two years without removal of accumulated sludge, or that has not been properly closed shall comply with one of the following options:
 - a. Permittee shall obtain a site specific permit to address surface disposal requirements under 40 CFR 503, ground water quality regulations under 10 CSR 20, Chapter 7 and 8, and solid waste management regulations under 10 CSR 80;
 - b. Permittee shall clean out the sludge lagoon to remove any sludge over two years old and shall continue to remove accumulated sludge at least every two years or an alternate schedule approved under 40 CFR 503.20(b). In order to avoid damage to the lagoon seal during cleaning, the permittee may leave a layer of sludge on the bottom of the lagoon, upon prior approval of the department; or
 - c. Permittee shall close the lagoon in accordance with Section 1.

SECTION H – LAND APPLICATION

1. The permittee shall not land apply sludge or biosolids unless land application is authorized in the Facility Description or special conditions section of the permit.
2. This permit replaces and terminates all previous sludge management plan approvals by the department for land application of sludge or biosolids.
3. Land application sites within a 20 mile radius of the wastewater treatment facility are authorized under this permit when biosolids are applied for beneficial use in accordance with these standard conditions unless a site specific permit is required under Section A, Subsection 9.
4. Biosolids shall not be applied unless authorized in this permit or exempted under 10 CSR 20, Chapter 6.
 - a. This permit does not authorize the land application of sludge except when sludge meets the definition of biosolids.
 - b. This permit authorizes “Class A or B” biosolids derived from domestic wastewater sludges to be land applied onto grass land, crop land, timber land or other similar agricultural or silviculture lands at rates suitable for beneficial use as organic fertilizer and soil conditioner.
5. Public Contact Sites.

Permittees who wish to apply Class A biosolids to public contact sites must obtain approval from the department. Applications for approval shall be in the form of an engineering report and shall address priority pollutants and dioxin concentrations. Authorization for land applications must be provided in the special conditions section of this permit or in a separate site-specific permit.

6. Agricultural and Silvicultural Sites.

In addition to specified conditions herein, this permit is subject to the attached Water Quality Guides numbers WQ 422 through 426 published by the University of Missouri, and hereby incorporated as though fully set forth herein. The guide topics are as follows:

WQ 422	Land Application of Septage
WQ 423	Monitoring Requirements for Biosolids Land Application
WQ 424	Biosolids Standards for Pathogens and Vectors
WQ 425	Biosolids Standards for Metals and Other Trace Substances
WQ 426	Best Management Practices for Biosolids Land Applications

SECTION I – CLOSURE REQUIREMENTS

1. This section applies to all wastewater treatment facilities (mechanical and lagoons) and sludge or biosolids storage and treatment facilities and incineration ash ponds. It does not apply to land application sites.
2. Permittees who plan to cease operation must obtain department approval of a closure plan which addresses proper removal and disposal of all residues, including sludge, biosolids, and ash. Permittee must maintain this permit until the facility is properly closed per 10 CSR 20-6.010 and 10 CSR 20-6.015.
3. Residuals that are left in place during closure of a lagoon or earthen structure shall not exceed the agricultural loading rates as follows:
 - a. Residuals shall meet the monitoring and land application limits for agricultural rates as referenced in Section H of these standard conditions.
 - b. If a wastewater treatment lagoon has been in operation for 15 years or more, the sludge in the lagoon qualifies for Class B with respect to pathogens (see WQ 424, Table 3), and testing for fecal coliform is not required. For other lagoons, testing for fecal coliform is required to show compliance with Class B limitations. See WQ 423 and 424.
 - c. The allowable nitrogen loading that may be left in the lagoon shall be based on the plant available nitrogen (PAN) loading. See WQ 426 for calculation procedures. For a grass cover crop, the allowable PAN is 300 pounds/acre.
4. When closing a wastewater treatment lagoon with a design treatment capacity equal or less than 150 persons, the residuals are considered “septage” under the similar treatment works” definition. See WQ 422. Under the septage category, residuals may be left in place as follows:
 - a. Testing for metals or fecal coliform is not required.
 - b. If the wastewater treatment lagoon has been in use for less than 15 years, mix lime with the sludge at the rate of 50 pounds of hydrated lime per 1000 gallons (134 cubic feet) of sludge.
 - c. The amount of sludge that may be left in the lagoon shall be based on the plant available nitrogen (PAN) loading. 100 dry tons/acre of sludge may be left in the basin without testing for nitrogen. If more than 100 dry tons/acre will be left in the lagoon, test for nitrogen and determine the PAN in accordance with WQ 426. Allowable PAN loading is 300 pounds/acre.
5. Residuals left within the lagoon shall be mixed with soil on at least a 1 to 1 ratio, the lagoon berms shall be demolished, and the site shall be graded and vegetated so as to avoid ponding of storm water and provide adequate surface water drainage without creating erosion.
6. Lagoon closure activities shall obtain a storm water permit for land disturbance activities that equal or exceed five acres in accordance with 10 CSR 20-6.200.
7. If sludge exceeds agricultural loading rates under Section H or I, a landfill permit or solid waste disposal permit shall be obtained to authorize on-site sludge disposal under the Missouri Solid Waste Management Law and regulations per 10 CSR 80, and the permittee must comply with the surface disposal requirements under 40 CFR 503, Subpart C.

SECTION J – MONITORING FREQUENCY

1. At a minimum, sludge or biosolids shall be tested for volume and percent total solids on a frequency that will accurately represent sludge quantities produced and disposed.
2. Testing for land application is listed under Section H, Subsection 6 of these standard conditions (see WQ 423). Once per year is the minimum test frequency. Additional testing shall be performed for each 100 dry tons of sludge generated or stored during the year.
3. Additional testing may be required in the special conditions or other sections of the permit. Permittees receiving industrial wastewater may be required to conduct additional testing upon request from the department.
4. Monitoring requirements shall be performed in accordance with, “POTW Sludge Sampling and Analysis Guidance Document”, United States Environmental Protection Agency, August 1989, and subsequent revisions.

SECTION K – RECORD KEEPING AND REPORTING REQUIREMENTS

1. The permittee shall maintain records on file at the facility for at least five years for the items listed in these Standard Conditions and any additional items in the Special Conditions section of this permit. This shall include dates when the sludge facility is checked for proper operation, records of maintenance and repairs and other relevant information.
2. Reporting Period
 - a. By January 28th of each year, an annual report shall be submitted for the previous calendar year period for all mechanical wastewater treatment facilities, sludge lagoons, and sludge or biosolids disposal facilities.
 - b. Permittees with wastewater treatment lagoons shall submit the above annual report only when sludge or biosolids are removed from the lagoon during the report period or when the lagoon is closed.
3. Report Forms. The annual report shall be submitted on report forms provided by the department or equivalent forms approved by the department.
4. Report shall be submitted as follows:
Major facilities (those serving 10,000 persons or 1 million gallons per day) shall report to both the department and EPA. Other facilities need to report only to the department. Reports shall be submitted to the addresses listed as follows:

DNR regional office listed in your permit
(See cover letter of permit)

EPA Region VII
Water Compliance Branch (WACM)
Sludge Coordinator
901 N 5th Street
Kansas City, KS 66101

5. Annual Report Contents. The annual report shall include the following:
 - a. Sludge/biosolids testing performed. Include a copy or summary of all test results, even if not required by this permit.
 - b. Sludge or Biosolids quantity shall be reported as dry tons for quantity generated by the wastewater treatment facility, the quantity stored on site at end of year, and the quantity used or disposed.
 - c. Gallons and % solids data used to calculate the dry ton amounts.
 - d. Description of any unusual operating conditions.
 - e. Final disposal method, dates, and location, and person responsible for hauling and disposal.
 - (1) This must include the name, address and permit number for the hauler and the sludge facility. If hauled to a municipal wastewater treatment facility, sanitary landfill, or other approved treatment facility, give the name and permit number of that facility.
 - (2) Include a description of the type of hauling equipment used and the capacity in tons, gallons, or cubic feet.
 - f. Contract Hauler Activities.
If contract hauler, provide a copy of a signed contract or billing receipts from the contractor. Permittee shall require the contractor to supply information required under this permit for which the contractor is responsible. The permittee shall submit a signed statement from the contractor that he has complied with the standards contained in this permit, unless the contract hauler has a separate sludge disposal or biosolids use permit.
 - g. Land Application Sites.
 - (1) Report the location of each application site, the annual and cumulative dry tons/acre for each site, and the landowners name and address. The location for each spreading site shall be given as legal description for nearest ¼, ¼, Section, Township, Range, and County, or as latitude and longitude.
 - (2) If biosolids application exceeds 2 dry tons/acre/year, report biosolids nitrogen results. Plant Available Nitrogen (PAN) in pounds/acre, crop nitrogen requirement, available nitrogen in the soil prior to biosolids application, and PAN calculations for each site.
 - (3) If the “Low Metals” criteria is exceeded, report the annual and cumulative pollutant loading rates in pounds per acre for each applicable pollutant, and report the percent of cumulative loading which has been reached at each site.
 - (4) Report the method used for compliance with pathogen and vector attraction requirements.
 - (5) Report soil test results for pH, CEC, and phosphorus. If none was tested during the year, report the last date when tested and results.

RECEIVED

OCT 27 2015

FOR AGENCY USE ONLY

CHECK NUMBER

P43

DATE RECEIVED

FEE SUBMITTED

10/27/15

\$1500.00



MISSOURI DEPARTMENT OF NATURAL RESOURCES
WATER PROTECTION PROGRAM

FORM B: APPLICATION FOR OPERATING PERMIT FOR FACILITIES THAT RECEIVE PRIMARILY DOMESTIC WASTE AND HAVE A DESIGN FLOW LESS THAN OR EQUAL TO 100,000 GALLONS PER DAY

READ THE ACCOMPANYING INSTRUCTIONS BEFORE COMPLETING THIS FORM

1. THIS APPLICATION IS FOR:

- An operating permit for a new or unpermitted facility. Construction Permit # 0001205
(Include completed antidegradation review or request for antidegradation review, see instructions)
- A new site-specific operating permit formerly general permit #MOG _____
- A site-specific operating permit renewal: Permit #MO- _____ Expiration Date _____
- A site-specific operating permit modification: Permit #MO- _____ Reason: _____
- General permit (MOGD – Non POTWs discharging < 50,000 GPD or MOG823 – Land Application of Domestic Wastewater):
Permit #MO- _____ Expiration Date _____

1.1 Is the appropriate fee included with the application (see instructions for appropriate fee)? YES NO

2. FACILITY

NAME
ENCLAVE LAKE ESTATES

TELEPHONE NUMBER WITH AREA CODE
(573) 332-1100

ADDRESS (PHYSICAL)
365 LAKEVIEW CROSSING

CITY
GORDONVILLE

STATE
MO

ZIP CODE
63701

2.1 Legal description: LG 231 $\frac{1}{4}$, $\frac{1}{4}$, $\frac{1}{4}$, Sec. , T 31N, R 13E County CAPE GIRARDEAU

2.2 UTM Coordinates Easting (X): 794530 Northing (Y): 4135425
For Universal Transverse Mercator (UTM), Zone 15 North referenced to North American Datum 1983 (NAD83)

2.3 Name of receiving stream: UNNAMED TRIBUTARY TO HUBBLE CREEK

2.4 Number of outfalls: 1 Wastewater outfalls: 1 Stormwater outfalls: Instream monitoring sites:

3. OWNER

NAME
ENCLAVE LAKE POA, INC.

EMAIL ADDRESS

TELEPHONE NUMBER WITH AREA CODE
(573) 332-1100

ADDRESS
832 S KINGSHIGHWAY

CITY
CAPE GIRARDEAU

STATE
MO

ZIP CODE
63703

3.1 Request review of draft permit prior to public notice? YES NO

3.2 Are you a publicly owned treatment works? YES NO

If yes, is the Financial Questionnaire attached? YES NO

3.3 Are you a privately owned treatment works? YES NO

3.4 Are you a privately owned treatment facility regulated by the Public Service Commission? YES NO

4. CONTINUING AUTHORITY: Permanent organization that will serve as the continuing authority for the operation, maintenance and modernization of the facility.

NAME
ENCLAVE LAKE POA, INC.

EMAIL ADDRESS

TELEPHONE NUMBER WITH AREA CODE
(573) 332-1100

ADDRESS
832 S KINGSHIGHWAY

CITY
CAPE GIRARDEAU

STATE
MO

ZIP CODE
63703

If the continuing authority is different than the owner, include a copy of the contract agreement between the two parties and a description of the responsibilities of both parties within the agreement.

5. OPERATOR

NAME
N/A

TITLE

CERTIFICATE NUMBER

EMAIL ADDRESS

TELEPHONE NUMBER WITH AREA CODE

6. FACILITY CONTACT

NAME
DANA LEGGANS

TITLE
DEVELOPER

EMAIL ADDRESS

TELEPHONE NUMBER WITH AREA CODE
(573) 332-1100

ADDRESS
832 S KINGSHIGHWAY


CITY
CAPE GIRARDEAU

STATE
MO

ZIP CODE
63703

7. DESCRIPTION OF FACILITY

7.1 Process Flow Diagram or Schematic: Provide a diagram showing the processes of the treatment plant. Show all of the treatment units, including disinfection (e.g. – chlorination and dechlorination), influents, and outfalls. Specify where samples are taken. Indicate any treatment process changes in the routing of wastewater during dry weather and peak wet weather. Include a brief narrative description of the diagram.
Attach sheets as necessary.

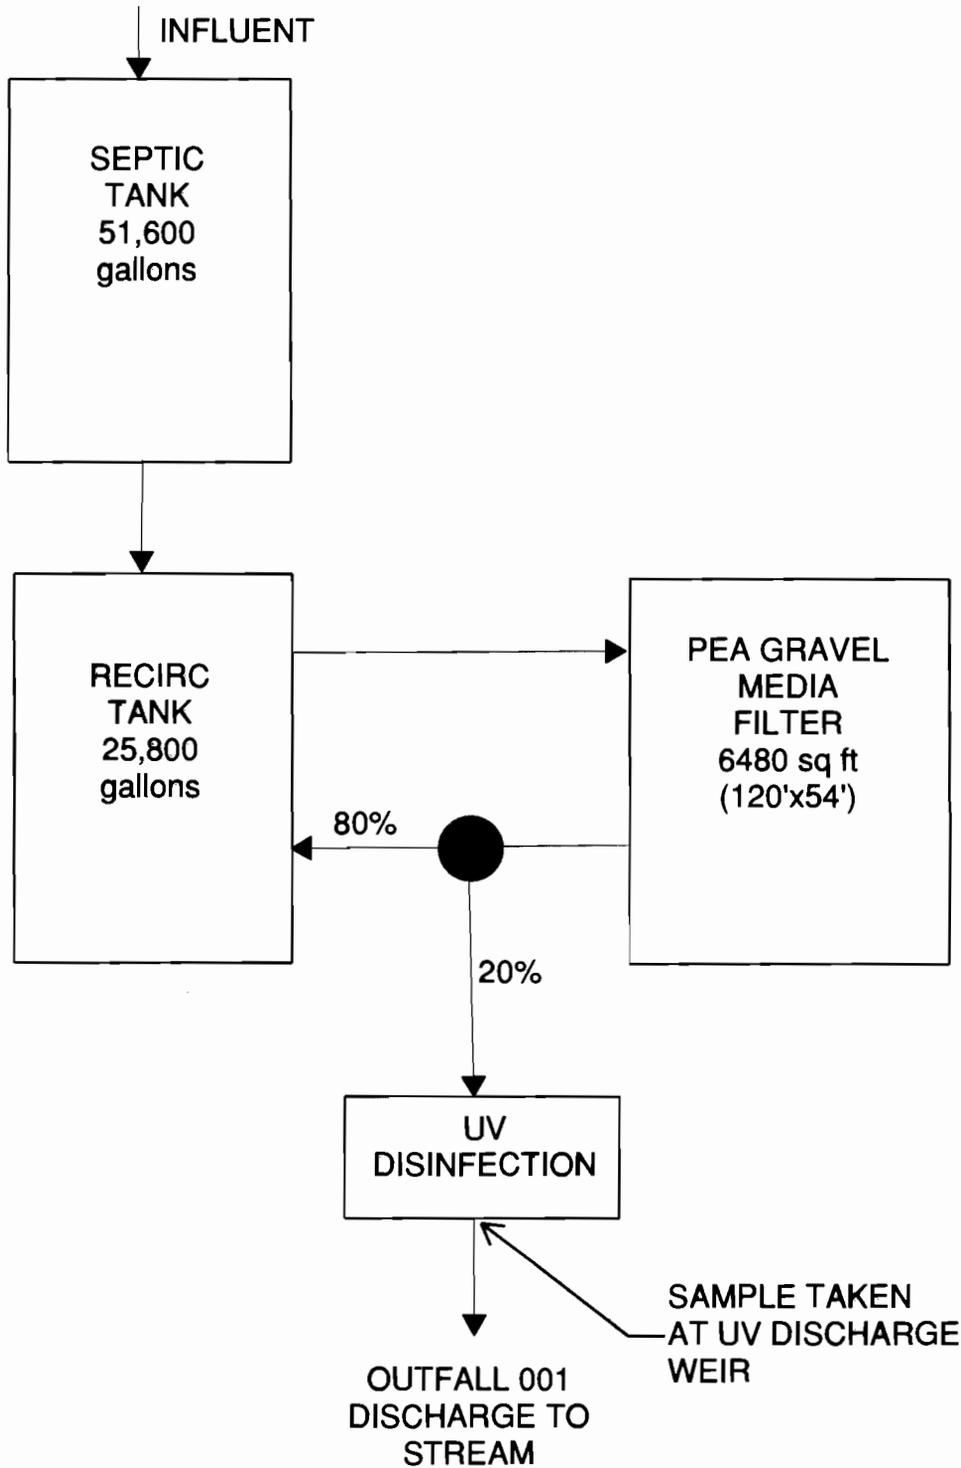

7.2 Attach an aerial photograph or USGS topographic map showing the location of the facility and outfall.

8. ADDITIONAL FACILITY INFORMATION	
8.1	Facility SIC code: <u>4952</u> Discharge SIC code: <u>4952</u>
8.2	Number of people presently connected or population equivalent (P.E.) _____ Design P.E. <u>258</u>
8.3	Connections to the facility: Number of units presently connected: Homes <u>10</u> Trailers _____ Apartments _____ Other (including industrial) _____ Number of commercial establishments: _____
8.4	Design flow: <u>25,800</u> Actual flow: _____
8.5	Will discharge be continuous through the year? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Discharge will occur during the following months: How many days of the week will discharge occur? <u>7</u>
8.6	Is industrial wastewater discharged to the facility? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No If yes, attach a list of the industries that discharge to your facility
8.7	Does the facility accept or process leachate from landfills? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
8.8	Is wastewater land applied? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No If yes, is Form I attached? <input type="checkbox"/> Yes <input type="checkbox"/> No
8.9	Does the facility discharge to a losing stream or sinkhole? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
8.10	Has a wasteload allocation study been completed for this facility? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
9. LABORATORY CONTROL INFORMATION	
LABORATORY WORK CONDUCTED BY PLANT PERSONNEL	
Lab work conducted outside of plant.	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
Push-button or visual methods for simple test such as pH, settleable solids.	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
Additional procedures such as dissolved oxygen, chemical oxygen demand, biological oxygen demand, titrations, solids, volatile content.	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
More advanced determinations such as BOD seeding procedures, fecal coliform, nutrients, total oils, phenols, etc.	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
Highly sophisticated instrumentation, such as atomic absorption and gas chromatograph.	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
10. COLLECTION SYSTEM	
10.1	Length of pipe in the sewer collection system? _____ Feet, or _____ Miles (either unit is appropriate)
10.2	Does significant infiltration occur in the collection system? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No If yes, briefly explain any steps underway or planned to minimize inflow and infiltration:
11. BYPASSING	
Does any bypassing occur in the collection system or at the treatment facility? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No If yes, explain:	

12. SLUDGE HANDLING, USE AND DISPOSAL

12.1 Is the sludge a hazardous waste as defined by 10 CSR 25? Yes No

12.2 Sludge production, including sludge received from others: 5.7 Design dry tons/year _____ Actual dry tons/year

12.3 Capacity of sludge holding structures:
 Sludge storage provided: 1478 cubic feet; 893 days of storage; 30 average percent solids of sludge;
 No sludge storage is provided. Sludge is stored in lagoon.

12.4 Type of Storage: Holding tank Building
 Basin Lagoon
 Concrete Pad Other (Describe) _____

12.5 Sludge Treatment:
 Anaerobic Digester Lagoon Composting
 Storage Tank Aerobic Digester Other (Attach description)
 Lime Stabilization Air or Heat Drying

12.6 Sludge Use or Disposal:
 Land Application Surface Disposal (Sludge Disposal Lagoon, Sludge held for more than two years)
 Contract Hauler Hauled to Another treatment facility
 Incineration Sludge Retained in Wastewater treatment lagoon
 Solid waste landfill

12.7 Person responsible for hauling sludge to disposal facility:
 By applicant By others (complete below)

NAME		EMAIL ADDRESS	
ADDRESS	CITY	STATE	ZIP CODE
CONTACT PERSON	TELEPHONE NUMBER WITH AREA CODE	PERMIT NO. MO-	

12.8 Sludge use or disposal facility
 By applicant By others (Complete below.)

NAME		EMAIL ADDRESS	
ADDRESS	CITY	STATE	ZIP CODE
CONTACT PERSON	TELEPHONE NUMBER WITH AREA CODE	PERMIT NO. MO-	

12.9 Does the sludge or biosolids disposal comply with federal sludge regulations under 40 CFR 503?
 Yes No (Explain)

13. CERTIFICATION

I certify that I am familiar with the information contained in the application, that to the best of my knowledge and belief such information is true, complete and accurate, and if granted this permit, I agree to abide by the Missouri Clean Water Law and all rules, regulations, orders and decisions, subject to any legitimate appeal available to applicant under the Missouri Clean Water Law.

NAME (TYPE OR PRINT) <i>Dana Leggans</i>	OFFICIAL TITLE <i>Manager-Enclave Lake Dero</i>	TELEPHONE NUMBER WITH AREA CODE <i>573-332-1100</i>
SIGNATURE <i>Dana Leggans</i>		DATE SIGNED <i>10/7/15</i>

STATE OF MISSOURI
DEPARTMENT OF NATURAL RESOURCES

Jeremiah W. (Jay) Nixon, Governor • Sara Parker Pauley, Director

www.dnr.mo.gov

January 6, 2012

Enclave Lake Devco, LLC
PO Box 1118NS
Granite City, IL 62040

RECEIVED

OCT 27 2015

Water Protection Program

Dear Sir(s):

Plans and Specifications prepared by Brian Strickland, P.E., Strickland Engineering for construction to serve The Enclave Lake Estates located in Cape Girardeau County, Missouri have been received by the Missouri Department of Natural Resources (MDNR). This submission, which included all the required documents, has been reviewed by staff at the Southeast Regional Office, and has been found to be in conformance with the Missouri Clean Water Law. Construction Permit No. CP0001205 is hereby issued. This permit authorizes construction of the facilities described on the permit. Approval of the MDNR must be obtained prior to making any changes from the approved plans and specifications. Please see page 2 for issuance and expiration dates. This permit may be extended one year upon written request to MDNR before the expiration date. Following completion of construction, the enclosed application must be completed and returned to MDNR.

If you were affected by this decision, you may appeal to have the matter heard by the administrative hearing commission. To appeal, you must file a petition with the administrative hearing commission within thirty days after the date this decision was mailed or the date it was delivered, whichever date was earlier. If any such petition is sent by registered mail or certified mail, it will be deemed filed on the date it is mailed; if it is sent by any method other than registered mail or certified mail, it will be deemed filed on the date it is received by the administrative hearing commission."

If one or more acres of land are disturbed over the life of this project, a permit for the discharge of storm water from all of the disturbed land (including individual house sites) may be required. Details are provided in storm water regulation 10 CSR 20-6.200. For more information about these requirements or to obtain the application forms, please contact the Southeast Regional Office at (573) 840-9750. Other environmental permits may also be required depending on the scope of the project. Please contact this office or the appropriate MDNR program to obtain information on other permits.

Sincerely,
SOUTHEAST REGIONAL OFFICE


Gary L. Gaines, P.E.
Regional Director

GLG/tSA

Enclosure

c: Brian Strickland, P.E., Strickland Engineering, 113 West Main Street, Jackson, MO 63755

DEPARTMENT OF NATURAL RESOURCES

MISSOURI CLEAN WATER COMMISSION



CONSTRUCTION PERMIT

The Missouri Department of Natural Resources hereby issues a permit to:

Enclave Lake Devco, LLC
P.O. Box 1118NS
Granite City, IL 62040

for the construction of (described facilities):

A 51,000 gallon septic tank, a 25,800 gallon recirculation tank with two pumps capable of pumping 350.5 gallons per minute against a TDH of 32.8 feet, a 58 feet by 124 feet recirculating sand filter, an 80-20 flow splitter, a chlorine disinfection unit, a dechlorination unit, approximately 3,304 lineal feet of 4" PVC forcemain, 3,497 lineal feet of 3" PVC forcemain, 2,918 lineal feet of 2" PVC forcemain, 80 lineal feet of 6" DIP, 393 lineal feet of 6" PVC gravity sewer, complete with all the necessary appurtenances to make a complete and usable system to serve The Enclave Lake Estates located in Gordonville, Missouri. Construction must adhere to plans and specifications submitted by Brian Strickland, P.E., on October 31, 2011.

Construction of such proposed facilities shall be in accordance with the provisions of the Missouri Clean Water Law, Chapter 644, RSMo. and regulation promulgated thereunder, or this permit may be revoked by the Department of Natural Resources

As the Department of Natural Resources does not examine structural features of design or the efficiency of mechanical equipment, the issuance of this permit does not include approval of these features.

A representative of the department may inspect the work covered by this permit during construction. Issuance of a permit to operate by the department will be contingent on the work substantially adhering to the approved plans and specifications

This permit applies only to the construction of water pollution control components; it does not apply to other environmentally regulated areas.

January 6, 2012

Effective Date

Sara Parker Pauley, Director, Department of Natural Resources

January 5, 2013

Expiration Date

Gary L. Gaines, P.E., Director, Southeast Regional Office

Filing Fee Paid
Check # 8783

