

STATE OF MISSOURI
DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION



MISSOURI STATE OPERATING PERMIT

In compliance with the Missouri Clean Water Law, (Chapter 644 R.S. Mo. as amended, hereinafter, the Law), and the Federal Water Pollution Control Act (Public Law 92-500, 92nd Congress) as amended,

Permit No. MO-0137812

Owner: DRS Technologies, Inc.
Address: 201 Evans Lane, St. Louis, MO 63121

Continuing Authority: Stephen Foster
Address: #1 McDaniel Street, West Plains, MO 65775

Facility Name: DRS-SSI
Facility Address: #1 McDaniel Street, West Plains, MO 65775

Legal Description: See page 2
UTM Coordinates: See page 2

Receiving Stream: See page 2
First Classified Stream and ID: See page 2
USGS Basin & Sub-watershed No.: See page 2

is authorized to discharge from the facility described herein, in accordance with the effluent limitations and monitoring requirements as set forth herein:

FACILITY DESCRIPTION

See page 2

This permit authorizes only stormwater discharges under the Missouri Clean Water Law and the National Pollutant Discharge Elimination System; it does not apply to other regulated areas. This permit may be appealed in accordance with Sections 640.013, 621.250, and 644.051.6 of the Law.

June 1, 2018

Effective Date

Handwritten signature of Edward B. Galbraith in blue ink.

Edward B. Galbraith, Director, Division of Environmental Quality

March 31, 2023

Expiration Date

Handwritten signature of Chris Wieberg in blue ink.

Chris Wieberg, Director, Water Protection Program

FACILITY DESCRIPTION (CONTINUED)

Truck and trailer as well as military armored vehicle manufacturing.

OUTFALL # 001 – Stormwater; SIC # 3715; NAICS # 336212

Legal Description: Sec.20, T24N, R08W, Howell County
UTM Coordinates: X = 601677, Y = 4066773
Receiving Stream: North Fork Howell Creek (C)
First Classified Stream and ID: North Fork Howell Creek; (C) WBID# 3960; losing
USGS Basin & Sub-watershed No.: Headwaters Howell Creek (11010010-0201)
Estimated flow: 1.09 MGD
Actual flow: Dependent upon precipitation

OUTFALL # 002 – Stormwater; SIC # 3715; NAICS # 336212

Legal Description: Sec.17, T24N, R08W, Howell County
UTM Coordinates: X = 601549, Y = 4066890
Receiving Stream: Tributary to North Fork Howell Creek
First Classified Stream and ID: North Fork Howell Creek; (C) WBID# 3960; losing
USGS Basin & Sub-watershed No.: Headwaters Howell Creek (11010010-0201)
Estimated flow: 0.42 MGD
Actual flow: Dependent upon precipitation

OUTFALL # 003 – Stormwater; SIC # 3715; NAICS # 336212

Legal Description: Sec.20, T24N, R08W, Howell County
UTM Coordinates: X = 601644, Y = 4066731
Receiving Stream: Tributary to North Fork Howell Creek
First Classified Stream and ID: North Fork Howell Creek; (C) WBID# 3960; losing
USGS Basin & Sub-watershed No.: Headwaters Howell Creek (11010010-0201)
Estimated flow: 0.49 MGD
Actual flow: Dependent upon precipitation

OUTFALL # 004 – Outfall eliminated in previous permit.

OUTFALL # 005 – Stormwater; SIC # 3715; NAICS # 336212

Legal Description: Sec.20, T24N, R08W, Howell County
UTM Coordinates: X = 601778, Y = 4066599
Receiving Stream: Tributary to North Fork Howell Creek
First Classified Stream and ID: North Fork Howell Creek; (C) WBID# 3960; losing
USGS Basin & Sub-watershed No.: Headwaters Howell Creek (11010010-0201)
Estimated flow: 0.81 MGD
Actual flow: Dependent upon precipitation

OUTFALL # 006 – Stormwater; SIC # 3715; NAICS # 336212

Legal Description: Sec.20, T24N, R08W, Howell County
UTM Coordinates: X = 601815, Y = 4066603
Receiving Stream: North Fork Howell Creek (C)
First Classified Stream and ID: North Fork Howell Creek; (C) WBID# 3960; losing
USGS Basin & Sub-watershed No.: Headwaters Howell Creek (11010010-0201)
Estimated flow: 0.41 MGD
Actual flow: Dependent upon precipitation

A. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

OUTFALLS #001, #002, #003, #005, #006 <i>Stormwater Only</i>		TABLE A-1 FINAL EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS				
The permittee is authorized to discharge from outfall(s) with serial number(s) as specified in the application for this permit. The final effluent limitations shall become effective on June 1, 2018 and remain in effect until expiration of the permit. Such discharges shall be controlled, limited and monitored by the permittee as specified below:						
EFFLUENT PARAMETERS	UNITS	FINAL LIMITATIONS		BENCH-MARKS	MONITORING REQUIREMENTS	
		DAILY MAXIMUM	MONTHLY AVERAGE		MEASUREMENT FREQUENCY	SAMPLE TYPE
PHYSICAL						
Flow	MGD	*		--	once/quarter ◇	24 hr. estimate
Precipitation	inches	*		--	once/quarter ◇	measured
CONVENTIONAL						
Chemical Oxygen Demand	mg/L	**		70	once/quarter ◇	grab ∞
Oil & Grease	mg/L	**		10	once/quarter ◇	grab ∞
pH ^Ω	SU	6.5 to 9.0		-	once/quarter ◇	grab ∞
Settleable Solids	mL/L/hr	**		1.0	once/quarter ◇	grab ∞
Total Suspended Solids	mg/L	**		100	once/quarter ◇	grab ∞
METALS						
Copper, Total Recoverable	µg/L	**		26	once/quarter ◇	grab ∞
Iron, Total Recoverable	µg/L	**		4000	once/quarter ◇	grab ∞
Zinc, Total Recoverable	µg/L	**		209	once/quarter ◇	grab ∞
MONITORING REPORTS SHALL BE SUBMITTED <u>QUARTERLY</u> ; THE FIRST REPORT IS DUE <u>OCTOBER 28, 2018</u> . THERE SHALL BE NO DISCHARGE OF FLOATING SOLIDS OR VISIBLE FOAM IN OTHER THAN TRACE AMOUNTS.						

* Monitoring requirement only.

Ω The facility will report the minimum and maximum values. pH is not to be averaged.

** Monitoring requirement with associated benchmark. See Special Conditions #2 through #5

∞ All samples shall be collected from a discharge resulting from a precipitation event greater than 0.1 inches in magnitude and that occurs at least 72 hours from the previously measurable precipitation event. If a discharge does not occur within the reporting period, report as no discharge. The total amount of precipitation should be noted from the event from which the samples were collected.

◇ Quarterly sampling

MINIMUM QUARTERLY SAMPLING REQUIREMENTS			
QUARTER	MONTHS	QUARTERLY EFFLUENT PARAMETERS	REPORT IS DUE
First	January, February, March	Sample at least once during any month of the quarter	April 28 th
Second	April, May, June	Sample at least once during any month of the quarter	July 28 th
Third	July, August, September	Sample at least once during any month of the quarter	October 28 th
Fourth	October, November, December	Sample at least once during any month of the quarter	January 28 th

B. STANDARD CONDITIONS

In addition to specified conditions stated herein, this permit is subject to the attached Part I standard conditions dated August 1, 2014, and hereby incorporated as though fully set forth herein.

C. SPECIAL CONDITIONS

1. Electronic Discharge Monitoring Report (eDMR) Submission System
 - (a) Discharge Monitoring Reporting Requirements. The permittee must electronically submit compliance monitoring data via the eDMR system. In regards to Standard Conditions Part I, Section B, #7, the eDMR system is currently the only Department approved reporting method for this permit.
 - (b) Programmatic Reporting Requirements. The following reports (if required by this permit) must be electronically submitted as an attachment to the eDMR system until such a time when the current or a new system is available to allow direct input of the data:
 - (1) Any additional report required by the permit excluding bypass reporting.
After such a system has been made available by the Department, required data shall be directly input into the system by the next report due date.
 - (c) Other actions. The following shall be submitted electronically after such a system has been made available by the Department:
 - (1) General Permit Applications/Notices of Intent to discharge (NOIs);
 - (2) Notices of Termination (NOTs);
 - (3) No Exposure Certifications (NOEs);
 - (4) Low Erosivity Waivers and Other Waivers from Stormwater Controls (LEWs); and
 - (5) Bypass reporting.
 - (d) Electronic Submissions. To access the eDMR system, use the following link in your web browser: <https://edmr.dnr.mo.gov/edmr/E2/Shared/Pages/Main/Login.aspx>.
 - (e) Waivers from Electronic Reporting. The permittee must electronically submit compliance monitoring data and reports unless a waiver is granted by the department in compliance with 40 CFR Part 127. The permittee may obtain an electronic reporting waiver by first submitting an eDMR Waiver Request Form: <http://dnr.mo.gov/forms/780-2692-f.pdf>. The Department will either approve or deny this electronic reporting waiver request within 120 calendar days. Only permittees with an approved waiver request may submit monitoring data and reports on paper to the Department for the period that the approved electronic reporting waiver is effective.
2. The purpose of the Stormwater Pollution Prevention Plan (SWPPP) and the Best Management Practices (BMPs) listed herein is the prevention of pollution of waters of the state. A deficiency of a BMP means it was not effectively preventing pollution [10 CSR 20-2.010(56)] of waters of the state, and corrective actions means the facility took steps to eliminate the deficiency.
3. The facility's SIC code(s) or description is found in 40 CFR 122.26(b)(14) and/or 10 CSR 20-6.200(2) hence shall implement a SWPPP which must be prepared and implemented upon permit issuance. The SWPPP must be kept on-site and should not be sent to the Department unless specifically requested. The SWPPP must be reviewed and updated every five years or as site conditions change (see Part III: Antidegradation Analysis and SWPPP sections in the fact sheet). The permittee shall select, install, use, operate, and maintain the Best Management Practices prescribed in the SWPPP in accordance with the concepts and methods described in: *Developing Your Stormwater Pollution Prevention Plan, A Guide for Industrial Operators*, (EPA 833-B-09-002) published by the EPA in February 2009 (www.epa.gov/npdes/pubs/industrial_swppp_guide.pdf). The SWPPP must include:
 - (a) A listing of specific contaminants and their control measures (or BMPs) and a narrative explaining how BMPs are implemented to control and minimize the amount of contaminants potentially entering stormwater.
 - (b) The SWPPP must include a schedule for once per month site inspections and brief written reports. The inspection report must include precipitation information for the entire period since last inspection, as well as observations and evaluations of BMP effectiveness. Throughout coverage under this permit, the facility must perform ongoing SWPPP review and revision to incorporate any site condition changes.
 - i. Operational deficiencies must be corrected within seven (7) calendar days.
 - ii. Minor structural deficiencies must be corrected within fourteen (14) calendar days.
 - iii. Major structural deficiencies must be reported to the regional office within seven (7) days of discovery. The initial report shall consist of the deficiency noted, the proposed remedies, the interim or temporary remedies (including the general timing of the placement of the interim measures), and an estimate of the timeframe needed to wholly complete the repairs or construction. The permittee will work with the regional office to determine the best course of action, including but not limited to temporary structures to control stormwater runoff. The facility shall correct the major structural deficiency as soon as reasonably achievable.
 - iv. All actions taken to correct the deficiencies shall be included with the written report, including photographs.
 - v. Inspection reports must be kept on site with the SWPPP and maintained for a period of five (5) years. These must be made available to Department and EPA personnel upon request.
 - (c) A provision for designating an individual to be responsible for environmental matters.
 - (d) A provision for providing training to all personnel involved in material handling and storage, and housekeeping of maintenance and cleaning areas. Proof of training shall be submitted on request of the Department.

C. SPECIAL CONDITIONS (CONTINUED)

4. This permit stipulates pollutant benchmarks applicable to your discharge. The benchmarks do not constitute direct numeric effluent limitations; therefore, a benchmark exceedance alone is not a permit violation. Benchmark monitoring and visual inspections shall be used to determine the overall effectiveness of SWPPP and to assist you in knowing when additional corrective action may be necessary to protect water quality. If a sample exceeds a benchmark concentration you must review your SWPPP and your BMPs to determine what improvements or additional controls are needed to reduce that pollutant in your stormwater discharge(s).

Any time a benchmark exceedance occurs a Corrective Action Report (CAR) must be completed. A CAR is a document that records the efforts undertaken by the facility to improve BMPs to meet benchmarks in future samples. CARs must be retained with the SWPPP and available to the Department upon request. If the efforts taken by the facility are not sufficient and subsequent exceedances of a benchmark occur, the facility must contact the Department if a benchmark value cannot be achieved. Failure to take corrective action to address a benchmark exceedance and failure to make measureable progress towards achieving the benchmarks is a permit violation.

5. Permittee shall adhere to the following minimum Best Management Practices (BMPs):
- (a) Prevent the spillage or loss of fluids, oil, grease, fuel, etc. from vehicle maintenance, equipment cleaning, or warehouse activities and thereby prevent the contamination of stormwater from these substances.
 - (b) Provide collection facilities and arrange for proper disposal of waste products including but not limited to petroleum waste products, and solvents.
 - (c) Store all paint, solvents, petroleum products and petroleum waste products (except fuels), and storage containers (such as drums, cans, or cartons) so that these materials are not exposed to stormwater or provide other prescribed BMPs such as plastic lids and/or portable spill pans to prevent the commingling of stormwater with container contents. Commingled water may not be discharged under this permit. Provide spill prevention control, and/or management sufficient to prevent any spills of these pollutants from entering waters of the state. Any containment system used to implement this requirement shall be constructed of materials compatible with the substances contained and shall also prevent the contamination of groundwater. Any spills should be noted in the SWPPP.
 - (d) Provide good housekeeping practices on the site to keep trash from entry into waters of the state.
 - (e) Provide sediment and erosion control sufficient to prevent or control sediment loss off of the property.
6. To protect the general criteria found at 10 CSR 20-7.031(4), before releasing water accumulated in secondary containment areas, it must be examined for hydrocarbon odor and presence of sheen. If the presence of odor or sheen is indicated, the water shall be treated using an appropriate method or disposed of in accordance with legally approved methods, such as being sent to a wastewater treatment facility. Following treatment, the water shall be tested for oil and grease, benzene, toluene, ethylbenzene, and xylene using 40 CFR part 136 methods. All pollutant levels must be below the most protective, applicable standards for the receiving stream, found in 10 CSR 20-7.031 Table A. Records of all testing and treatment of water accumulated in secondary containment shall be stored in the SWPPP to be available on demand to Department and EPA personnel.
7. The full implementation of this operating permit, which includes implementation of any applicable schedules of compliance, shall constitute compliance with all applicable federal and state statutes and regulations in accordance with §644.051.16, RSMo, and the CWA section 402(k); however, this permit may be reopened and modified, or alternatively revoked and reissued to comply with any applicable effluent standard or limitation issued or approved under Sections 301(b)(2)(C) and (D), §304(b)(2), and §307(a) (2) of the Clean Water Act, if the effluent standard or limitation so issued or approved contains different conditions or is otherwise more stringent than any effluent limitation in the permit; or controls any pollutant not limited in the permit.
8. All outfalls must be clearly marked in the field.
9. Changes in Discharges of Toxic Pollutant
- In addition to the reporting requirements under §122.41(1), all existing manufacturing, commercial, mining, and silvicultural dischargers must notify the Director as soon as they know or have reason to believe:
- (a) That an activity has occurred or will occur which would result in the discharge, on a routine or frequent basis, of any toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following notification levels:
 - (1) One hundred micrograms per liter (100 µg/L);
 - (2) Two hundred micrograms per liter (200 µg/L) for acrolein and acrylonitrile;
 - (3) Five hundred micrograms per liter (500 µg/L) for 2,4-dinitrophenol and for 2-methyl-4, 6-dinitrophenol;
 - (4) One milligram per liter (1 mg/L) for antimony;
 - (5) Five (5) times the maximum concentration value reported for the pollutant in the permit application in accordance with 40 CFR 122.21(g)(7); or
 - (6) The notification level established by the Department in accordance with 40 CFR 122.44(f).

C. SPECIAL CONDITIONS (CONTINUED)

- (b) That any activity has occurred or will occur which would result in any discharge, on a non-routine or infrequent basis, of a toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following “notification levels”:
 - (1) Five hundred micrograms per liter (500 µg/l);
 - (2) One milligram per liter (1 mg/l) for antimony;
 - (3) Ten (10) times the maximum concentration value reported for that pollutant in the permit application in accordance with §122.21(g)(7).
 - (4) The level established by the Director in accordance with §122.44(f).
- 10. Report as no-discharge when a discharge does not occur during the report period. It is a violation of this permit to report no-discharge when a discharge has occurred.
- 11. Reporting of Non-Detects
 - (a) An analysis conducted by the permittee or their contracted laboratory shall be conducted in such a way that the precision and accuracy of the analyzed result can be enumerated.
 - (b) The permittee shall not report a sample result as “non-detect” without also reporting the detection limit of the test. Reporting as “non-detect” without also including the detection limit will be considered failure to report, which is a violation of this permit.
 - (c) The permittee shall report the “non-detect” result using the less than sign and the minimum detection limit (e.g. <10).
 - (d) Where the permit contains a Minimum Level (ML) and the permittee is granted authority in the permit to report zero in lieu of the < ML for a specified parameter (conventional, priority pollutants, metals, etc.), then zero (0) is to be reported for that parameter.
 - (e) See Standard Conditions Part I, Section A, #4 regarding proper detection limits used for sample analysis.
 - (f) When calculating monthly averages, one-half of the minimum detection limit (MDL) should be used instead of a zero. Where all data are below the MDL, the “<MDL” shall be reported as indicated in item (C).
- 12. It is a violation of the Missouri Clean Water Law to fail to pay fees associated with this permit (644.055 RSMo).

MISSOURI DEPARTMENT OF NATURAL RESOURCES
FACT SHEET
FOR THE PURPOSE OF RENEWAL
OF
MO-0137812
DRS-SSI

The Federal Water Pollution Control Act ("Clean Water Act" Section 402 Public Law 92-500 as amended) established the National Pollution Discharge Elimination System (NPDES) permit program. This program regulates the discharge of pollutants from point sources into the waters of the United States, and the release of stormwater from certain point sources. All such discharges are unlawful without a permit (Section 301 of the "Clean Water Act"). After a permit is obtained, a discharge not in compliance with all permit terms and conditions is unlawful. Missouri State Operating Permits (MSOPs) are issued by the Director of the Missouri Department of Natural Resources (Department) under an approved program, operating in accordance with federal and state laws (Federal "Clean Water Act" and "Missouri Clean Water Law" Section 644 as amended). MSOPs are issued for a period of five (5) years unless otherwise specified for less.

As per [40 CFR Part 124.8(a)] and [10 CSR 20-6.020(1)(A)2.] a factsheet shall be prepared to give pertinent information regarding the applicable regulations, rationale for the development of effluent limitations and conditions, and the public participation process for the Missouri State Operating Permit (MSOP or operating permit) listed below. A factsheet is not an enforceable part of an operating permit.

Part I. FACILITY INFORMATION

Facility Type: Industrial Stormwater
 Facility SIC Code(s): 3715
 Facility NAICS Code: 336212
 Application Date: 07/31/2017
 Expiration Date: 03/31/2018
 Last Inspection: 08/22/2017 in compliance

FACILITY DESCRIPTION:

DRS-SSI manufactures heavy transportation equipment including machining operations, welding, assembly, and painting. All exterior storage of chemicals is under roof and in concrete spill containment. Material exposed to storm water includes raw steel, wood pallets, and final product awaiting shipment.

Water is used for the production area in a five stage wash line in the paint department and seven steam cleaning booths in Plant 1. All process water is discharged to the West Plains POTW.

PERMITTED FEATURES TABLE:

OUTFALL	EST FLOW (MGD)*	TREATMENT LEVEL	EFFLUENT TYPE
001	1.09	BMPs	Storm water
002	0.42	BMP	Storm water
003	0.49	BMP	Storm water
005	0.83	BMP	Storm water
006	0.39	BMP	Storm water

*Calculated by permittee using the rational method, rational coefficient 0.7, rainfall 5.5 in/day, runoff areas calculated by permittee.

FACILITY PERFORMANCE HISTORY & COMMENTS:

The electronic discharge monitoring reports were reviewed for the last five years. Exceedances were noted at outfall #001 for total suspended solids; at outfall #002 for zinc; at outfall #003 for chemical oxygen demand, copper, total suspended solids, and zinc; at outfall #005 for total suspended solids and zinc, and at outfall #006 for total suspended solids. The exceedances are mainly clustered during the 3rd and 4th quarter 2017 reporting periods. The permit writer discussed this anomaly with the facility, and was provided with a letter detailing the probable reason for these exceedances. In April of 2017, the facility was severely flooded. When the floodwaters receded, they left 3+ inches of loose sediment on the site. The facility has been working since that time to remove the large amounts of sediment; however, the loosely compacted nature of the sediment makes it difficult to remove or control, leading to elevated levels being discharged in the stormwater. The permittee plans to continue removing the sediment, and also plans to pave the affected areas,

also to control the sediment. Limits were converted to benchmarks, as the permit writer concurs with the permittee that many of the sites recent issues are probably stemming from this sediment deposit. Continued remediation of the sediment should lead to an improvement in DMR data, as the site was mostly compliant with the permitted limits prior to the flood event.

FACILITY MAP:
FIGURE 1



MAJOR WATER USER:

Any surface or groundwater user with a water source and the equipment necessary to withdraw or divert 100,000 gallons (or 70 gallons per minute) or more per day combined from all sources from any stream, river, lake, well, spring, or other water source is considered a major water user in Missouri. All major water users are required by law to register water use annually (Missouri Revised Statutes Chapter 256.400 Geology, Water Resources and Geodetic Survey Section). <https://dnr.mo.gov/pubs/pub2337.htm>

✓ Not applicable; this permittee cannot withdraw water from the state in excess of 70 gpm/0.1 MGD.

Part II. RECEIVING WATERBODY INFORMATION

RECEIVING WATER BODY'S WATER QUALITY:

The receiving waterbody has no concurrent water quality data available. North Fork Howell Creek (C) (3960) has been designated a losing stream. No further relevant water quality information was found.

303(D) LIST:

Section 303(d) of the federal Clean Water Act requires each state identify waters not meeting water quality standards and for which adequate water pollution controls have not been required. Water quality standards protect such beneficial uses of water as whole body contact (such as swimming), maintaining fish and other aquatic life, and providing drinking water for people, livestock, and wildlife. The 303(d) list helps state and federal agencies keep track of impaired waters not addressed by normal water pollution control programs. <http://dnr.mo.gov/env/wpp/waterquality/303d/303d.htm>

✓ Not applicable; this facility does not discharge to an impaired segment of a 303(d) listed stream.

TOTAL MAXIMUM DAILY LOAD (TMDL):

A TMDL is a calculation of the maximum amount of a given pollutant that a water body can absorb before its water quality is affected; hence, the purpose of a TMDL is to determine the pollutant loading a specific waterbody can assimilate without exceeding water quality standards. If a water body is determined to be impaired as listed on the 303(d) list, then a watershed management plan or TMDL may be developed. The TMDL shall include the WLA calculation. <http://dnr.mo.gov/env/wpp/tmdl/>

✓ Not applicable; this facility is not associated with a TMDL.

APPLICABLE DESIGNATIONS OF WATERS OF THE STATE:

✓ As per Missouri's Effluent Regulations [10 CSR 20-7.015(1)(B)], the waters of the state are divided into the following seven categories. Each category lists effluent limitations for specific parameters, which are presented in each outfall's effluent limitation table and further discussed in the derivation & discussion of limits section.

- Missouri or Mississippi River:
- Lake or Reservoir:
- Losing:
- Metropolitan No-Discharge:
- Special Stream:
- Subsurface Water:
- All Other Waters:

RECEIVING WATERBODY TABLE:

OUTFALL	WATERBODY NAME	CLASS	WBID	DESIGNATED USES	DISTANCE TO CLASSIFIED SEGMENT	12-DIGIT HUC
#001	North Fork Howell Creek (Losing)	(C)	3960	AQL, IRR, LWW, SCR, WBC(B), HHP	0	11010010-0201 Headwaters Howell Creek
#002	Tributary to North Fork Howell Creek	n/a	n/a	GEN	0	
	North Fork Howell Creek (Losing)	C	3960	AQL, IRR, LWW, SCR, WBC(B), HHP	0.01	
#003	Tributary to North Fork Howell Creek	n/a	n/a	GEN	0	
	North Fork Howell Creek (Losing)	C	3960	AQL, IRR, LWW, SCR, WBC(B), HHP	0.03	
#005	Tributary to North Fork Howell Creek	n/a	n/a	GEN	0	
	North Fork Howell Creek (Losing)	C	3960	AQL, IRR, LWW, SCR, WBC(B), HHP	0.03	
#006	North Fork Howell Creek (Losing)	C	3960	AQL, IRR, LWW, SCR, WBC(B), HHP	0	

n/a not applicable

WBID = Waterbody IDentification: Missouri Use Designation Dataset 8-20-13 MUDD V1.0 data can be found as an ArcGIS shapefile on MSDIS at ftp://msdis.missouri.edu/pub/Inland_Water_Resources/MO_2014_WQS_Stream_Classifications_and_Use_shp.zip

* As per 10 CSR 20-7.031 Missouri Water Quality Standards, the Department defines the Clean Water Commission's water quality objectives in terms of "water uses to be maintained and the criteria to protect those uses." The receiving stream and 1st classified receiving stream's beneficial water uses to be maintained are in the receiving stream table in accordance with [10 CSR 20-7.031(1)(C)].

Uses which may be found in the receiving streams table, above:

10 CSR 20-7.031(1)(C)1.:

AQL = Protection of aquatic life (Current narrative use(s) are defined to ensure the protection and propagation of fish shellfish and wildlife, which is further subcategorized as: WWH = Warm Water Habitat; CLH = Cool Water Habitat; CDH = Cold Water Habitat; EAH = Ephemeral Aquatic Habitat; MAH = Modified Aquatic Habitat; LAH = Limited Aquatic Habitat. This permit uses AQL effluent limitations in 10 CSR 20-7.031 Table A for all habitat designations unless otherwise specified.)

10 CSR 20-7.031(1)(C)2.: Recreation in and on the water

WBC = Whole Body Contact recreation where the entire body is capable of being submerged;

WBC-A = Whole body contact recreation supporting swimming uses and has public access;

WBC-B = Whole body contact recreation supporting swimming;

SCR = Secondary Contact Recreation (like fishing, wading, and boating).

10 CSR 20-7.031(1)(C)3. to 7.:

HHP (formerly HHP) = Human Health Protection as it relates to the consumption of fish;

IRR = Irrigation for use on crops utilized for human or livestock consumption;
LWW = Livestock and wildlife watering (Current narrative use is defined as LWP = Livestock and Wildlife Protection);
DWS = Drinking Water Supply;
IND = Industrial water supply

MIXING CONSIDERATIONS:

Mixing zone: not allowed [10 CSR 20-7.031(5)(A)4.B.(I)(a)].
Zone of initial dilution: not allowed [10 CSR 20-7.031(5)(A)4.B.(I)(b)].

RECEIVING STREAM MONITORING REQUIREMENTS:

No receiving water monitoring requirements are recommended at this time.

Part III. RATIONALE AND DERIVATION OF EFFLUENT LIMITATIONS & PERMIT CONDITIONS

ALTERNATIVE EVALUATIONS FOR NEW FACILITIES:

As per [10 CSR 20-7.015(4)(A)], discharges to losing streams shall be permitted only after other alternatives including land application, discharges to a gaining stream and connection to a regional wastewater treatment facility have been evaluated and determined to be unacceptable for environmental and/or economic reasons.

✓ Not applicable; the facility is an existing facility.

ANTI-BACKSLIDING:

Federal Regulations [CWA §303(d)(4); CWA §402(c); 40 CFR Part 122.44(l)] require a reissued permit to be as stringent as the previous permit with some exceptions. Backsliding (a less stringent permit limitation) is only allowed under certain conditions.

- ✓ Limitations in this operating permit for the reissuance conform to the anti-backsliding provisions of Section 402(o) of the Clean Water Act, and 40 CFR Part 122.44.
- ✓ The Department determined technical mistakes or mistaken interpretations of law were made in issuing the permit under section 402(a)(1)(b).
 - 5 years of DMR data were supplied to the permit writer which support conversions of some limits on all the outfalls to benchmarks; see below for more information.
 - The previous permit limits for the outfalls were established in error, based on limits for process wastewater; however, this is a stormwater outfall. This renewal establishes limits and benchmarks appropriate for stormwater discharges. There will be no changes to industrial activities onsite or the composition of the stormwater discharge as a result of this renewal. The benchmark concentrations and required corrective actions within this permit are protective of the receiving stream's uses to be maintained. The DMR data showed no reasonable potential to exceed water quality standards in-stream, either narrative or numeric. Many of the exceeding data points are clarified by the permit writer above in the "Facility performance History and Comments" section above. The permit writer uses best professional judgment to determine the benchmark approach is appropriate for this stormwater only site, and believes the BMP repairs will sufficiently protect the receiving stream.
 - The previous permit contained a specific set of prohibitions related to general criteria found in 10 CSR 20-7.031(4); however, there was no determination as to whether the discharges have reasonable potential to cause or contribute to excursion of those general water quality standards in the previous permit. Federal regulations 40 CFR 122.44(d)(1)(iii) requires that in instances where reasonable potential (RP) to cause or contribute to an exceedance of a water quality standard exists, a numeric limitation must be included in the permit. Rather than conducting the appropriate RP determination and establishing numeric effluent limitations for specific pollutant parameters, the previous permit simply placed the prohibitions in the permit. These conditions were removed from the permit. Appropriate reasonable potential determinations were conducted for each general criterion listed in 10 CSR 20-7.031(4) and effluent limitations were placed in the permit for those general criteria where it was determined the discharge had reasonable potential to cause or contribute to excursions of the general criteria. Specific effluent limitations were not included for those general criteria where it was determined that the discharges will not cause or contribute to excursions of general criteria. Removal of the prohibitions does not reduce the protections of the permit or allow for impairment of the receiving stream. The permit maintains sufficient effluent limitations, monitoring requirements and best management practices to protect water quality.

ANTIDEGRADATION REVIEW:

For process water discharge with new, altered, or expanding discharges, the Department is to document, by means of antidegradation review, if the use of a water body's available assimilative capacity is justified. In accordance with Missouri's water quality regulations for antidegradation [10 CSR 20-7.031(3)], degradation may be justified by documenting the socio-economic importance of a discharge after determining the necessity of the discharge. Facilities must submit the antidegradation review request to the Department prior to establishing, altering, or expanding discharges. See <http://dnr.mo.gov/env/wpp/permits/antideg-implementation.htm>

✓ Not applicable; the facility has not submitted information proposing expanded or altered process water discharge; no further degradation proposed therefore no further review necessary.

For stormwater discharges with new, altered, or expanding discharges, the stormwater BMP chosen for the facility, through the antidegradation analysis performed by the facility, must be implemented and maintained at the facility. Failure to implement and maintain the chosen BMP alternative is a permit violation; see SWPPP.

- ✓ Applicable; the facility must review and maintain stormwater BMPs as appropriate.

BENCHMARKS:

When a permitted feature or outfall consists of only stormwater, a benchmark may be implemented at the discretion of the permit writer. Benchmarks require the facility to monitor, and if necessary, replace and update stormwater control measures. Benchmark concentrations are not effluent limitations. A benchmark exceedance, therefore, is not a permit violation; however, failure to take corrective action is a violation of the permit. Benchmark monitoring data is used to determine the overall effectiveness of control measures and to assist the permittee in knowing when additional corrective actions may be necessary to comply with the limitations of the permit.

Because of the fleeting nature of stormwater discharges, the Department, under the direction of EPA guidance, has determined monthly averages are capricious measures of stormwater discharges. The *Technical Support Document for Water Quality Based Toxics Control* (EPA/505/2-90-001; 1991) Section 3.1 indicates most procedures within the document apply only to water quality based approaches, not end-of-pipe technology-based controls. Hence, stormwater only outfalls will generally only contain a maximum daily limit (MDL), benchmark, or monitoring requirement determined by the site specific conditions including the receiving water's current quality. While inspections of the stormwater BMPs occur monthly, facilities with no compliance issues are usually expected to sample stormwater quarterly.

Numeric benchmark values are based on water quality standards or other stormwater permits including guidance forming the basis of Environmental Protection Agency's (EPA's) *Multi-Sector General Permit for Stormwater Discharges Associated with Industrial Activity* (MSGP). Because precipitation events are sudden and momentary, benchmarks based on state or federal standards or recommendations use the Criteria Maximum Concentration (CMC) value, or acute standard. The CMC is the estimate of the highest concentration of a material in surface water to which an aquatic community can be exposed briefly without resulting in an unacceptable effect. The CMC for aquatic life is intended to be protective of the vast majority of the aquatic communities in the United States.

- ✓ Applicable; this facility has stormwater-only outfalls with benchmark constraints. The benchmarks listed are consistently achieved in stormwater discharges by a variety of other industries with SWPPPs.

COMPLIANCE AND ENFORCEMENT:

Enforcement is the action taken by the Water Protection Program (WPP) to bring an entity into compliance with the Missouri Clean Water Law, its implementing regulations, and/or any terms and conditions of an operating permit. The primary purpose of the enforcement activity in the WPP is to resolve violations and return the entity to compliance.

- ✓ Not applicable; the permittee/facility is not currently under Water Protection Program enforcement action.

EFFLUENT LIMITATION GUIDELINE:

Effluent Limitation Guidelines, or ELGs, are found at 40 CFR 400-499. These are limitations established by the EPA based on the SIC code and the type of work a facility is conducting. Most ELGs are for process wastewater and some address stormwater. All are technology based limitations which must be met by the applicable facility at all times.

- ✓ The facility has an associated ELG but does not discharge wastewater to waters of the state; stormwater discharges are not addressed by the ELG.

GROUNDWATER MONITORING:

Groundwater is a water of the state according to 10 CSR 20-7.015(1)11, and is subject to regulations at 10 CSR 20-7.015(7) and 10 CSR 20-7.031(6) and must be protected accordingly.

- ✓ This facility is not required to monitor groundwater for the water protection program.

REASONABLE POTENTIAL ANALYSIS (RPA):

Federal regulation [40 CFR Part 122.44(d)(1)(i)] requires effluent limitations for all pollutants that are (or may be) discharged at a level causing or have the reasonable potential to cause (or contribute to) an in-stream excursion above narrative or numeric water quality standards. If the permit writer determines any given pollutant has the reasonable potential to cause or contribute to an in-stream excursion above the WQS, the permit must contain effluent limits for that pollutant [40 CFR Part 122.44(d)(1)(iii)].

- ✓ Not applicable; an RPA was not conducted for this facility. This permit establishes permit limits and benchmarks for stormwater. The Department has determined stormwater is not a continuous discharge and is therefore not necessarily dependent on mathematical RPAs. However, the permit writer completed an RPD, a reasonable potential determination, using best professional judgment for all of the appropriate parameters in this permit. An RPD consists of reviewing application data and/or discharge monitoring data for the last five years and comparing those data to narrative or numeric water quality criteria.
- ✓ Permit writers use the Department's permit writer's manual (<http://dnr.mo.gov/env/wpp/permits/manual/permit-manual.htm>), the EPA's permit writer's manual (<https://www.epa.gov/npdes/npdes-permit-writers-manual>), program policies, and best professional

judgment. For each parameter in each permit, the permit writer carefully considers all applicable information regarding: technology based effluent limitations, effluent limitation guidelines, water quality standards, stream flows and uses, and all applicable site specific information and data gathered by the permittee through discharge monitoring reports and renewal (or new) application sampling. Best professional judgment is based on the experience of the permit writer, cohorts in the Department and resources at the EPA, research, and maintaining continuity of permits if necessary. For stormwater permits, the permit writer is required per 10 CSR 6.200(6)(B)2 to consider: A. application and other information supplied by the permittee; B. effluent guidelines; C. best professional judgment of the permit writer; D. water quality; and E. BMPs. Part V provides specific decisions related to this permit.

SCHEDULE OF COMPLIANCE (SOC):

A schedule of remedial measures included in a permit, including an enforceable sequence of interim requirements (actions, effluent limits, operations, or milestone events) leading to compliance with the Missouri Clean Water Law, its implementing regulations, and/or the terms and conditions of an operating permit. SOC's are allowed under 40 CFR 122.47 providing certain conditions are met.

✓ Not applicable; this permit does not contain a SOC.

SECONDARY CONTAINMENT STRUCTURES SPECIAL CONDITION:

The previous permit's special conditions required sampling of total petroleum hydrocarbons (TPH) under the decision model to discharge stormwater having a sheen in secondary containment. The special condition has been revised in all permits beginning in 2015 to include oil and grease and BTEX (benzene, toluene, ethylbenzene, and xylene) sampling of the potentially contaminated stormwater in secondary containment. This change was due to 1) no water quality standards for TPH; and 2) there are no approved methods found in 40 CFR 136 for TPH. The facility need only sample for these constituents prior to release when a sheen or petroleum odor is present.

SPILL REPORTING:

Per 10 CSR 24-3.010, any emergency involving a hazardous substance must be reported to the Department's 24 hour Environmental Emergency Response hotline at (573) 634-2436 at the earliest practicable moment after discovery. The Department may require the submittal of a written report detailing measures taken to clean up a spill. These reporting requirements apply whether or not the spill results in chemicals or materials leaving the permitted property or reaching waters of the state. This requirement is in addition to the noncompliance reporting requirement found in Standard Conditions Part I. <http://dnr.mo.gov/env/esp/spillbill.htm>

SLUDGE – DOMESTIC BIOSOLIDS:

Biosolids are solid materials resulting from domestic wastewater treatment meeting federal and state criteria for beneficial use (i.e. fertilizer). Sewage sludge is solid, semi-solid, or liquid residue generated during the treatment of domestic sewage in a treatment works; including but not limited to, domestic septage; scum or solids removed in primary, secondary, or advanced wastewater treatment process; and material derived from sewage sludge. Sewage sludge does not include ash generated during the firing of sewage sludge in a sewage sludge incinerator or grit and screening generated during preliminary treatment of domestic sewage in a treatment works. Additional information: <http://extension.missouri.edu/main/DisplayCategory.aspx?C=74> (WQ422 through WQ449).

✓ Not applicable; this condition is not applicable to the permittee for this facility.

SLUDGE – INDUSTRIAL:

Industrial sludge is solid, semi-solid, or liquid residue generated during the treatment of industrial process wastewater in a treatment works; including but not limited to, scum or solids removed in primary, secondary, or advanced wastewater treatment process; scum and solids filtered from water supplies and backwashed; and a material derived from industrial sludge.

✓ Not applicable; sludge is not land applied at this facility.

STORMWATER PERMITTING:

A standard mass-balance equation cannot be calculated for stormwater from this facility because the stormwater flow and flow in the receiving stream cannot be determined for conditions on any given day. The amount of stormwater discharged from the facility will vary based on previous rainfall, soil saturation, humidity, detention time, BMPs, surface permeability, etc. Flow in the receiving stream will vary based on climatic conditions, size of watershed, amount of surfaces with reduced permeability (houses, parking lots, and the like) in the watershed, hydrogeology, topography, etc. Decreased permeability increases the flash of the stream.

It is likely sufficient rainfall to cause a discharge for four continuous days from a facility will also cause some significant amount of flow in the receiving stream. Chronic WQSs are based on a four-day exposure (except ammonia, which is based on a thirty day exposure). In the event a discharge does occur from this facility for four continuous days, some amount of flow will occur in the receiving stream. This flow will dilute stormwater discharges from a facility. For these reasons, most industrial stormwater facilities have limited potential to cause a violation of chronic water quality standards in the receiving stream.

Sufficient rainfall to cause a discharge for one hour or more from a facility would not necessarily cause significant flow in a receiving stream. Acute WQSs are based on a one hour of exposure, and must be protected at all times in unclassified streams, and within mixing zones of class P streams [10 CSR 20-7.031(4) and (5)(4)4.B.]. Therefore, industrial stormwater facilities with toxic contaminants do have the potential to cause a violation of acute WQSs if those toxic contaminants occur in sufficient amounts.

It is due to the items stated above staff are unable to perform statistical Reasonable Potential Analysis (RPA). However, staff will use their best professional judgment in determining if a facility has a potential to violate Missouri's Water Quality Standards.

STORMWATER POLLUTION PREVENTION PLAN (SWPPP):

In accordance with 40 CFR 122.44(k), Best Management Practices (BMPs) must be used to control or abate the discharge of pollutants when: 1) Authorized under section 304(e) of the Clean Water Act (CWA) for the control of toxic pollutants and hazardous substances from ancillary industrial activities; 2) Authorized under section 402(p) of the CWA for the control of stormwater discharges; 3) Numeric effluent limitations are infeasible; or 4) the practices are reasonably necessary to achieve effluent limitations and standards or to carry out the purposes and intent of the CWA. In accordance with the EPA's *Developing Your Stormwater Pollution Prevention Plan, A Guide for Industrial Operators*, (Document number EPA 833-B-09-002) [published by the United States Environmental Protection Agency (USEPA) in February 2009], BMPs are measures or practices used to reduce the amount of pollution entering waters of the state from a permitted facility. BMPs may take the form of a process, activity, or physical structure. Additionally in accordance with the Stormwater Management, a SWPPP is a series of steps and activities to 1) identify sources of pollution or contamination, and 2) select and carry out actions which prevent or control the pollution of storm water discharges.

A SWPPP must be prepared by the permittee if the SIC code is found in 40 CFR 122.26(b)(14) and/or 10 CSR 20-6.200(2). A SWPPP may be required of other facilities where stormwater has been identified as necessitating better management. The purpose of a SWPPP is to comply with all applicable stormwater regulations by creating an adaptive management plan to control and mitigate stream pollution from stormwater runoff. Developing a SWPPP provides opportunities to employ appropriate BMPs to minimize the risk of pollutants being discharged during storm events. The following paragraph outlines the general steps the permittee should take to determine which BMPs will work to achieve the benchmark values or limits in the permit. This section is not intended to be all encompassing or restrict the use of any physical BMP or operational and maintenance procedure assisting in pollution control. Additional steps or revisions to the SWPPP may be required to meet the requirements of the permit.

Areas which should be included in the SWPPP are identified in 40 CFR 122.26(b)(14). Once the potential sources of stormwater pollution have been identified, a plan should be formulated to best control the amount of pollutant being released and discharged by each activity or source. This should include, but is not limited to, minimizing exposure to stormwater, good housekeeping measures, proper facility and equipment maintenance, spill prevention and response, vehicle traffic control, and proper materials handling. Once a plan has been developed the facility will employ the control measures determined to be adequate to achieve the benchmark values discussed above. The facility will conduct monitoring and inspections of the BMPs to ensure they are working properly and re-evaluate any BMP not achieving compliance with permitting requirements. For example, if sample results from an outfall show values of TSS above the benchmark value, the BMP being employed is deficient in controlling stormwater pollution. Corrective action should be taken to repair, improve, or replace the failing BMP. This internal evaluation is required at least once per month but should be continued more frequently if BMPs continue to fail. If failures do occur, continue this trial and error process until appropriate BMPs have been established.

For new, altered, or expanded stormwater discharges, the SWPPP shall identify reasonable and effective BMPs while accounting for environmental impacts of varying control methods. The antidegradation analysis must document why no discharge or no exposure options are not feasible. The selection and documentation of appropriate control measures shall serve as an alternative analysis of technology and fulfill the requirements of antidegradation [10 CSR 20-7.031(3)]. For further guidance, consult the antidegradation implementation procedure (<http://dnr.mo.gov/env/wpp/docs/AIP050212.pdf>).

Alternative Analysis (AA) evaluation of the BMPs is a structured evaluation of BMPs that are reasonable and cost effective. The AA evaluation should include practices that are designed to be: 1) non-degrading; 2) less degrading; or 3) degrading water quality. The glossary of AIP defines these three terms. The chosen BMP will be the most reasonable and effective management strategy while ensuring the highest statutory and regulatory requirements are achieved and the highest quality water attainable for the facility is discharged. The AA evaluation must demonstrate why "no discharge" or "no exposure" is not a feasible alternative at the facility. This structured analysis of BMPs serves as the antidegradation review, fulfilling the requirements of 10 CSR 20-7.031(3) Water Quality Standards and *Antidegradation Implementation Procedure (AIP)*, Section II.B.

If parameter-specific numeric exceedances continue to occur and the permittee feels there are no practicable or cost-effective BMPs which will sufficiently reduce a pollutant concentration in the discharge to the benchmark values established in the permit, the permittee can submit a request to re-evaluate the benchmark values. This request needs to include 1) a detailed explanation of why the facility is unable to comply with the permit conditions and unable to establish BMPs to achieve the benchmark values; 2) financial data of the company and documentation of cost associated with BMPs for review and 3) the SWPPP, which should contain adequate documentation of BMPs employed, failed BMPs, corrective actions, and all other required information. This will allow the

Department to conduct a cost analysis on control measures and actions taken by the facility to determine cost-effectiveness of BMPs. The request shall be submitted in the form of an operating permit modification; the application is found at:

<http://dnr.mo.gov/forms/index.html>.

✓ Applicable; a SWPPP shall be developed and implemented for this facility.

TECHNOLOGY-BASED EFFLUENT LIMITATIONS (TBEL):

One of the major strategies of the Clean Water Act (CWA) in making “reasonable further progress toward the national goal of eliminating the discharge of all pollutants” is to require effluent limitations based on the capabilities of the technologies available to control those discharges. Technology-based effluent limitations (TBELs) aim to prevent pollution by requiring a minimum level of effluent quality attainable using demonstrated technologies for reducing discharges of pollutants or pollution into the waters of the United States. TBELs are developed independently of the potential impact of a discharge on the receiving water, which is addressed through water quality standards and water quality-based effluent limitations (WQBELs).

✓ Not applicable; this facility does not discharge process wastewater therefore is not subject to TBEL POC analysis.

VARIANCE:

Per the Missouri Clean Water Law §644.061.4, variances shall be granted for such period of time and under such terms and conditions as shall be specified by the commission in its order. The variance may be extended by affirmative action of the commission. In no event shall the variance be granted for a period of time greater than is reasonably necessary for complying with the Missouri Clean Water Law §§644.006 to 644.141 or any standard, rule or regulation promulgated pursuant to Missouri Clean Water Law §§644.006 to 644.141.

✓ Not applicable; this permit is not drafted under premise of a petition for variance.

WASTELOAD ALLOCATIONS (WLA) FOR LIMITS:

As per [10 CSR 20-2.010(78)], the WLA is the amount of pollutant each discharger is allowed to discharge into the receiving stream without endangering water quality. Two general types of effluent limitations, technology-based effluent limits (TBELs) and water quality based effluent limits (WQBELs) are reviewed. If one limit does not provide adequate protection for the receiving waters, then the other must be used.

✓ Not applicable; wasteload allocations were not calculated.

WLA MODELING:

Permittees may submit site specific studies to better determine the site specific wasteload allocations applied in permits.

✓ Not applicable; a WLA study was either not submitted or determined not applicable by Department staff.

WATER QUALITY STANDARDS:

Per 10 CSR 20-7.031(4), general criteria shall be applicable to all waters of the state at all times including mixing zones. Additionally, 40 CFR 122.44(d)(1) directs the Department to establish in each NPDES permit to include conditions to achieve water quality established under Section 303 of the Clean Water Act, including state narrative criteria for water quality.

WHOLE EFFLUENT TOXICITY (WET) TEST:

A WET test is a quantifiable method to determine discharges from the facility cause toxicity to aquatic life by itself, in combination with, or through synergistic responses, when mixed with receiving stream water.

✓ Not applicable; at this time, the permittee is not required to conduct WET testing for this facility.

Part IV. EFFLUENT LIMITS DETERMINATION

Effluent limitations derived and established for this permit are based on current operations of the facility. Effluent means both process water and stormwater. Any flow through the outfall is considered a discharge and must be sampled and reported as provided below. Future permit action due to facility modification may contain new operating permit terms and conditions that supersede the terms and conditions, including effluent limitations, of this operating permit.

GENERAL CRITERIA CONSIDERATIONS:

In accordance with 40 CFR 122.44(d)(1), effluent limitations shall be placed into permits for pollutants which have been determined to cause, have the reasonable potential to cause, or to contribute to an excursion above any State water quality standard, including State narrative criteria for water quality. The rule further states pollutants which have been determined to cause, have the reasonable potential to cause, or contribute to an excursion above a narrative criterion within an applicable State water quality standard, the permit shall contain a numeric effluent limitation to protect that narrative criterion. The previous permit included the narrative criteria as specific prohibitions placed upon the discharge. These prohibitions were included in the permit absent any discussion of the discharge’s reasonable potential to cause or contribute to an excursion of the criterion. In order to comply with this regulation, the permit writer has completed a reasonable potential determination on whether the discharge has reasonable potential to cause, or contribute to an excursion of the general criteria listed in 10 CSR 20-7.031(4). These specific requirements are listed below followed by derivation and discussion (the lettering matches that of the rule itself, under 10 CSR 20-7.031(4)). In instances where reasonable

potential exists, the permit includes numeric limitations to address the reasonable potential. In instances where reasonable potential does not exist the permit includes monitoring of the discharges potential to impact the receiving stream's narrative criteria. Finally, all of the previous permit narrative criteria prohibitions have been removed from the permit given they are addressed by numeric limits where reasonable potential exists. It should also be noted that Section 644.076.1, RSMo as well as Section D – Administrative Requirements of Standard Conditions Part I of this permit state that it shall be unlawful for any person to cause or permit any discharge of water contaminants from any water contaminant or point source located in Missouri that is in violation of sections 644.006 to 644.141 of the Missouri Clean Water Law or any standard, rule, or regulation promulgated by the commission.

- (A) Waters shall be free from substances in sufficient amounts to cause the formation of putrescent, unsightly or harmful bottom deposits or prevent full maintenance of beneficial uses.
- For all outfalls, there is no RP for putrescent bottom deposits preventing full maintenance of beneficial uses because nothing disclosed by the permittee at renewal for these outfalls indicates putrescent wastewater would be discharged from the facility.
 - For all outfalls, there is no RP for unsightly or harmful bottom deposits preventing full maintenance of beneficial uses because nothing disclosed by the permittee at renewal for these outfalls indicates effluent which would cause unsightly or harmful deposits would be discharged from the facility.
- (B) Waters shall be free from oil, scum and floating debris in sufficient amounts to be unsightly or prevent full maintenance of beneficial uses.
- For all outfalls, there is no RP for oil in sufficient amounts to be unsightly preventing full maintenance of beneficial uses because nothing disclosed by the permittee at renewal or during prior sampling for DMR requirements for these outfalls indicates oil will be present in sufficient amounts to impair beneficial uses.
 - For all outfalls, there is no RP for scum and floating debris in sufficient amounts to be unsightly preventing full maintenance of beneficial uses because nothing disclosed by the permittee at renewal for these outfalls indicates scum and floating debris will be present in sufficient amounts to impair beneficial uses
- (C) Waters shall be free from substances in sufficient amounts to cause unsightly color or turbidity, offensive odor or prevent full maintenance of beneficial uses.
- For all outfalls, there is no RP for unsightly color or turbidity in sufficient amounts preventing full maintenance of beneficial uses because nothing disclosed by the permittee at renewal for these outfalls indicates unsightly color or turbidity will be present in sufficient amounts to impair beneficial uses.
 - For all outfalls, there is no RP for offensive odor in sufficient amounts preventing full maintenance of beneficial uses because nothing disclosed by the permittee at renewal for these outfalls indicates offensive odor will be present in sufficient amounts to impair beneficial uses.
- (D) Waters shall be free from substances or conditions in sufficient amounts to result in toxicity to human, animal or aquatic life.
- The permit writer considered specific toxic pollutants when writing this permit. Numeric effluent limitations are included for those pollutants that could be discharged in toxic amounts. These effluent limitations are protective of human health, animals, and aquatic life.
- (E) There shall be no significant human health hazard from incidental contact with the water.
- It is the permit writer's opinion that this criterion is the same as (D).
- (F) There shall be no acute toxicity to livestock or wildlife watering.
- It is the permit writer's opinion that this criterion is the same as (D).
- (G) Waters shall be free from physical, chemical or hydrologic changes that would impair the natural biological community.
- For all outfalls, there is no RP for physical changes that would impair the natural biological community because nothing disclosed by the permittee at renewal for these outfalls indicates physical changes that would impair the natural biological community.
 - For all outfalls, there is no RP for hydrologic changes that would impair the natural biological community because nothing disclosed by the permittee at renewal for these outfalls indicates hydrologic changes that would impair the natural biological community.
 - It has previously been established that any chemical changes are covered by the specific numeric effluent limitations established in the permit.
- (H) Waters shall be free from used tires, car bodies, appliances, demolition debris, used vehicles or equipment and solid waste as defined in Missouri's Solid Waste Law, section 260.200, RSMo, except as the use of such materials is specifically permitted pursuant to section 260.200-260.247.
- There are no solid waste disposal activities or any operation that has reasonable potential to cause or contribute to the materials listed above being discharged through any outfall.

OUTFALLS #001, #002, #003, #005, #006 – STORMWATER OUTFALLS

EFFLUENT LIMITATIONS TABLE:

PARAMETERS	UNIT	DAILY MAXIMUM LIMIT	BENCH- MARK	PREVIOUS PERMIT LIMITS	MINIMUM SAMPLING FREQUENCY	MINIMUM REPORTING FREQUENCY	SAMPLE TYPE
PHYSICAL							
FLOW	MGD	*	-	NEW	ONCE/QUARTER	ONCE/QUARTER	24 HR. ESTIMATE
PRECIPITATION	inches	*	-	NEW	ONCE/QUARTER	ONCE/QUARTER	24 HR. TOT
CONVENTIONAL							
COD	mg/L	**	70	70 LIMIT	ONCE/QUARTER	ONCE/QUARTER	GRAB
OIL & GREASE	mg/L	**	10	15 LIMIT	ONCE/QUARTER	ONCE/QUARTER	GRAB
pH †	SU	6.5 TO 9.0	-	SAME	ONCE/QUARTER	ONCE/QUARTER	GRAB
SETTLABLE SOLIDS	mL/L/hr	**	1.0	1.5 LIMIT	ONCE/QUARTER	ONCE/QUARTER	GRAB
TSS	mg/L	**	100	30 LIMIT	ONCE/QUARTER	ONCE/QUARTER	GRAB
METALS							
COPPER, TR	µg/L	**	26	26 LIMIT	ONCE/QUARTER	ONCE/QUARTER	GRAB
IRON, TR	µg/L	**	4000	1000 BENCHMARK	ONCE/QUARTER	ONCE/QUARTER	GRAB
ZINC, TR	µg/L	**	209	209 LIMIT	ONCE/QUARTER	ONCE/QUARTER	GRAB

- * Monitoring requirement only
- ** Monitoring with associated benchmark
- † Report the minimum and maximum pH values; pH is not to be averaged.
- NEW Parameter not established in previous state operating permit.
- TR Total Recoverable

DERIVATION AND DISCUSSION OF LIMITS:

PHYSICAL:

Flow

In accordance with [40 CFR Part 122.44(i)(1)(ii)] the volume of effluent discharged from each outfall is needed to assure compliance with permitted effluent limitations. If the permittee is unable to obtain effluent flow, then it is the responsibility of the permittee to inform the Department, which may require the submittal of an operating permit modification. The facility will report the total flow in millions of gallons per day (MGD).

Precipitation

Monitoring only requirement; measuring the amount of precipitation [(10 CSR 20-6.200(2)(C)1.E(VI)] during an event is necessary to ensure adequate stormwater management exists at the site. Knowing the amount of potential stormwater runoff can provide the permittee a better understanding of specific control measure that should be employed to ensure protection of water quality. The facility will provide the 24 hour accumulation value of precipitation from the day of sampling the other parameters. It is not necessary to report all days of precipitation during the quarter because of the readily available on-line data.

CONVENTIONAL:

Chemical Oxygen Demand (COD)

Monitoring, with a 70 mg/L benchmark. The previous permit required a daily maximum limit of 70 mg/L. Limits are removed from this parameter as this discharge is stormwater, and the permit writer has determined no reasonable potential to exceed the narrative water quality standards. The DMR data at this site largely shows compliance with the previous permit limits, with only one exceedance at outfall #003, at 82 mg/L. There is no water quality standard for COD; however, increased oxygen demand may impact instream water quality. COD is also a valuable indicator parameter. COD monitoring allows the permittee to identify increases in COD that may indicate materials/chemicals coming into contact with stormwater that cause an increase in oxygen demand. Increases in COD may indicate a need for maintenance or improvement of BMPs. Additionally, a benchmark value will be implemented for this parameter. The benchmark value is known to be achievable with the site's current BMPs.

Oil & Grease

Monitoring with a daily maximum benchmark of 10 mg/L. The previous permit required a daily maximum limit of 10 mg/L. Limits were removed from this parameter as the permit writer determined no reasonable potential to exceed the water quality standards, either narrative or numeric. There were no limit exceedances in the previous permit cycle. Oil and grease is considered a conventional pollutant. Oil and grease is a comprehensive test which measures for gasoline, diesel, crude oil, creosote, kerosene, heating oils, heavy fuel oils, lubricating oils, waxes, and some asphalt and pitch. The test can also detect some volatile organics such as benzene, toluene, ethylbenzene, or toluene, but these constituents are often lost during testing due to their boiling points. It is recommended to perform separate testing for these constituents if they are a known pollutant of concern at the site, i.e. aquatic life toxicity or human health is a concern. Results do not allow for separation of specific pollutants within the test, they are reported, totaled, as "oil and grease". Per 10 CSR 20-7.031 Table A: *Criteria for Designated Uses*; 10 mg/L is the standard for protection of aquatic life. This standard will also be used to protect the general criteria found at 10 CSR 20: 7.031 (4). 10 mg/L is the level at which sheen is expected to form on receiving waters. Oils and greases of different densities will possibly form sheen or unsightly bottom deposits at levels which vary from 10 mg/L. To protect the general criteria, it is the responsibility of the permittee to visually observe the discharge and receiving waters for sheen or bottom deposits.

pH

6.5 to 9.0 SU, continued from the previous permit. The Water Quality Standard at 10 CSR 20-7.031(5)(E) states water contaminants shall not cause pH to be outside the range of 6.5 to 9.0 standard pH units.

Settleable Solids (SS)

Monitoring, with a daily maximum benchmark set at 1.0 mL/L/hr. The previous permit required a daily maximum limit of 1.5 mL/L/hr. There were no exceedances of this parameter in the previous permit cycle. Limits were removed from this parameter as the permit writer determined no reasonable potential to exceed the narrative water quality standards. There is no water quality standard for SS; however, sediment discharges can negatively impact aquatic life. Increased settleable solids are known to interfere with multiple stages of the life cycle in many benthic organisms. For example, they can smother eggs and young or clog the crevasses that benthic organisms use for habitat. Settleable solids are also a valuable indicator parameter. Solids monitoring allows the permittee to identify increases in sediment and solids that may indicate uncontrolled materials leaving the site. The benchmark can be met with the site's current technology, and is protective of the losing stream setting.

Total Suspended Solids (TSS)

Monitoring, with a daily maximum benchmark of 100 mg/L. The previous permit required a daily maximum limit of 30 mg/L. The permit writer used best professional judgment to remove these limits. The permittee struggled to meet these limits in the previous permit cycle. The permit writer believes they were applied in error due to the losing stream setting; however, this discharge is stormwater only. The DMRs reported by the permittee show they are generally compliant with 100 mg/L, with only one exceedance of 100 mg/L at outfall #003, and one at outfall #005, outside of the two quarters when the facility reported massive flooding and sediment deposition at the site. It is in the best professional judgment of the permit writer that the permittee will return to compliance following the clean-up of the excess sediment, and therefore the benchmark approach is appropriate to this site. There is no water quality standard for TSS; however, sediment discharges can negatively impact aquatic life habitat. TSS is also a valuable indicator parameter. TSS monitoring allows the permittee to identify increases in TSS that may indicate uncontrolled materials leaving the site. Increased suspended solids in runoff can lead to decreased available oxygen for aquatic life and an increase of surface water temperatures in a receiving stream. Suspended solids can also be carriers of toxins, which can adsorb to the suspended particles; therefore, total suspended solids are a valuable indicator parameter for other pollution. A benchmark value will be implemented for this parameter. The benchmark value will be set at 100 mg/L. This value is achievable through proper operational and maintenance of BMPs and falls within the range of values implemented in other permits having similar industrial activities.

METALS:

General warm-water habitat criteria apply (WWH) designated as AQL in 10 CSR 20-7.031 Table A. Additional use criterion (HHP, DWS, GRW, IRR, or LWV) may also be used as applicable to determine the most protective effluent limit for the stream class and uses.

Copper, Total Recoverable

Monitoring with a daily maximum benchmark of 26 µg/L. The previous permit required a daily maximum of 26 µg/L. Limits were removed on this parameter as the permit writer determined no reasonable potential to exceed water quality standards in-stream for this parameter, either numeric or narrative. There were two exceedances of this parameter at outfall #003 during the last permit cycle, but both occurred during the catastrophic flooding event and subsequent clean-up. A benchmark value will be implemented for this parameter. This value is achievable through proper operational and maintenance of BMPs and falls within the range of values implemented in other permits having similar industrial activities, and was largely achieved by this site in the previous permit cycle.

Iron, Total Recoverable

Monitoring, with a 4000 µg/L daily maximum benchmark. The previous permit required a benchmark of 1000 µg/L, which was based on the chronic water quality standard for iron. Due to the sporadic nature of stormwater discharges, the Department, under the direction of EPA guidance, has determined chronic standards are capricious measures of stormwater discharges. Chronic effluent limitations are based on the organism's ability to survive within the designated concentration for four days. Stormwater is rarely discharged continuously for four days. After reviewing other sources of data and studies, it is in the permit writer's best professional judgment to require a 4000 µg/L daily maximum benchmark for this facility.

Zinc, Total Recoverable

Monitoring, with a daily maximum benchmark of 209 µg/L. The previous permit required a daily maximum limit of 209 µg/L. The permit writer has determined no reasonable potential to exceed water quality standards, either numeric or narrative, in-stream; therefore, limits have been removed. There was only one exceedance of this parameter outside of the periods of flooding and clean-up. The benchmark is set at a level which is known to be achievable at other industrial sites with proper use and maintenance of BMPs.

Part V. SAMPLING AND REPORTING REQUIREMENTS:

See Standard Conditions Part I attached at the end of this permit and fully incorporated within.

ELECTRONIC DISCHARGE MONITORING REPORT (EDMR) SUBMISSION SYSTEM:

The U.S. Environmental Protection Agency (EPA) promulgated a final rule on October 22, 2015, to modernize Clean Water Act reporting for municipalities, industries, and other facilities by converting to an electronic data reporting system. This final rule requires regulated entities and state and federal regulators to use information technology to electronically report data required by the National Pollutant Discharge Elimination System (NPDES) permit program instead of filing paper reports. To comply with the federal rule, the Department is requiring all permittees to begin submitting discharge monitoring data and reports online.

Per 40 CFR 127.15 and 127.24, permitted facilities may request a temporary waiver for up to 5 years or a permanent waiver from electronic reporting from the Department. To obtain an electronic reporting waiver, a permittee must first submit an eDMR Waiver Request Form: <http://dnr.mo.gov/forms/780-2692-f.pdf>. A request must be made for each facility. If more than one facility is owned or operated by a single entity, then the entity must submit a separate request for each facility based on its specific circumstances. An approved waiver is non-transferable.

The Department must review and notify the facility within 120 calendar days of receipt if the waiver request has been approved or rejected [40 CFR 124.27(a)]. During the Department review period as well as after a waiver is granted, the facility must continue submitting a hard-copy of any reports required by their permit. The Department will enter data submitted in hard-copy from those facilities allowed to do so and electronically submit the data to the EPA on behalf of the facility.

✓ The permittee/facility is currently using the eDMR data reporting system.

SAMPLING FREQUENCY JUSTIFICATION:

Sampling and reporting frequency was generally retained from previous permit. 40 CFR 122.45(d)(1) indicates all continuous discharges shall be permitted with daily maximum and monthly average limits. Sampling frequency for stormwater-only outfalls is typically quarterly even though BMP inspection occurs monthly. The facility may sample more frequently if additional data is required to determine if best management operations and technology are performing as expected.

SAMPLING TYPE JUSTIFICATION:

Sampling type was continued from the previous permit. The sampling types are representative of the discharges, and are protective of water quality. Discharges with altering effluent should have composite sampling; discharges with uniform effluent can have grab samples. Grab samples are usually appropriate for stormwater. Parameters which must have grab sampling are: pH, ammonia, *E. coli*, total residual chlorine, free available chlorine, hexavalent chromium, dissolved oxygen, total phosphorus, and volatile organic samples.

SUFFICIENTLY SENSITIVE ANALYTICAL METHODS:

Please review Standard Conditions Part 1, section A, number 4. The analytical and sampling methods used shall conform to the reference methods listed in 10 CSR 20-7.015 and/or 40 CFR 136 unless alternates are approved by the Department. The facility shall use sufficiently sensitive analytical methods for detecting, identifying, and measuring the concentrations of pollutants. The facility shall ensure the selected methods are able to quantify the presence of pollutants in a given discharge at concentrations that are low enough to determine compliance with Water Quality Standards in 10 CSR 20-7.031 or effluent limitations unless provisions in the permit allow for other alternatives. A method is "sufficiently sensitive" when; 1) the method quantifies the pollutant below the level of the applicable water quality criterion or; 2) the method minimum level is above the applicable water quality criterion, but the amount of pollutant in a facility's discharge is high enough that the method detects and quantifies the level of pollutant in the discharge, or 3)

the method has the lowest minimum level of the analytical methods approved under 10 CSR 20-7.015 and or 40 CFR 136. These methods are also required for parameters listed as monitoring only, as the data collected may be used to determine if numeric limitations need to be established. A permittee is responsible for working with their contractors to ensure the analysis performed is sufficiently sensitive. 40 CFR 136 lists the approved methods accepted by the Department. Table A at 10 CSR 20-7.031 shows water quality standards.

Part VI. ADMINISTRATIVE REQUIREMENTS

On the basis of preliminary staff review and the application of applicable standards and regulations, the Department, as administrative agent for the Missouri Clean Water Commission, proposes to issue a permit(s) subject to certain effluent limitations, schedules, and special conditions contained herein and within the operating permit. The proposed determinations are tentative pending public comment.

PERMIT SYNCHRONIZATION:

The Department of Natural Resources is currently undergoing a synchronization process for operating permits. Permits are normally issued on a five-year term, but to achieve synchronization many permits will need to be issued for less than the full five years allowed by regulation. The intent is that all permits within a watershed will move through the Watershed Based Management (WBM) cycle together will all expire in the same fiscal year. <http://dnr.mo.gov/env/wpp/cpp/docs/watershed-based-management.pdf>. This will allow further streamlining by placing multiple permits within a smaller geographic area on public notice simultaneously, thereby reducing repeated administrative efforts. This will also allow the Department to explore a watershed based permitting effort at some point in the future. Renewal applications must continue to be submitted within 180 days of expiration, however, in instances where effluent data from the previous renewal is less than three years old, that data may be re-submitted to meet the requirements of the renewal application. If the permit provides a schedule of compliance for meeting new water quality based effluent limits beyond the expiration date of the permit, the time remaining in the schedule of compliance will be allotted in the renewed permit.

✓ *This permit will become synchronized by expiring the end of the 1st quarter, 2023.*

PUBLIC NOTICE:

The Department shall give public notice that a draft permit has been prepared and its issuance is pending.

<http://dnr.mo.gov/env/wpp/permits/pn/index.html> Additionally, public notice will be issued if a public hearing is to be held because of a significant degree of interest in and water quality concerns related to a draft permit. No public notice is required when a request for a permit modification or termination is denied; however, the requester and permittee must be notified of the denial in writing.

The Department must issue public notice of a pending operating permit or of a new or reissued statewide general permit. The public comment period is the length of time not less than 30 days following the date of the public notice which interested persons may submit written comments about the proposed permit.

For persons wanting to submit comments regarding this proposed operating permit, then please refer to the Public Notice page located at the front of this draft operating permit. The Public Notice page gives direction on how and where to submit appropriate comments.

- The Public Notice period for this operating permit was from 04/27/2018 to 05/28/2018. No responses were received.

DATE OF FACT SHEET: 03/13/2018

COMPLETED BY:

AMBERLY SCHULZ, ENVIRONMENTAL SPECIALIST
MISSOURI DEPARTMENT OF NATURAL RESOURCES
WATER PROTECTION PROGRAM
OPERATING PERMITS SECTION - INDUSTRIAL UNIT
(573) 751-8049
Amberly.schulz@dnr.mo.gov



STANDARD CONDITIONS FOR NPDES PERMITS
ISSUED BY
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION
REVISED
AUGUST 1, 2014

These Standard Conditions incorporate permit conditions as required by 40 CFR 122.41 or other applicable state statutes or regulations. These minimum conditions apply unless superseded by requirements specified in the permit.

Part I – General Conditions

Section A – Sampling, Monitoring, and Recording

1. **Sampling Requirements.**
 - a. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity.
 - b. All samples shall be taken at the outfall(s) or Missouri Department of Natural Resources (Department) approved sampling location(s), and unless specified, before the effluent joins or is diluted by any other body of water or substance.
2. **Monitoring Requirements.**
 - a. Records of monitoring information shall include:
 - i. The date, exact place, and time of sampling or measurements;
 - ii. The individual(s) who performed the sampling or measurements;
 - iii. The date(s) analyses were performed;
 - iv. The individual(s) who performed the analyses;
 - v. The analytical techniques or methods used; and
 - vi. The results of such analyses.
 - b. If the permittee monitors any pollutant more frequently than required by the permit at the location specified in the permit using test procedures approved under 40 CFR Part 136, or another method required for an industry-specific waste stream under 40 CFR subchapters N or O, the results of such monitoring shall be included in the calculation and reported to the Department with the discharge monitoring report data (DMR) submitted to the Department pursuant to Section B, paragraph 7.
3. **Sample and Monitoring Calculations.** Calculations for all sample and monitoring results which require averaging of measurements shall utilize an arithmetic mean unless otherwise specified in the permit.
4. **Test Procedures.** The analytical and sampling methods used shall conform to the reference methods listed in 10 CSR 20-7.015 unless alternates are approved by the Department. The facility shall use sufficiently sensitive analytical methods for detecting, identifying, and measuring the concentrations of pollutants. The facility shall ensure that the selected methods are able to quantify the presence of pollutants in a given discharge at concentrations that are low enough to determine compliance with Water Quality Standards in 10 CSR 20-7.031 or effluent limitations unless provisions in the permit allow for other alternatives. A method is “sufficiently sensitive” when; 1) the method minimum level is at or below the level of the applicable water quality criterion for the pollutant or, 2) the method minimum level is above the applicable water quality criterion, but the amount of pollutant in a facility’s discharge is high enough that the method detects and quantifies the level of pollutant in the discharge, or 3) the method has the lowest minimum level of the analytical methods approved under 10 CSR 20-7.015. These methods are also required for parameters that are listed as monitoring only, as the data collected may be used to determine if limitations need to be established. A permittee is responsible for working with their contractors to ensure that the analysis performed is sufficiently sensitive.
5. **Record Retention.** Except for records of monitoring information required by the permit related to the permittee’s sewage sludge use and disposal activities, which shall be retained for a period of at least five (5) years (or longer as required by 40 CFR part 503), the permittee shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by the permit, and records of all data used to complete the application for the permit, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Department at any time.

6. **Illegal Activities.**
 - a. The Federal Clean Water Act provides that any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under the permit shall, upon conviction, be punished by a fine of not more than \$10,000, or by imprisonment for not more than two (2) years, or both. If a conviction of a person is for a violation committed after a first conviction of such person under this paragraph, punishment is a fine of not more than \$20,000 per day of violation, or by imprisonment of not more than four (4) years, or both.
 - b. The Missouri Clean Water Law provides that any person or who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained pursuant to sections 644.006 to 644.141 shall, upon conviction, be punished by a fine of not more than \$10,000, or by imprisonment for not more than six (6) months, or by both. Second and successive convictions for violation under this paragraph by any person shall be punished by a fine of not more than \$50,000 per day of violation, or by imprisonment for not more than two (2) years, or both.

Section B – Reporting Requirements

1. **Planned Changes.**
 - a. The permittee shall give notice to the Department as soon as possible of any planned physical alterations or additions to the permitted facility when:
 - i. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in 40 CFR 122.29(b); or
 - ii. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants which are subject neither to effluent limitations in the permit, nor to notification requirements under 40 CFR 122.42;
 - iii. The alteration or addition results in a significant change in the permittee’s sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan;
 - iv. Any facility expansions, production increases, or process modifications which will result in a new or substantially different discharge or sludge characteristics must be reported to the Department 60 days before the facility or process modification begins. Notification may be accomplished by application for a new permit. If the discharge does not violate effluent limitations specified in the permit, the facility is to submit a notice to the Department of the changed discharge at least 30 days before such changes. The Department may require a construction permit and/or permit modification as a result of the proposed changes at the facility.
2. **Non-compliance Reporting.**
 - a. The permittee shall report any noncompliance which may endanger health or the environment. Relevant information shall be provided orally or via the current electronic method approved by the Department, within 24 hours from the time the permittee becomes aware of the circumstances, and shall be reported to the appropriate Regional Office during normal business hours or the Environmental Emergency Response hotline at 573-634-2436 outside of normal business hours. A written submission shall also be provided within five (5) business days of the time the permittee becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance.



STANDARD CONDITIONS FOR NPDES PERMITS
ISSUED BY
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION
REVISED
AUGUST 1, 2014

- b. The following shall be included as information which must be reported within 24 hours under this paragraph.
 - i. Any unanticipated bypass which exceeds any effluent limitation in the permit.
 - ii. Any upset which exceeds any effluent limitation in the permit.
 - iii. Violation of a maximum daily discharge limitation for any of the pollutants listed by the Department in the permit required to be reported within 24 hours.
 - c. The Department may waive the written report on a case-by-case basis for reports under paragraph 2. b. of this section if the oral report has been received within 24 hours.
3. **Anticipated Noncompliance.** The permittee shall give advance notice to the Department of any planned changes in the permitted facility or activity which may result in noncompliance with permit requirements. The notice shall be submitted to the Department 60 days prior to such changes or activity.
 4. **Compliance Schedules.** Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of the permit shall be submitted no later than 14 days following each schedule date. The report shall provide an explanation for the instance of noncompliance and a proposed schedule or anticipated date, for achieving compliance with the compliance schedule requirement.
 5. **Other Noncompliance.** The permittee shall report all instances of noncompliance not reported under paragraphs 2, 3, and 6 of this section, at the time monitoring reports are submitted. The reports shall contain the information listed in paragraph 2. a. of this section.
 6. **Other Information.** Where the permittee becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Department, it shall promptly submit such facts or information.
 7. **Discharge Monitoring Reports.**
 - a. Monitoring results shall be reported at the intervals specified in the permit.
 - b. Monitoring results must be reported to the Department via the current method approved by the Department, unless the permittee has been granted a waiver from using the method. If the permittee has been granted a waiver, the permittee must use forms provided by the Department.
 - c. Monitoring results shall be reported to the Department no later than the 28th day of the month following the end of the reporting period.
- b. Notice.
 - i. Anticipated bypass. If the permittee knows in advance of the need for a bypass, it shall submit prior notice, if possible at least 10 days before the date of the bypass.
 - ii. Unanticipated bypass. The permittee shall submit notice of an unanticipated bypass as required in Section B – Reporting Requirements, paragraph 5 (24-hour notice).
 - c. Prohibition of bypass.
 - i. Bypass is prohibited, and the Department may take enforcement action against a permittee for bypass, unless:
 1. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage;
 2. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventive maintenance; and
 3. The permittee submitted notices as required under paragraph 2. b. of this section.
 - ii. The Department may approve an anticipated bypass, after considering its adverse effects, if the Department determines that it will meet the three (3) conditions listed above in paragraph 2. c. i. of this section.
3. **Upset Requirements.**
 - a. Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology based permit effluent limitations if the requirements of paragraph 3. b. of this section are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review.
 - b. Conditions necessary for a demonstration of upset. A permittee who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs, or other relevant evidence that:
 - i. An upset occurred and that the permittee can identify the cause(s) of the upset;
 - ii. The permitted facility was at the time being properly operated; and
 - iii. The permittee submitted notice of the upset as required in Section B – Reporting Requirements, paragraph 2. b. ii. (24-hour notice).
 - iv. The permittee complied with any remedial measures required under Section D – Administrative Requirements, paragraph 4.
 - c. Burden of proof. In any enforcement proceeding, the permittee seeking to establish the occurrence of an upset has the burden of proof.

Section C – Bypass/Upset Requirements

1. **Definitions.**
 - a. *Bypass*: the intentional diversion of waste streams from any portion of a treatment facility, except in the case of blending.
 - b. *Severe Property Damage*: substantial physical damage to property, damage to the treatment facilities which causes them to become inoperable, or substantial and permanent loss of natural resources which can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production.
 - c. *Upset*: an exceptional incident in which there is unintentional and temporary noncompliance with technology based permit effluent limitations because of factors beyond the reasonable control of the permittee. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation.
2. **Bypass Requirements.**
 - a. Bypass not exceeding limitations. The permittee may allow any bypass to occur which does not cause effluent limitations to be exceeded, but only if it also is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions of paragraphs 2. b. and 2. c. of this section.

Section D – Administrative Requirements

1. **Duty to Comply.** The permittee must comply with all conditions of this permit. Any permit noncompliance constitutes a violation of the Missouri Clean Water Law and Federal Clean Water Act and is grounds for enforcement action; for permit termination, revocation and reissuance, or modification; or denial of a permit renewal application.
 - a. The permittee shall comply with effluent standards or prohibitions established under section 307(a) of the Federal Clean Water Act for toxic pollutants and with standards for sewage sludge use or disposal established under section 405(d) of the CWA within the time provided in the regulations that establish these standards or prohibitions or standards for sewage sludge use or disposal, even if the permit has not yet been modified to incorporate the requirement.
 - b. The Federal Clean Water Act provides that any person who violates section 301, 302, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any such sections in a permit issued under section 402, or any requirement imposed in a pretreatment program approved under sections 402(a)(3) or 402(b)(8) of the Act, is subject to a civil penalty not to exceed \$25,000 per day for each violation. The Federal Clean Water Act provides that any person who negligently violates sections 301, 302, 306, 307, 308, 318, or 405 of the Act, or any condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, or any requirement



STANDARD CONDITIONS FOR NPDES PERMITS
ISSUED BY
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION
REVISED
AUGUST 1, 2014

- imposed in a pretreatment program approved under section 402(a)(3) or 402(b)(8) of the Act, is subject to criminal penalties of \$2,500 to \$25,000 per day of violation, or imprisonment of not more than one (1) year, or both. In the case of a second or subsequent conviction for a negligent violation, a person shall be subject to criminal penalties of not more than \$50,000 per day of violation, or by imprisonment of not more than two (2) years, or both. Any person who knowingly violates such sections, or such conditions or limitations is subject to criminal penalties of \$5,000 to \$50,000 per day of violation, or imprisonment for not more than three (3) years, or both. In the case of a second or subsequent conviction for a knowing violation, a person shall be subject to criminal penalties of not more than \$100,000 per day of violation, or imprisonment of not more than six (6) years, or both. Any person who knowingly violates section 301, 302, 303, 306, 307, 308, 318 or 405 of the Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of the Act, and who knows at that time that he thereby places another person in imminent danger of death or serious bodily injury, shall, upon conviction, be subject to a fine of not more than \$250,000 or imprisonment of not more than 15 years, or both. In the case of a second or subsequent conviction for a knowing endangerment violation, a person shall be subject to a fine of not more than \$500,000 or by imprisonment of not more than 30 years, or both. An organization, as defined in section 309(c)(3)(B)(iii) of the CWA, shall, upon conviction of violating the imminent danger provision, be subject to a fine of not more than \$1,000,000 and can be fined up to \$2,000,000 for second or subsequent convictions.
- c. Any person may be assessed an administrative penalty by the EPA Director for violating section 301, 302, 306, 307, 308, 318 or 405 of this Act, or any permit condition or limitation implementing any of such sections in a permit issued under section 402 of this Act. Administrative penalties for Class I violations are not to exceed \$10,000 per violation, with the maximum amount of any Class I penalty assessed not to exceed \$25,000. Penalties for Class II violations are not to exceed \$10,000 per day for each day during which the violation continues, with the maximum amount of any Class II penalty not to exceed \$125,000.
- d. It is unlawful for any person to cause or permit any discharge of water contaminants from any water contaminant or point source located in Missouri in violation of sections 644.006 to 644.141 of the Missouri Clean Water Law, or any standard, rule or regulation promulgated by the commission. In the event the commission or the director determines that any provision of sections 644.006 to 644.141 of the Missouri Clean Water Law or standard, rules, limitations or regulations promulgated pursuant thereto, or permits issued by, or any final abatement order, other order, or determination made by the commission or the director, or any filing requirement pursuant to sections 644.006 to 644.141 of the Missouri Clean Water Law or any other provision which this state is required to enforce pursuant to any federal water pollution control act, is being, was, or is in imminent danger of being violated, the commission or director may cause to have instituted a civil action in any court of competent jurisdiction for the injunctive relief to prevent any such violation or further violation or for the assessment of a penalty not to exceed \$10,000 per day for each day, or part thereof, the violation occurred and continues to occur, or both, as the court deems proper. Any person who willfully or negligently commits any violation in this paragraph shall, upon conviction, be punished by a fine of not less than \$2,500 nor more than \$25,000 per day of violation, or by imprisonment for not more than one year, or both. Second and successive convictions for violation of the same provision of this paragraph by any person shall be punished by a fine of not more than \$50,000 per day of violation, or by imprisonment for not more than two (2) years, or both.
2. **Duty to Reapply.**
- a. If the permittee wishes to continue an activity regulated by this permit after the expiration date of this permit, the permittee must apply for and obtain a new permit.
- b. A permittee with a currently effective site-specific permit shall submit an application for renewal at least 180 days before the expiration date of the existing permit, unless permission for a later date has been granted by the Department. (The Department shall not grant permission for applications to be submitted later than the expiration date of the existing permit.)
- c. A permittee with currently effective general permit shall submit an application for renewal at least 30 days before the existing permit expires, unless the permittee has been notified by the Department that an earlier application must be made. The Department may grant permission for a later submission date. (The Department shall not grant permission for applications to be submitted later than the expiration date of the existing permit.)
3. **Need to Halt or Reduce Activity Not a Defense.** It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.
4. **Duty to Mitigate.** The permittee shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal in violation of this permit which has a reasonable likelihood of adversely affecting human health or the environment.
5. **Proper Operation and Maintenance.** The permittee shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the permittee to achieve compliance with the conditions of this permit. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of back-up or auxiliary facilities or similar systems which are installed by a permittee only when the operation is necessary to achieve compliance with the conditions of the permit.
6. **Permit Actions.**
- a. Subject to compliance with statutory requirements of the Law and Regulations and applicable Court Order, this permit may be modified, suspended, or revoked in whole or in part during its term for cause including, but not limited to, the following:
- i. Violations of any terms or conditions of this permit or the law;
- ii. Having obtained this permit by misrepresentation or failure to disclose fully any relevant facts;
- iii. A change in any circumstances or conditions that requires either a temporary or permanent reduction or elimination of the authorized discharge; or
- iv. Any reason set forth in the Law or Regulations.
- b. The filing of a request by the permittee for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any permit condition.
7. **Permit Transfer.**
- a. Subject to 10 CSR 20-6.010, an operating permit may be transferred upon submission to the Department of an application to transfer signed by the existing owner and the new owner, unless prohibited by the terms of the permit. Until such time the permit is officially transferred, the original permittee remains responsible for complying with the terms and conditions of the existing permit.
- b. The Department may require modification or revocation and reissuance of the permit to change the name of the permittee and incorporate such other requirements as may be necessary under the Missouri Clean Water Law or the Federal Clean Water Act.
- c. The Department, within 30 days of receipt of the application, shall notify the new permittee of its intent to revoke or reissue or transfer the permit.
8. **Toxic Pollutants.** The permittee shall comply with effluent standards or prohibitions established under section 307(a) of the Federal Clean Water Act for toxic pollutants and with standards for sewage sludge use or disposal established under section 405(d) of the Federal Clean Water Act within the time provided in the regulations that establish these standards or prohibitions or standards for sewage sludge use or disposal, even if the permit has not yet been modified to incorporate the requirement.
9. **Property Rights.** This permit does not convey any property rights of any sort, or any exclusive privilege.



STANDARD CONDITIONS FOR NPDES PERMITS
ISSUED BY
THE MISSOURI DEPARTMENT OF NATURAL RESOURCES
MISSOURI CLEAN WATER COMMISSION
REVISED
AUGUST 1, 2014

10. **Duty to Provide Information.** The permittee shall furnish to the Department, within a reasonable time, any information which the Department may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit or to determine compliance with this permit. The permittee shall also furnish to the Department upon request, copies of records required to be kept by this permit.
11. **Inspection and Entry.** The permittee shall allow the Department, or an authorized representative (including an authorized contractor acting as a representative of the Department), upon presentation of credentials and other documents as may be required by law, to:
 - a. Enter upon the permittee's premises where a regulated facility or activity is located or conducted, or where records must be kept under the conditions of the permit;
 - b. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this permit;
 - c. Inspect at reasonable times any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this permit; and
 - d. Sample or monitor at reasonable times, for the purposes of assuring permit compliance or as otherwise authorized by the Federal Clean Water Act or Missouri Clean Water Law, any substances or parameters at any location.
12. **Closure of Treatment Facilities.**
 - a. Persons who cease operation or plan to cease operation of waste, wastewater, and sludge handling and treatment facilities shall close the facilities in accordance with a closure plan approved by the Department.
 - b. Operating Permits under 10 CSR 20-6.010 or under 10 CSR 20-6.015 are required until all waste, wastewater, and sludges have been disposed of in accordance with the closure plan approved by the Department and any disturbed areas have been properly stabilized. Disturbed areas will be considered stabilized when perennial vegetation, pavement, or structures using permanent materials cover all areas that have been disturbed. Vegetative cover, if used, shall be at least 70% plant density over 100% of the disturbed area.
13. **Signatory Requirement.**
 - a. All permit applications, reports required by the permit, or information requested by the Department shall be signed and certified. (See 40 CFR 122.22 and 10 CSR 20-6.010)
 - b. The Federal Clean Water Act provides that any person who knowingly makes any false statement, representation, or certification in any record or other document submitted or required to be maintained under this permit, including monitoring reports or reports of compliance or non-compliance shall, upon conviction, be punished by a fine of not more than \$10,000 per violation, or by imprisonment for not more than six (6) months per violation, or by both.
 - c. The Missouri Clean Water Law provides that any person who knowingly makes any false statement, representation or certification in any application, record, report, plan, or other document filed or required to be maintained pursuant to sections 644.006 to 644.141 shall, upon conviction, be punished by a fine of not more than ten thousand dollars, or by imprisonment for not more than six months, or by both.
14. **Severability.** The provisions of the permit are severable, and if any provision of the permit, or the application of any provision of the permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of the permit, shall not be affected thereby.

27730

RECEIVED

JUL 31 2017



MISSOURI DEPARTMENT OF NATURAL RESOURCES WATER PROTECTION PROGRAM FORM A - APPLICATION FOR NONDOMESTIC PERMIT UNDER MISSOURI CLEAN WATER LAW

FOR AGENCY USE ONLY CHECK NUMBER DATE RECEIVED 7-31-17 FEE SUBMITTED

Handwritten initials and signature

Note PLEASE READ THE ACCOMPANYING INSTRUCTIONS BEFORE COMPLETING THIS FORM.

1. This application is for: [] An operating permit for a new or unpermitted facility: Please indicate the original Construction Permit # [] An operating permit renewal: Please indicate the permit # MO- 0137812 Expiration Date 03/31/2018 [] An operating permit modification: Please indicate the permit # MO- Modification Reason:

1.1 Is the appropriate fee included with the application? (See instructions for appropriate fee) [] YES [x] NO

2. FACILITY

NAME DRS-SSI TELEPHONE NUMBER WITH AREA CODE (417) 257-6445 ADDRESS (PHYSICAL) #1 McDaniel Street CITY West Plains STATE MO ZIP CODE 65775

3. OWNER

NAME DRS Technologies Inc. EMAIL ADDRESS droth@drs.com TELEPHONE NUMBER WITH AREA CODE (314) 553-4146 ADDRESS (MAILING) 201 Evans Lane CITY St. Louis STATE MO ZIP CODE 63121

3.1 Request review of draft permit prior to public notice? [x] YES [] NO

4. CONTINUING AUTHORITY

NAME Stephen Foster EMAIL ADDRESS Steve.Foster@drs.com TELEPHONE NUMBER WITH AREA CODE (417) 257-2636 ADDRESS (MAILING) #1 McDaniel Street CITY West Plains STATE MO ZIP CODE 65775

5. OPERATOR

NAME CERTIFICATE NUMBER TELEPHONE NUMBER WITH AREA CODE ADDRESS (MAILING) CITY STATE ZIP CODE

6. FACILITY CONTACT

NAME Tammy L. Hampton TITLE EHS Coordinator TELEPHONE NUMBER WITH AREA CODE (417) 257-6445 E-MAIL ADDRESS thampton@drs.com

7. ADDITIONAL FACILITY INFORMATION

7.1 Legal Description of Outfalls. (Attach additional sheets if necessary.) 001 NE 1/4 NE 1/4 Sec 20 T 24N R 8W Howell County UTM Coordinates Easting (X): 601677 Northing (Y): 4066773 For Universal Transverse Mercator (UTM), Zone 15 North referenced to North American Datum 1983 (NAD83) 002 NE 1/4 NE 1/4 Sec 20 T 24N R 8W Howell County UTM Coordinates Easting (X): 601678 Northing (Y): 4066768 003 NE 1/4 NE 1/4 Sec 20 T 24N R 8W Howell County UTM Coordinates Easting (X): 601644 Northing (Y): 4066731 004 N/A 1/4 Sec T R County UTM Coordinates Easting (X): Northing (Y):

7.2 Primary Standard Industrial Classification (SIC) and Facility North American Industrial Classification System (NAICS) Codes. 001 - SIC 3715 and NAICS 336212 002 - SIC and NAICS 003 - SIC and NAICS 004 - SIC and NAICS


Form A
DRS-SSI
MO-0137812

7.1 (continued)

- 004 Removed from service

- 005 NE $\frac{1}{4}$, NE $\frac{1}{4}$, Sec 20, T24N, R8W, Howell County
X: 601994, Y: 4066399

- 006 NE $\frac{1}{4}$, NE $\frac{1}{4}$, Sec 20, T24N, R8W, Howell County
X: 601817, Y: 4066601

8. ADDITIONAL FORMS AND MAPS NECESSARY TO COMPLETE THIS APPLICATION (Complete all forms that are applicable.)			
A.	Is your facility a manufacturing, commercial, mining or silviculture waste treatment facility? If yes, complete Form C or 2F. (2F is the U.S. EPA's Application for Storm Water Discharges Associate with Industrial Activity.)	YES <input type="checkbox"/>	NO <input checked="" type="checkbox"/>
B.	Is application for storm water discharges only? If yes, complete Form C or 2F.	YES <input checked="" type="checkbox"/>	NO <input type="checkbox"/>
C.	Is your facility considered a "Primary Industry" under EPA guidelines: If yes, complete Forms C or 2F and D.	YES <input type="checkbox"/>	NO <input checked="" type="checkbox"/>
D.	Is wastewater land applied? If yes, complete Form I.	YES <input type="checkbox"/>	NO <input checked="" type="checkbox"/>
E.	Is sludge, biosolids, ash or residuals generated, treated, stored or land applied? If yes, complete Form R.	YES <input type="checkbox"/>	NO <input checked="" type="checkbox"/>
F.	If you are a Class IA CAFO, please disregard part D and E of this section. However, please attach any revision to your Nutrient Management Plan.		
F.	Attach a map showing all outfalls and the receiving stream at 1" = 2,000' scale.		
9. ELECTRONIC DISCHARGE MONITORING REPORT (eDMR) SUBMISSION SYSTEM			
Per 40 CFR Part 127 National Pollutant Discharge Elimination System (NPDES) Electronic Reporting Rule, reporting of effluent limits and monitoring shall be submitted by the permittee via an electronic system to ensure timely, complete, accurate, and nationally consistent set of data. One of the following must be checked in order for this application to be considered complete. Please visit http://dnr.mo.gov/env/wpp/edmr.htm to access the Facility Participation Package.			
<input type="checkbox"/> - You have completed and submitted with this permit application the required documentation to participate in the eDMR system.			
<input checked="" type="checkbox"/> - You have previously submitted the required documentation to participate in the eDMR system and/or you are currently using the eDMR system.			
<input type="checkbox"/> - You have submitted a written request for a waiver from electronic reporting. See instructions for further information regarding waivers.			
10. DOWNSTREAM LANDOWNER(S) Attach additional sheets as necessary. See Instructions. (PLEASE SHOW LOCATION ON MAP. SEE 8.D ABOVE).			
NAME Armstrong Wood Products, Inc.			
ADDRESS 508 W. Thornburgh Street		CITY West Plains	STATE MO
			ZIP CODE 65775
11. I certify that I am familiar with the information contained in the application, that to the best of my knowledge and belief such information is true, complete and accurate, and if granted this permit, I agree to abide by the Missouri Clean Water Law and all rules, regulations, orders and decisions, subject to any legitimate appeal available to applicant under the Missouri Clean Water Law to the Missouri Clean Water Commission.			
NAME AND OFFICIAL TITLE (TYPE OR PRINT) Stephen Foster, VP Site Leader		TELEPHONE NUMBER WITH AREA CODE (417) 257-6236	
SIGNATURE 		DATE SIGNED 07/25/17	

MO 780-1473 (09/16)

BEFORE MAILING, PLEASE ENSURE ALL SECTIONS ARE COMPLETED AND ADDITIONAL FORMS, IF APPLICABLE, ARE INCLUDED.

Submittal of an incomplete application may result in the application being returned.


HAVE YOU INCLUDED:

- | | |
|--|---|
| <input type="checkbox"/> Appropriate Fees? | <input type="checkbox"/> Form I (Irrigation), if applicable? |
| <input checked="" type="checkbox"/> Map at 1" = 2000' scale? | <input type="checkbox"/> Form R (Sludge), if applicable? |
| <input checked="" type="checkbox"/> Signature? | <input type="checkbox"/> Revised Nutrient Management Plan, if applicable? |
| <input checked="" type="checkbox"/> Form C or 2F, if applicable? | |
| <input type="checkbox"/> Form D, if applicable? | |

FIGURE 1



**FIGURE 2 T24N, R8W, Sec. 16, 17, 20 & 21
West Plains USGS Quadrangle**

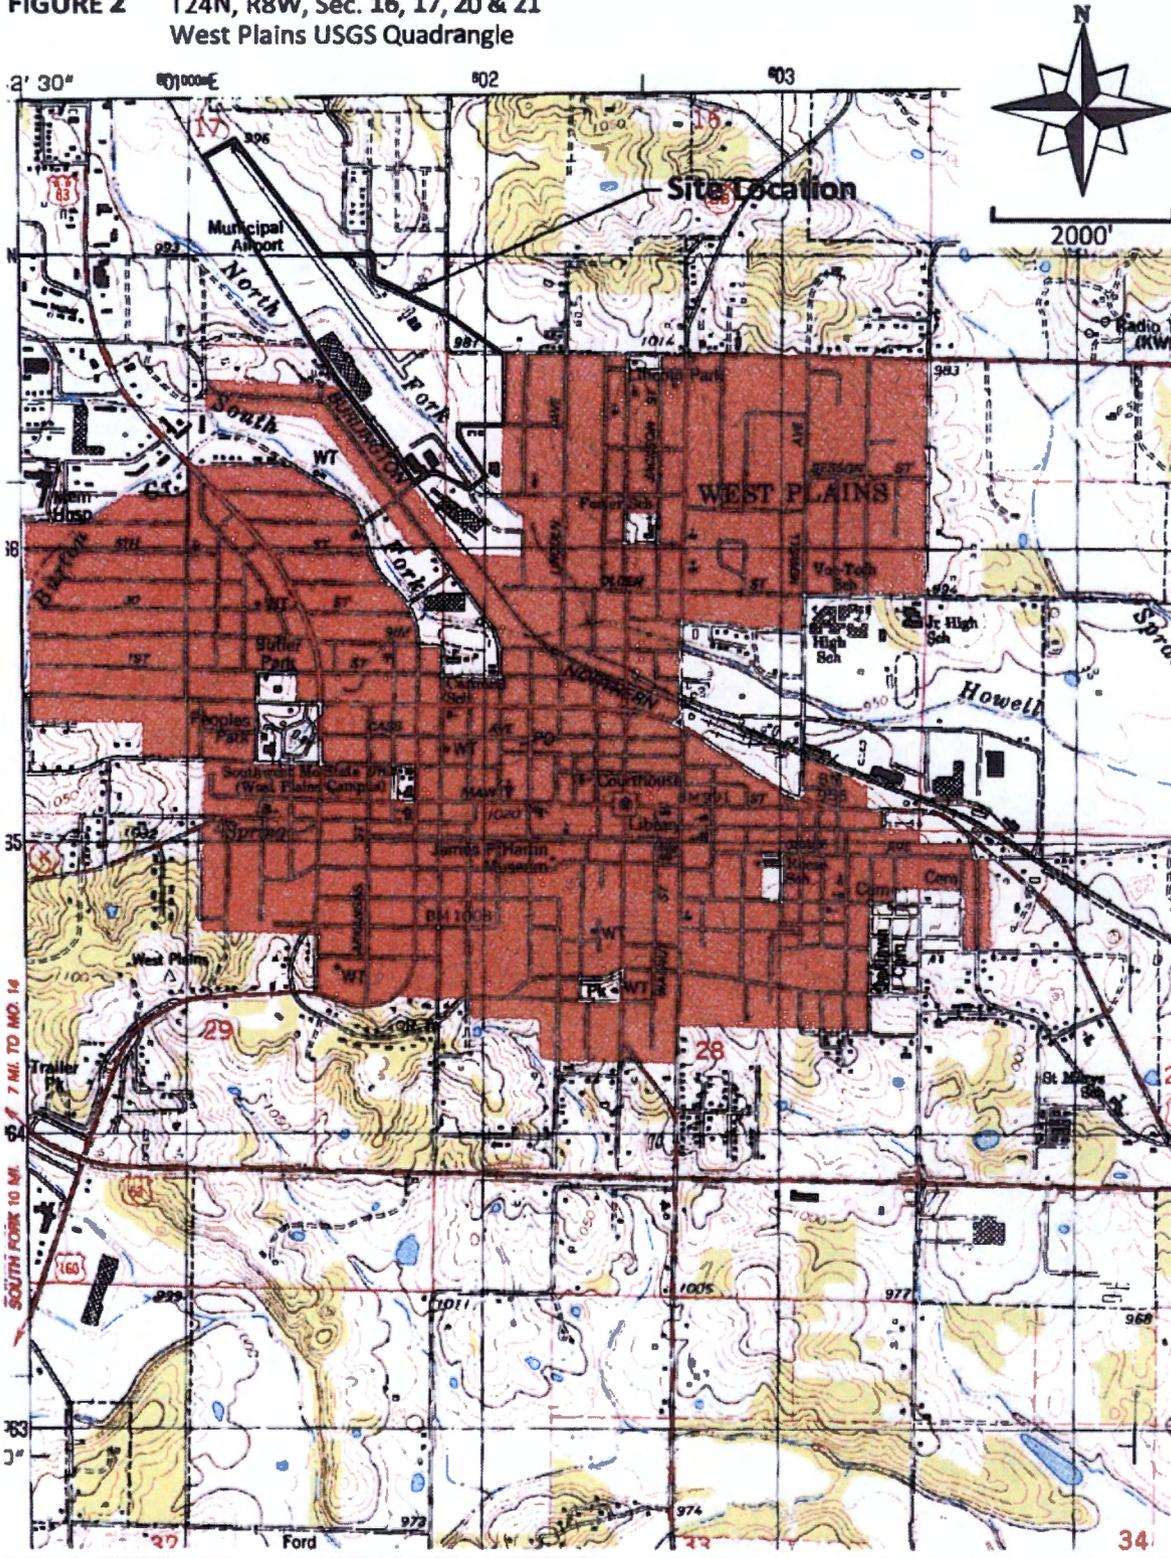



MISSOURI DEPARTMENT OF NATURAL RESOURCES
 WATER PROTECTION PROGRAM, WATER POLLUTION BRANCH
FORM C – APPLICATION FOR DISCHARGE PERMIT –
MANUFACTURING, COMMERCIAL, MINING,
SILVICULTURE OPERATIONS, PROCESS AND STORMWATER

FOR AGENCY USE ONLY	
CHECK NO.	
DATE RECEIVED	FEE SUBMITTED

NOTE: DO NOT ATTEMPT TO COMPLETE THIS FORM BEFORE READING THE ACCOMPANYING INSTRUCTIONS

1.00 NAME OF FACILITY
 DRS-SSI

1.10 THIS FACILITY IS NOW IN OPERATION UNDER MISSOURI OPERATING PERMIT NUMBER
 MO-0137812

1.20 THIS IS A NEW FACILITY AND WAS CONSTRUCTED UNDER MISSOURI CONSTRUCTION PERMIT NUMBER (COMPLETE ONLY IF THIS FACILITY DOES NOT HAVE AN OPERATING PERMIT).
 N/A

2.00 LIST THE STANDARD INDUSTRIAL CLASSIFICATION (SIC) CODES APPLICABLE TO YOUR FACILITY (FOUR DIGIT CODE)

A. FIRST 3715 B. SECOND N/A
 C. THIRD _____ D. FOURTH _____

2.10 FOR EACH OUTFALL GIVE THE LEGAL DESCRIPTION.

OUTFALL NUMBER (LIST) NE 1/4 NE 1/4 SEC 20 T 24N R 8W Howell COUNTY
 001, 002, 003, 005, 006

2.20 FOR EACH OUTFALL LIST THE NAME OF THE RECEIVING WATER

OUTFALL NUMBER (LIST)	RECEIVING WATER
001, 002, 003, 005, 006 (004 eliminated)	Howell Creek

2.30 BRIEFLY DESCRIBE THE NATURE OF YOUR BUSINESS
 Truck and trailer manufacturing.

2.40 CONTINUED

C. EXCEPT FOR STORM RUNOFF, LEAKS OR SPILLS, ARE ANY OF THE DISCHARGES DESCRIBED IN ITEMS A OR B INTERMITTENT OR SEASONAL?

YES (COMPLETE THE FOLLOWING TABLE) NO (GO TO SECTION 2.50)

1. OUTFALL NUMBER <i>(list)</i>	2. OPERATION(S) CONTRIBUTING FLOW <i>(list)</i>	3. FREQUENCY		4. FLOW				C. DURATION <i>(in days)</i>
		A. DAYS PER WEEK <i>(specify average)</i>	B. MONTHS PER YEAR <i>(specify average)</i>	A. FLOW RATE <i>(in mgd)</i>		B. TOTAL VOLUME <i>(specify with units)</i>		
				1. LONG TERM AVERAGE	2. MAXIMUM DAILY	4. LONG TERM DAILY	3. MAXIMUM AVERAGE	

2.50 MAXIMUM PRODUCTION

A. DOES AN EFFLUENT GUIDELINE LIMITATION PROMULGATED BY EPA UNDER SECTION 304 OF THE CLEAN WATER ACT APPLY TO YOUR FACILITY?
 YES (COMPLETE B.) NO (GO TO SECTION 2.60)

B. ARE THE LIMITATIONS IN THE APPLICABLE EFFLUENT GUIDELINES EXPRESSED IN TERMS OF PRODUCTION (OF OTHER MEASURE OF OPERATION)?
 YES (COMPLETE C.) NO (GO TO SECTION 2.60)

C. IF YOU ANSWERED "YES" TO B. LIST THE QUANTITY THAT REPRESENTS AN ACTUAL MEASUREMENT OF YOUR MAXIMUM LEVEL OF PRODUCTION, EXPRESSED IN THE TERMS AND UNITS USED IN THE APPLICABLE EFFLUENT GUIDELINE AND INDICATE THE AFFECTED OUTFALLS.

1. MAXIMUM QUANTITY			2. AFFECTED OUTFALLS <i>(list outfall numbers)</i>
A. QUANTITY PER DAY	B. UNITS OF MEASURE	C. OPERATION, PRODUCT, MATERIAL, ETC. <i>(specify)</i>	

2.60 IMPROVEMENTS

A. ARE YOU NOW REQUIRED BY ANY FEDERAL, STATE OR LOCAL AUTHORITY TO MEET, ANY IMPLEMENTATION SCHEDULE FOR THE CONSTRUCTION, UPGRADING OR OPERATION OF WASTEWATER TREATMENT EQUIPMENT OR PRACTICES OR ANY OTHER ENVIRONMENTAL PROGRAMS THAT MAY AFFECT THE DISCHARGES DESCRIBED IN THIS APPLICATION? THIS INCLUDES, BUT IS NOT LIMITED TO, PERMIT CONDITIONS, ADMINISTRATIVE OR ENFORCEMENT ORDERS, ENFORCEMENT COMPLIANCE SCHEDULE LETTERS, STIPULATIONS, COURT ORDERS AND GRANT OR LOAN CONDITIONS.
 YES (COMPLETE THE FOLLOWING TABLE) NO (GO TO 3.00)

1. IDENTIFICATION OF CONDITION AGREEMENT, ETC.	2. AFFECTED OUTFALLS		3. BRIEF DESCRIPTION OF PROJECT	4. FINAL COMPLIANCE DATE	
				A. REQUIRED	B. PROJECTED

B. OPTIONAL: YOU MAY ATTACH ADDITIONAL SHEETS DESCRIBING ANY ADDITIONAL WATER POLLUTION CONTROL PROGRAMS (OR OTHER ENVIRONMENTAL PROJECTS WHICH MAY AFFECT YOUR DISCHARGES) YOU NOW HAVE UNDER WAY OR WHICH YOU PLAN. INDICATE WHETHER EACH PROGRAM IS NOW UNDER WAY OR PLANNED, AND INDICATE YOUR ACTUAL OR PLANNED SCHEDULES FOR CONSTRUCTION.

MARK "X" IF DESCRIPTION OF ADDITIONAL CONTROL PROGRAMS IS ATTACHED.

3.10 BIOLOGICAL TOXICITY TESTING DATA

DO YOU HAVE ANY KNOWLEDGE OR REASON TO BELIEVE THAT ANY BIOLOGICAL TEST FOR ACUTE OR CHRONIC TOXICITY HAS BEEN MADE ON ANY OF YOUR DISCHARGES OR ON RECEIVING WATER IN RELATION TO YOUR DISCHARGE WITHIN THE LAST THREE YEARS?

YES (IDENTIFY THE TEST(S) AND DESCRIBE THEIR PURPOSES BELOW.) NO (GO TO 3.20)

3.20 CONTRACT ANALYSIS INFORMATION


WERE ANY OF THE ANALYSES REPORTED PERFORMED BY A CONTRACT LABORATORY OR CONSULTING FIRM?

YES (LIST THE NAME, ADDRESS AND TELEPHONE NUMBER OF AND POLLUTANTS ANALYZED BY EACH SUCH LABORATORY OR FIRM BELOW.) NO (GO TO 3.30)

A. NAME	B. ADDRESS	C. TELEPHONE (area code and number)	D. POLLUTANTS ANALYZED (list)
PDC Laboratories, Inc.	1805 West Sunset Street, Springfield, MO 65807	417-864-8924	chemical oxygen demand oil & grease settleable solids total suspended solids copper iron zinc

3.30 CERTIFICATION

I CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM FAMILIAR WITH THE INFORMATION SUBMITTED IN THIS APPLICATION AND ALL ATTACHMENTS AND THAT, BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THAT THE INFORMATION IS TRUE, ACCURATE AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT.

NAME AND OFFICIAL TITLE (TYPE OR PRINT) Stephen Foster, VP Site Leader	TELEPHONE NUMBER WITH AREA CODE (417) 257-6236
SIGNATURE (SEE INSTRUCTIONS) 	DATE SIGNED 07/25/17

PLEASE PRINT OR TYPE. You may report some or all of this information on separate sheet (Use the same format) instead of completing these pages.
SEE INSTRUCTIONS

FORM C
TABLE 1 FOR 3.00 ITEM A AND B

OUTFALL NO.
001

INTAKE AND EFFLUENT CHARACTERISTICS

PART A – You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
A. Biochemical Oxygen Demand (BOD)												
B. Chemical Oxygen Demand (COD)	15 mg/L				5 mg/L		3					
C. Total organic Carbon (TOC)												
D. Total Suspended Solids (TSS)	62 mg/L				25.6 mg/L		3					
E. Ammonia (as N)												
F. Flow	VALUE 0.28 MGD		VALUE		VALUE 0.22 MGD		3			VALUE		
G. Temperature (winter)	VALUE		VALUE		VALUE				°C	VALUE		
H. Temperature (summer)	VALUE		VALUE		VALUE				°C	VALUE		
I. pH	MINIMUM 6.86	MAXIMUM 8.30	MINIMUM	MAXIMUM					STANDARD UNITS			

PART B – Mark "X" in column 2A for each pollutant you know or have reason to believe is present. Mark "X" in column 2B for each pollutant you believe to be absent. If you mark column 2A for any pollutant, you must provide the results for at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	

CONVENTIONAL AND NONCONVENTIONAL POLLUTANTS

A. Bromide (24959-67-9)		X												
B. Chlorine, Total Residual		X												
C. Color		X												
D. Fecal Colliform		X												
E. Fluoride (16984-48-8)		X												
F. Nitrate - Nitrate (as N)		X												

1. POLLUTANT AND CAS NUMBER <i>(if available)</i>	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE <i>(optional)</i>			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE <i>(if available)</i>		C. LONG TERM AVRG. VALUE <i>(if available)</i>		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
G. Nitrogen, Total Organic <i>(as N)</i>		X												
H. Oil and Grease		X	<5.6 mg/L					<5.6 mg/L	3					
I. Phosphorus <i>(as P)</i> , Total (7723-14-0)		X												
J. Sulfate <i>(as SO₄⁻)</i> (14808-79-8)		X												
K. Sulfide <i>(as S)</i>		X												
L. Sulfite <i>(as SO₃⁻)</i> (14265-45-3)		X												
M. Surfactants		X												
N. Aluminum, Total (7429-90-5)		X												
O. Barium, Total (7440-39-3)		X												
P. Boron, Total (7440-42-8)		X												
Q. Cobalt, Total (7440-48-4)		X												
R. Iron, Total (7439-89-6)	X		480 ug/L					218.7 ug/L	3					
S. Magnesium, Total (7439-95-4)		X												
T. Molybdenum, Total (7439-98-7)		X												
U. Manganese, Total (7439-96-5)		X												
V. Tin, Total (7440-31-5)		X												
W. Titanium, Total (7440-32-6)		X												

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
METALS, AND TOTAL PHENOLS														
1M. Antimony, Total (7440-36-9)		X												
2M. Arsenic, Total (7440-38-2)		X												
3M. Beryllium, Total (7440-41-7)		X												
4M. Cadmium, Total (7440-43-9)		X												
5M. Chromium III (16065-83-1)		X												
6M. Chromium VI (18540-29-9)		X												
7M. Copper, Total (7440-50-8)	X		4.2 ug/L					2.73 ug/L	3					
8M. Lead, Total (7439-92-1)														
9M. Mercury, Total (7439-97-6)		X												
10M. Nickel, Total (7440-02-0)		X												
11M. Selenium, Total (7782-49-2)		X												
12M. Silver, Total (7440-22-4)		X												
13M. Thallium, Total (7440-28-0)		X												
14M. Zinc, Total (7440-66-6)	X		120 ug/L					61.67 ug/L	3					
15M. Cyanide, Amenable to Chlorination		X												
16M. Phenols, Total		X												
RADIOACTIVITY														
(1) Alpha Total		X												
(2) Beta Total		X												
(3) Radium Total		X												
(4) Radium 226 Total		X												

PLEASE PRINT OR TYPE. You may report some or all of this information on separate sheet
(Use the same format) instead of completing these pages.
SEE INSTRUCTIONS

FORM C
TABLE 1 FOR 3.00 ITEM A AND B

OUTFALL NO.
002

INTAKE AND EFFLUENT CHARACTERISTICS

PART A – You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
A. Biochemical Oxygen Demand (BOD)												
B. Chemical Oxygen Demand (COD)	13 mg/L				8.33 mg/L		3					
C. Total organic Carbon (TOC)												
D. Total Suspended Solids (TSS)	31 mg/L				13.93 mg/L		3					
E. Ammonia (as N)												
F. Flow	VALUE 0.11 MGD		VALUE		VALUE 0.09 MGD		3			VALUE		
G. Temperature (winter)	VALUE		VALUE		VALUE				°C	VALUE		
H. Temperature (summer)	VALUE		VALUE		VALUE				°C	VALUE		
I. pH	MINIMUM 6.76	MAXIMUM 8.60	MINIMUM	MAXIMUM					STANDARD UNITS			

PART B – Mark "X" in column 2A for each pollutant you know or have reason to believe is present. Mark "X" in column 2B for each pollutant you believe to be absent. If you mark column 2A for any pollutant, you must provide the results for at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	

CONVENTIONAL AND NONCONVENTIONAL POLLUTANTS

A. Bromide (24959-67-9)		X											
B. Chlorine, Total Residual		X											
C. Color		X											
D. Fecal Colliform		X											
E. Fluoride (16984-48-8)		X											
F. Nitrate - Nitrate (as N)		X											

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT							4. UNITS		5. INTAKE (optional)		
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
G. Nitrogen, Total Organic (as N)		X												
H. Oil and Grease	X		6.0 mg/L					2.0 mg/L	3					
I. Phosphorus (as P), Total (7723-14-0)		X												
J. Sulfate (as SO ₄) (14808-79-8)		X												
K. Sulfide (as S)		X												
L. Sulfite (as SO ₃) (14265-45-3)		X												
M. Surfactants		X												
N. Aluminum, Total (7429-90-5)		X												
O. Barium, Total (7440-39-3)		X												
P. Boron, Total (7440-42-8)		X												
Q. Cobalt, Total (7440-48-4)		X												
R. Iron, Total (7439-89-6)	X		270 ug/L					169.67 ug/L	3					
S. Magnesium, Total (7439-95-4)		X												
T. Molybdenum, Total (7439-98-7)		X												
U. Manganese, Total (7439-96-5)		X												
V. Tin, Total (7440-31-5)		X												
W. Titanium, Total (7440-32-6)		X												

1. POLLUTANT AND CAS NUMBER <i>(if available)</i>	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE <i>(optional)</i>			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE <i>(if available)</i>		C. LONG TERM AVRG. VALUE <i>(if available)</i>		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
METALS, AND TOTAL PHENOLS														
1M. Antimony, Total (7440-36-9)		X												
2M. Arsenic, Total (7440-38-2)		X												
3M. Beryllium, Total (7440-41-7)		X												
4M. Cadmium, Total (7440-43-9)		X												
5M. Chromium III (16065-83-1)		X												
6M. Chromium VI (18540-29-9)		X												
7M. Copper, Total (7440-50-8)	X		3.6 ug/L				3.2 ug/L	3						
8M. Lead, Total (7439-92-1)														
9M. Mercury, Total (7439-97-6)		X												
10M. Nickel, Total (7440-02-0)		X												
11M. Selenium, Total (7782-49-2)		X												
12M. Silver, Total (7440-22-4)		X												
13M. Thallium, Total (7440-28-0)		X												
14M. Zinc, Total (7440-66-6)	X		130 ug/L				91.33 ug/L	3						
15M. Cyanide, Amenable to Chlorination		X												
16M. Phenols, Total		X												
RADIOACTIVITY														
(1) Alpha Total		X												
(2) Beta Total		X												
(3) Radium Total		X												
(4) Radium 226 Total		X												

PLEASE PRINT OR TYPE. You may report some or all of this information on separate sheet
(Use the same format) instead of completing these pages.
SEE INSTRUCTIONS

FORM C
TABLE 1 FOR 3.00 ITEM A AND B

OUTFALL NO.
003

INTAKE AND EFFLUENT CHARACTERISTICS

PART A – You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
A. Biochemical Oxygen Demand (BOD)												
B. Chemical Oxygen Demand (COD)	33 mg/L				16.36 mg/L		3					
C. Total organic Carbon (TOC)												
D. Total Suspended Solids (TSS)	350 mg/L				124.53 mg/L		3					
E. Ammonia (as N)												
F. Flow	VALUE 0.13 MGD		VALUE		VALUE 0.1 MGD		3			VALUE		
G. Temperature (winter)	VALUE		VALUE		VALUE				°C	VALUE		
H. Temperature (summer)	VALUE		VALUE		VALUE				°C	VALUE		
I. pH	MINIMUM 6.79	MAXIMUM 8.80	MINIMUM	MAXIMUM					STANDARD UNITS			

PART B – Mark "X" in column 2A for each pollutant you know or have reason to believe is present. Mark "X" in column 2B for each pollutant you believe to be absent. If you mark column 2A for any pollutant, you must provide the results for at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	

CONVENTIONAL AND NONCONVENTIONAL POLLUTANTS

A. Bromide (24959-67-9)		X											
B. Chlorine, Total Residual		X											
C. Color		X											
D. Fecal Colliform		X											
E. Fluoride (16984-48-8)		X											
F. Nitrate - Nitrate (as N)		X											

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
G. Nitrogen, Total Organic (as N)		X												
H. Oil and Grease		X	<5.7 mg/L					<5.7 mg/L	3					
I. Phosphorus (as P), Total (7723-14-0)		X												
J. Sulfate (as SO ₄) (14808-79-8)		X												
K. Sulfide (as S)		X												
L. Sulfite (as SO ₃) (14265-45-3)		X												
M. Surfactants		X												
N. Aluminum, Total (7429-90-5)		X												
O. Barium, Total (7440-39-3)		X												
P. Boron, Total (7440-42-8)		X												
Q. Cobalt, Total (7440-48-4)		X												
R. Iron, Total (7439-89-6)	X		3100 ug/L					1292.33 ug/L	3					
S. Magnesium, Total (7439-95-4)		X												
T. Molybdenum, Total (7439-98-7)		X												
U. Manganese, Total (7439-96-5)		X												
V. Tin, Total (7440-31-5)		X												
W. Titanium, Total (7440-32-6)		X												

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
METALS, AND TOTAL PHENOLS														
1M. Antimony, Total (7440-36-9)		X												
2M. Arsenic, Total (7440-38-2)		X												
3M. Beryllium, Total (7440-41-7)		X												
4M. Cadmium, Total (7440-43-9)		X												
5M. Chromium III (16065-83-1)		X												
6M. Chromium VI (18540-29-9)		X												
7M. Copper, Total (7440-50-8)	X		16 ug/L					8.53 ug/L	3					
8M. Lead, Total (7439-92-1)														
9M. Mercury, Total (7439-97-6)		X												
10M. Nickel, Total (7440-02-0)		X												
11M. Selenium, Total (7782-49-2)		X												
12M. Silver, Total (7440-22-4)		X												
13M. Thallium, Total (7440-28-0)		X												
14M. Zinc, Total (7440-66-6)	X		310 ug/L					171.6 ug/L	3					
15M. Cyanide, Amenable to Chlorination		X												
16M. Phenols, Total		X												
RADIOACTIVITY														
(1) Alpha Total		X												
(2) Beta Total		X												
(3) Radium Total		X												
(4) Radium 226 Total		X												

PLEASE PRINT OR TYPE. You may report some or all of this information on separate sheet
(Use the same format) instead of completing these pages.
SEE INSTRUCTIONS

FORM C
TABLE 1 FOR 3.00 ITEM A AND B

INTAKE AND EFFLUENT CHARACTERISTICS	OUTFALL NO. 005
--	--------------------

PART A – You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE <i>(if available)</i>		C. LONG TERM AVRG. VALUE <i>(if available)</i>		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
A. Biochemical Oxygen Demand (BOD)												
B. Chemical Oxygen Demand (COD)	<6.0 mg/L				<6.0 mg/L		3					
C. Total organic Carbon (TOC)												
D. Total Suspended Solids (TSS)	120 mg/L				54.6 mg/L		3					
E. Ammonia (as N)												
F. Flow	VALUE 0.21 MGD		VALUE		VALUE 0.16 MGD		3			VALUE		
G. Temperature (winter)	VALUE		VALUE		VALUE				°C	VALUE		
H. Temperature (summer)	VALUE		VALUE		VALUE				°C	VALUE		
I. pH	MINIMUM 6.94	MAXIMUM 8.90	MINIMUM	MAXIMUM					STANDARD UNITS			

PART B – Mark "X" in column 2A for each pollutant you know or have reason to believe is present. Mark "X" in column 2B for each pollutant you believe to be absent. If you mark column 2A for any pollutant, you must provide the results for at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER <i>(if available)</i>	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE <i>(if available)</i>		C. LONG TERM AVRG. VALUE <i>(if available)</i>		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	

CONVENTIONAL AND NONCONVENTIONAL POLLUTANTS

A. Bromide (24959-67-9)		X												
B. Chlorine, Total Residual		X												
C. Color		X												
D. Fecal Coliform		X												
E. Fluoride (16984-48-8)		X												
F. Nitrate - Nitrate (as N)		X												

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
G. Nitrogen, Total Organic (as N)		X												
H. Oil and Grease		X	<5.5 mg/L					<5.5 mg/L	3					
I. Phosphorus (as P), Total (7723-14-0)		X												
J. Sulfate (as SO ⁴) (14808-79-8)		X												
K. Sulfide (as S)		X												
L. Sulfite (as SO ³) (14265-45-3)		X												
M. Surfactants		X												
N. Aluminum, Total (7429-90-5)		X												
O. Barium, Total (7440-39-3)		X												
P. Boron, Total (7440-42-8)		X												
Q. Cobalt, Total (7440-48-4)		X												
R. Iron, Total (7439-89-6)	X		980 ug/L					613.33 ug/L	3					
S. Magnesium, Total (7439-95-4)		X												
T. Molybdenum, Total (7439-98-7)		X												
U. Manganese, Total (7439-96-5)		X												
V. Tin, Total (7440-31-5)		X												
W. Titanium, Total (7440-32-6)		X												

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCENTRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
METALS, AND TOTAL PHENOLS														
1M. Antimony, Total (7440-36-9)		X												
2M. Arsenic, Total (7440-38-2)		X												
3M. Beryllium, Total (7440-41-7)		X												
4M. Cadmium, Total (7440-43-9)		X												
5M. Chromium III (16065-83-1)		X												
6M. Chromium VI (18540-29-9)		X												
7M. Copper, Total (7440-50-8)	X		5.2 ug/L					4.46 ug/L	3					
8M. Lead, Total (7439-92-1)														
9M. Mercury, Total (7439-97-6)		X												
10M. Nickel, Total (7440-02-0)		X												
11M. Selenium, Total (7782-49-2)		X												
12M. Silver, Total (7440-22-4)		X												
13M. Thallium, Total (7440-28-0)		X												
14M. Zinc, Total (7440-66-6)	X		180 ug/L					142.3 ug/L	3					
15M. Cyanide, Amenable to Chlorination		X												
16M. Phenols, Total		X												
RADIOACTIVITY														
(1) Alpha Total		X												
(2) Beta Total		X												
(3) Radium Total		X												
(4) Radium 226 Total		X												

PLEASE PRINT OR TYPE. You may report some or all of this information on separate sheet
(Use the same format) instead of completing these pages.
SEE INSTRUCTIONS

FORM C
TABLE 1 FOR 3.00 ITEM A AND B

OUTFALL NO.
006

INTAKE AND EFFLUENT CHARACTERISTICS

PART A – You must provide the results of at least one analysis for every pollutant in this table. Complete one table for each outfall. See instructions for additional details.

1. POLLUTANT	2. EFFLUENT						3. UNITS (specify if blank)		4. INTAKE (optional)			
	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
A. Biochemical Oxygen Demand (BOD)												
B. Chemical Oxygen Demand (COD)	12.0 mg/L				6.26 mg/L		3					
C. Total organic Carbon (TOC)												
D. Total Suspended Solids (TSS)	67 mg/L				31.53 mg/L		3					
E. Ammonia (as N)												
F. Flow	VALUE 0.10 MGD		VALUE		VALUE 0.076 MGD		3			VALUE		
G. Temperature (winter)	VALUE		VALUE		VALUE			°C		VALUE		
H. Temperature (summer)	VALUE		VALUE		VALUE			°C		VALUE		
I. pH	MINIMUM 6.60	MAXIMUM 8.10	MINIMUM	MAXIMUM				STANDARD UNITS				

PART B – Mark "X" in column 2A for each pollutant you know or have reason to believe is present. Mark "X" in column 2B for each pollutant you believe to be absent. If you mark column 2A for any pollutant, you must provide the results for at least one analysis for that pollutant. Complete one table for each outfall. See the instructions for additional details and requirements.

1. POLLUTANT AND CAS NUMBER (if available)	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE (optional)			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE (if available)		C. LONG TERM AVRG. VALUE (if available)		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	


CONVENTIONAL AND NONCONVENTIONAL POLLUTANTS

A. Bromide (24959-67-9)		X											
B. Chlorine, Total Residual		X											
C. Color		X											
D. Fecal Coliform		X											
E. Fluoride (16984-48-8)		X											
F. Nitrate - Nitrate (as N)		X											

1. POLLUTANT AND CAS NUMBER <i>(if available)</i>	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE <i>(optional)</i>			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE <i>(if available)</i>		C. LONG TERM AVRG. VALUE <i>(if available)</i>		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
G. Nitrogen, Total Organic <i>(as N)</i>		X												
H. Oil and Grease		X	<5.6 mg/L				<5.6 mg/L		3					
I. Phosphorus <i>(as P)</i> , Total (7723-14-0)		X												
J. Sulfate <i>(as SO₄⁻)</i> (14808-79-8)		X												
K. Sulfide <i>(as S)</i>		X												
L. Sulfite <i>(as SO₃⁻)</i> (14265-45-3)		X												
M. Surfactants		X												
N. Aluminum, Total (7429-90-5)		X												
O. Barium, Total (7440-39-3)		X												
P. Boron, Total (7440-42-8)		X												
Q. Cobalt, Total (7440-48-4)		X												
R. Iron, Total (7439-89-6)	X		730 ug/L				321.66 ug/L		3					
S. Magnesium, Total (7439-95-4)		X												
T. Molybdenum, Total (7439-98-7)		X												
U. Manganese, Total (7439-96-5)		X												
V. Tin, Total (7440-31-5)		X												
W. Titanium, Total (7440-32-6)		X												

1. POLLUTANT AND CAS NUMBER <i>(if available)</i>	2. MARK "X"		3. EFFLUENT						4. UNITS		5. INTAKE <i>(optional)</i>			
	A. BELIEVED PRESENT	B. BELIEVED ABSENT	A. MAXIMUM DAILY VALUE		B. MAXIMUM 30 DAY VALUE <i>(if available)</i>		C. LONG TERM AVRG. VALUE <i>(if available)</i>		D. NO. OF ANALYSES	A. CONCEN- TRATION	B. MASS	A. LONG TERM AVRG. VALUE		B. NO. OF ANALYSES
			(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS	(1) CONCENTRATION	(2) MASS				(1) CONCENTRATION	(2) MASS	
METALS, AND TOTAL PHENOLS														
1M. Antimony, Total (7440-36-9)		X												
2M. Arsenic, Total (7440-38-2)		X												
3M. Beryllium, Total (7440-41-7)		X												
4M. Cadmium, Total (7440-43-9)		X												
5M. Chromium III (16065-83-1)		X												
6M. Chromium VI (18540-29-9)		X												
7M. Copper, Total (7440-50-8)	X		3.8 ug/L				1.26 ug/L	3						
8M. Lead, Total (7439-92-1)														
9M. Mercury, Total (7439-97-6)		X												
10M. Nickel, Total (7440-02-0)		X												
11M. Selenium, Total (7782-49-2)		X												
12M. Silver, Total (7440-22-4)		X												
13M. Thallium, Total (7440-28-0)		X												
14M. Zinc, Total (7440-66-6)	X		64 ug/L				49 ug/L	3						
15M. Cyanide, Amenable to Chlorination		X												
16M. Phenols, Total		X												
RADIOACTIVITY														
(1) Alpha Total		X												
(2) Beta Total		X												
(3) Radium Total		X												
(4) Radium 226 Total		X												

FIGURE 3

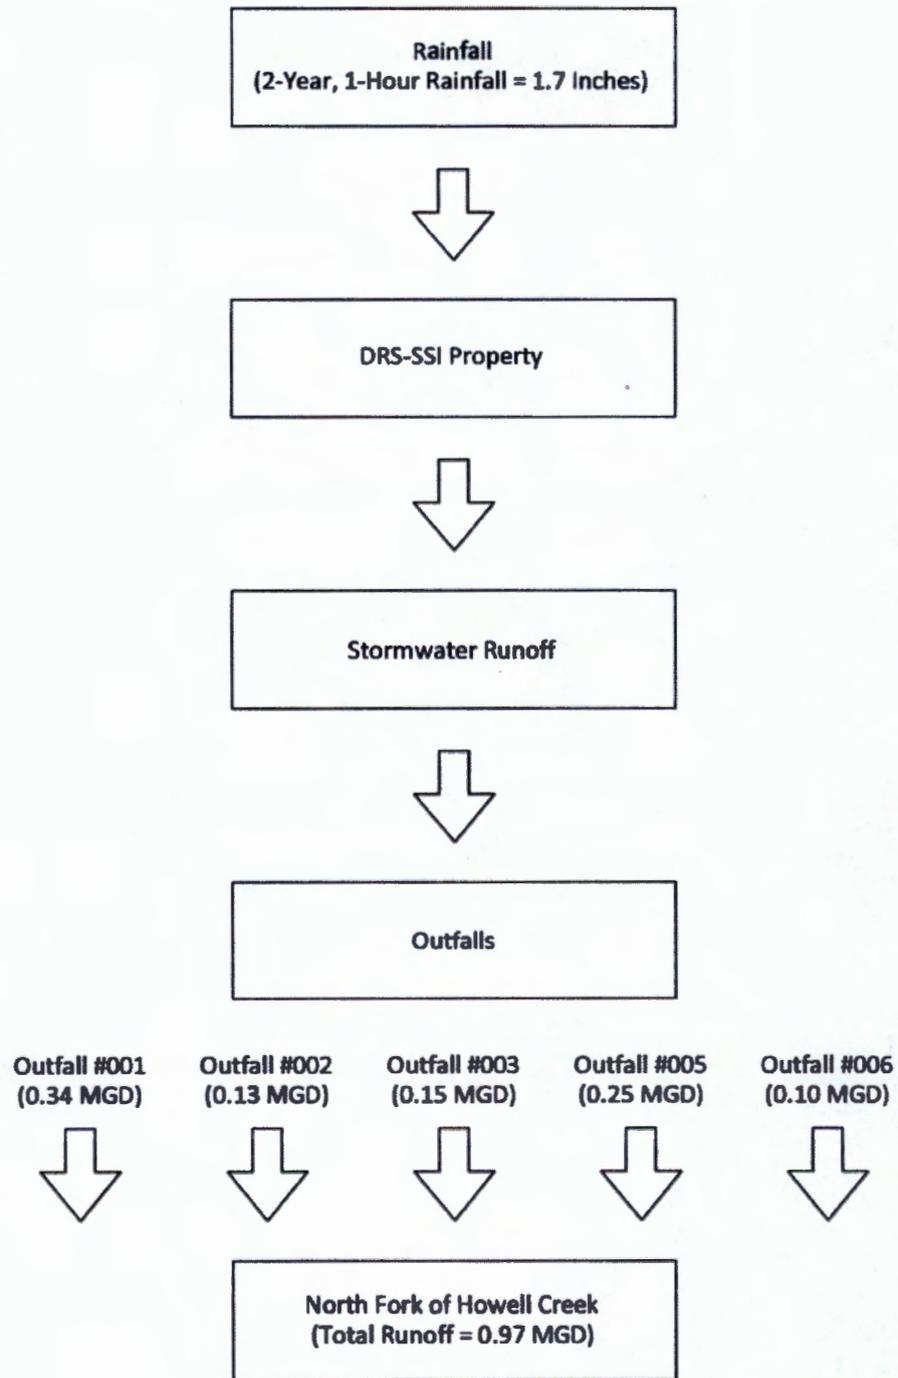

DRS-SSI Runoff Calculations

Calculate for 10-year, 24-hour storm.

For West Plains, 10-year, 24-hour storm rainfall

5.5 inches/12 =

0.46 feet/day

Outfall #	Dimensions			Runoff Coeff (c)	Rainfall (ft/day)	Q = cia (cu.ft./day)	Q (Gal/Day)	Q (MGD)
	Length (ft)	Width (ft)	Area (sq. ft.)					
001	428	1,064	455,392	0.70	0.46	146,105	1,092,865	1.09
002	330	530	174,900	0.70	0.46	56,114	419,731	0.42
003	330	625	206,250	0.70	0.46	66,172	494,966	0.49
005	370	915	338,550	0.70	0.46	108,618	812,464	0.81
006	585	825	482,625	0.25	0.46	55,301	413,650	0.41
					Sum	432,309	3,233,675	3.23

Calculate for 2-year, 1.0-hour storm.

For West Plains, 2-year, 1.0-hour storm rainfall :

1.7 inches/12 =

0.14 feet/day

Outfall #	Dimensions			Runoff Coeff (c)	Rainfall (ft/day)	Q = cia (cu.ft./day)	Q (Gal/Day)	Q (MGD)
	Length (ft)	Width (ft)	Area (sq. ft.)					
001	428	1,064	455,392	0.70	0.14	45,160	337,795	0.34
002	330	530	174,900	0.70	0.14	17,344	129,735	0.13
003	330	625	206,250	0.70	0.14	20,453	152,989	0.15
005	370	915	338,550	0.70	0.14	33,573	251,125	0.25
006	585	825	482,625	0.20	0.14	13,674	102,284	0.10
					Sum	130,204	973,928	0.97


11/11/14

Stormwater Runoff Calculations



Google earth




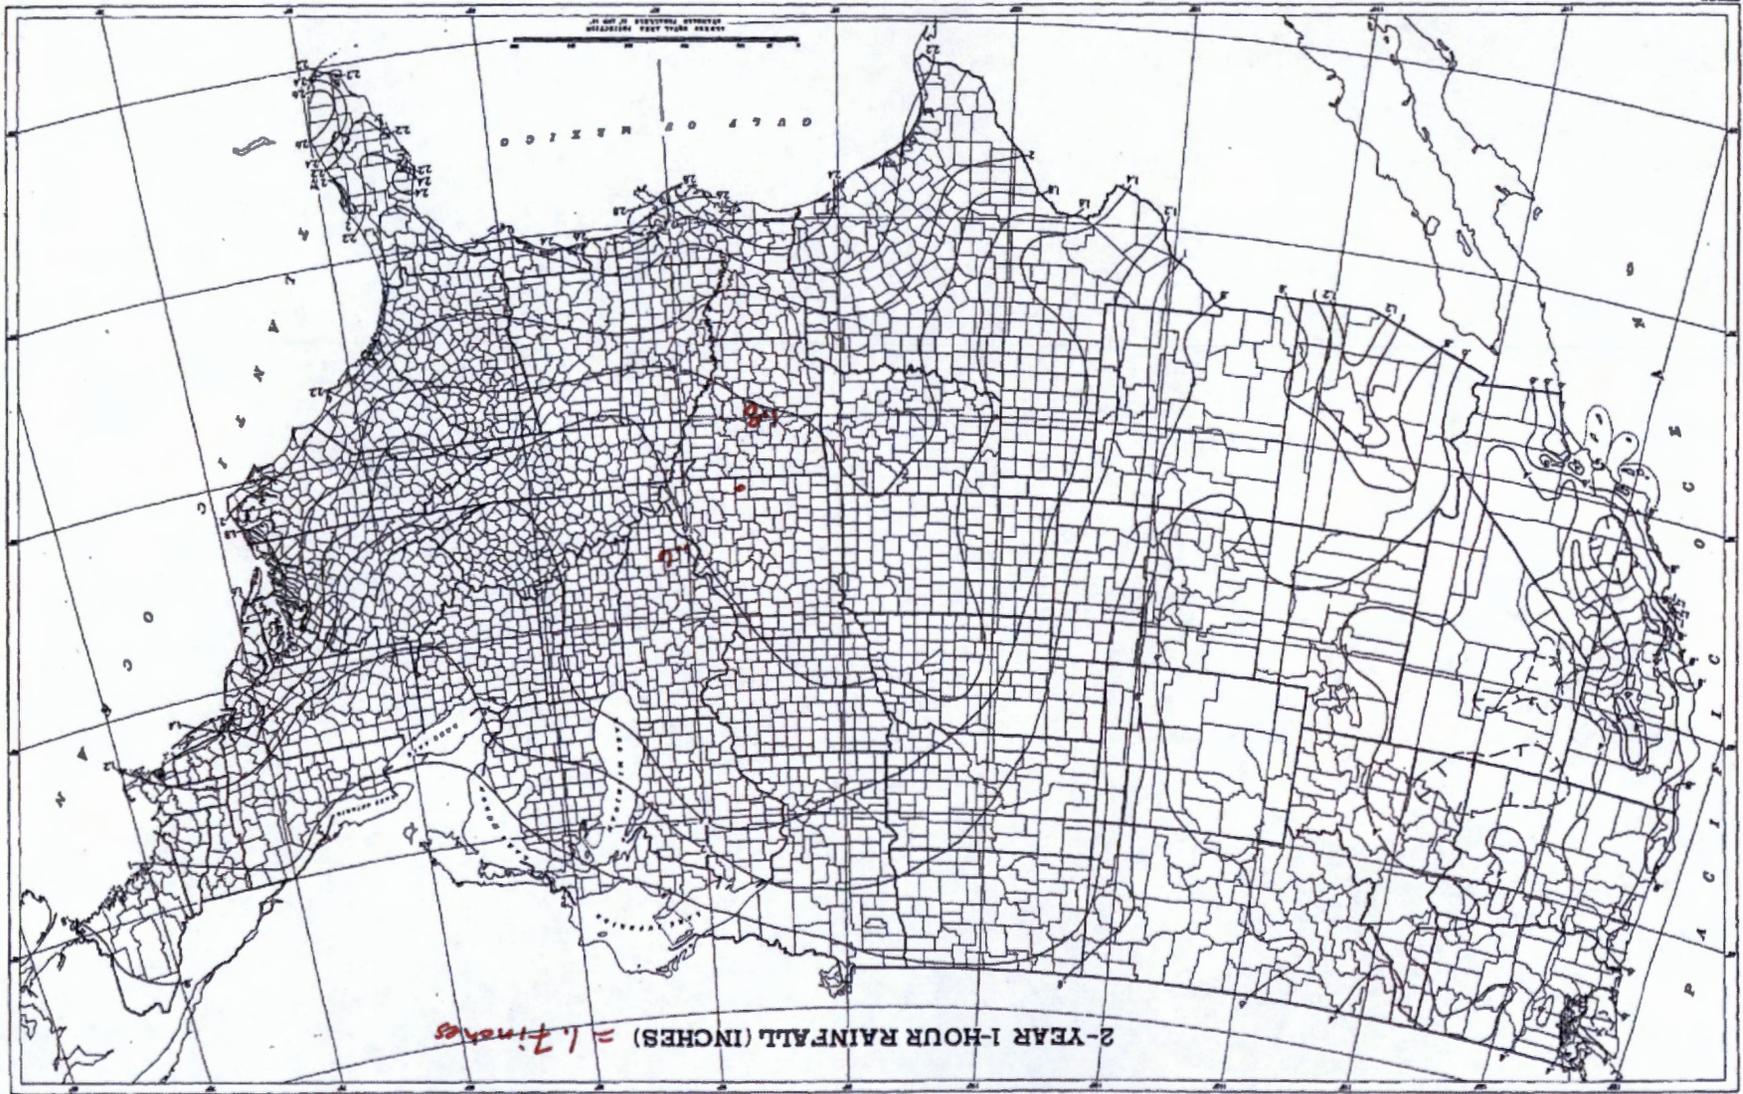

100 MILES

UNITED STATES

2-YEAR 1-HOUR RAINFALL (INCHES) = 1.7 inches

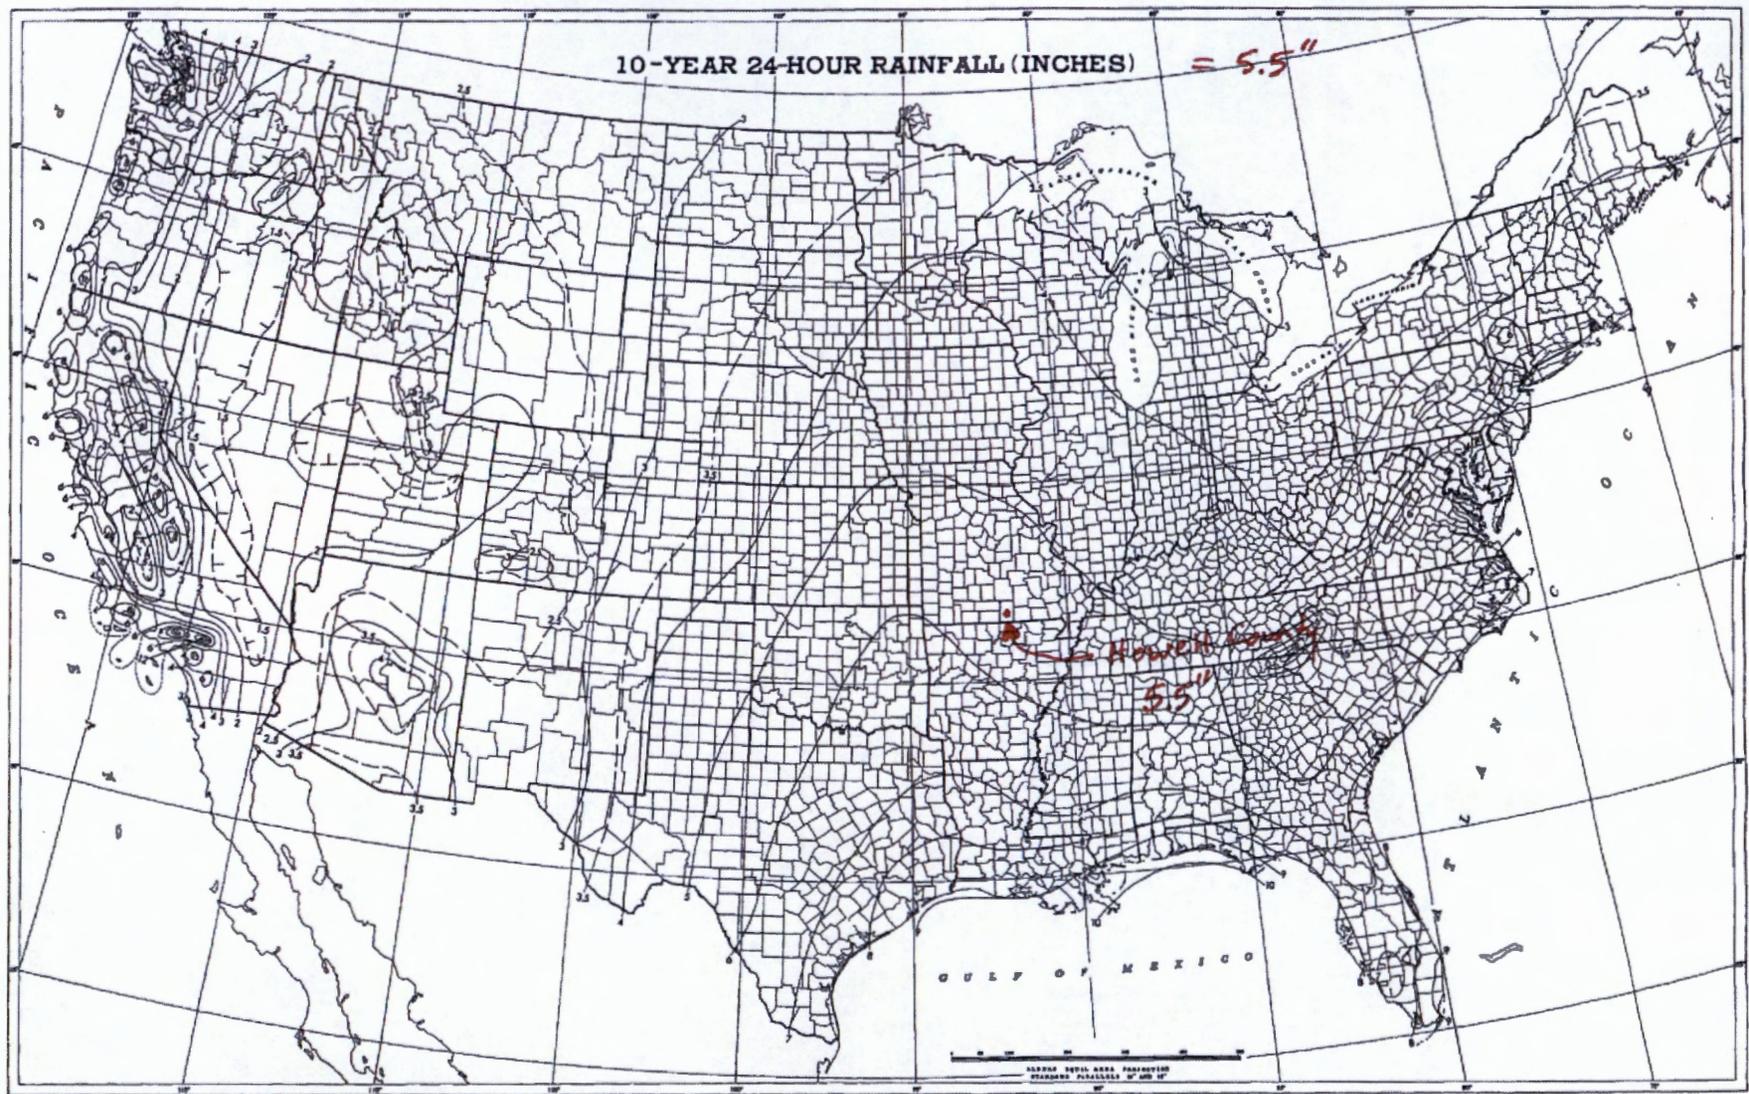

U.S. DEPARTMENT OF COMMERCE
LUTHER H. HODGES, Secretary

WEATHER BUREAU
F. W. REICHELDERFER, Chief

TECHNICAL PAPER NO. 40

RAINFALL FREQUENCY ATLAS OF THE UNITED STATES

for Durations from 30 Minutes to 24 Hours and
Return Periods from 1 to 100 Years

Prepared by
DAVID M. HERSHFIELD
Cooperative Studies Section, Hydrologic Services Division
for
Engineering Division, Soil Conservation Service
U.S. Department of Agriculture



WASHINGTON, D.C.

May 1961

Repaginated and Reprinted January 1963

For sale by the Superintendent of Documents, U.S. Government Printing Office, Washington 25, D.C. Price \$1.25

9/9/2015 11/17/2015 3/10/2016 10/5/2016 2/21/2017 6/23/2017

Outfall SP-001				Plant 4 - South Test Track Turnaround						
Effluent Parameters	Units	Sample Type	Daily Maximum							
Flow	MGD	24-hr estimate	Monitoring only	0.17	1.62	0.18	0.22	0.28	0.15	
Precipitation	Inches	Total measured	Monitoring only	0.4	3.84	0.43	0.53	0.66	0.35	
Settleable Solids	ml/L/hr	grab	1.5	<0.10	0.10	<0.10	<0.10	<0.10	<0.10	
Total Suspended Solids	mg/L	grab	30	9.2	91	14	62	4.0	11	
Chemical Oxygen Demand	mg/L	grab	70	<6.0	13	<6.0	<6.0	<6.0	15	
Oil & Grease	mg/L	grab	10	<5.1	<5.5	<5.5	<5.6	<5.1	<5.2	
ph - Units	SU	grab	6.5-9.0	6.7	7.1	8.4	8.3	7.04	6.86	
Copper, TR	ug/L	grab	26	<20	4	<3.0	4.2	4.0	<3.0	
Iron, TR (BMP 1000 ug/L)	ug/L	grab	<1000	70	970	210	480	66	110	
Zinc, TR	ug/L	grab	209	43	74	51	120	35	30	

Outfall SP-002				Plant 1 - Paint Haz Waste Pad (adjacent to Paint Dept)						
Effluent Parameters	Units	Sample Type	Daily Maximum							
Flow	MGD	24-hr estimate	Monitoring only	0.06	0.62	0.07	0.09	0.11	0.06	
Precipitation	Inches	Total measured	Monitoring only	0.4	3.84	0.43	0.53	0.66	0.35	
Settleable Solids	ml/L/hr	grab	1.5	<0.10	<0.10	<0.10	<0.10	<0.10	<0.10	
Total Suspended Solids	mg/L	grab	30	3.6	4.0	9.6	31	2.0	8.8	
Chemical Oxygen Demand	mg/L	grab	70	8.0	6.4	<6.0	13	<6.0	12	
Oil & Grease	mg/L	grab	10	<5.1	<5.4	<5.6	<5.6	<5.1	6.0	
ph - Units	SU	grab	6.5-9.0	6.2	6.9	8.21	8.6	7.30	6.76	
Copper, TR	ug/L	grab	26	<20	<3.0	<3.0	2.6	3.4	3.6	
Iron, TR (BMP 1000 ug/L)	ug/L	grab	<1000	29	84	120	270	49	190	
Zinc, TR	ug/L	grab	209	69	91	67	80	64	130	

Outfall SP-003				Plant 1 - North Employee Lot (adjacent to Shipping/Receiving)						
Effluent Parameters	Units	Sample Type	Daily Maximum							
Flow	MGD	24-hr estimate	Monitoring only	0.08	0.73	0.08	0.10	0.13	0.07	
Precipitation	Inches	Total measured	Monitoring only	0.4	3.84	0.43	0.53	0.66	0.35	
Settleable Solids	ml/L/hr	grab	1.5	<0.10	<0.10	<0.10	0.2	<0.10	<0.10	
Total Suspended Solids	mg/L	grab	30	6.8	49	33	350	3.6	20.0	
Chemical Oxygen Demand	mg/L	grab	70	7.3	6.1	<6.0	33	10	6.1	
Oil & Grease	mg/L	grab	10	<5.1	<5.6	<5.5	<5.7	<5.1	<5.2	
ph - Units	SU	grab	6.5-9.0	7.4	7.2	8.32	8.8	6.93	6.79	
Copper, TR	ug/L	grab	26	<20	4.4	<3.0	16	5.1	4.5	
Iron, TR (BMP 1000 ug/L)	ug/L	grab	<1000	66	880	490	3100	87	690	
Zinc, TR	ug/L	grab	209	15	57	58	310	15	190	

Outfall SP-005				Plant 1 - South Employee Lot (adjacent to Building 10)						
Effluent Parameters	Units	Sample Type	Daily Maximum							
Flow	MGD	24-hr estimate	Monitoring only	0.13	1.21	0.13	0.17	0.21	0.11	
Precipitation	Inches	Total measured	Monitoring only	0.4	3.84	0.43	0.53	0.66	0.35	
Settleable Solids	ml/L/hr	grab	1.5	0.10	0.20	<0.10	<0.10	<0.10	<0.12	
Total Suspended Solids	mg/L	grab	30	56	360	88	120	15	29	
Chemical Oxygen Demand	mg/L	grab	70	6.7	7.7	<6.0	<6.0	<6.0	<6.0	
Oil & Grease	mg/L	grab	10	<4.8	<5.6	<5.0	<5.5	<5.1	<5.2	
ph - Units	SU	grab	6.5-9.0	6.6	7.0	8.04	8.9	7.05	6.94	
Copper, TR	ug/L	grab	26	<20	9.6	5.5	5.2	4.7	3.5	
Iron, TR (BMP 1000 ug/L)	ug/L	grab	<1000	650	4100	1200	980	170	690	
Zinc, TR	ug/L	grab	209	190	170	91	180	87	160	

Outfall SP-006				Storage Lot across from Buildings 8/9						
Effluent Parameters	Units	Sample Type	Daily Maximum							
Flow	MGD	24-hr estimate	Monitoring only	0.06	0.57	0.06	0.08	0.1	0.05	
Precipitation	Inches	Total measured	Monitoring only	0.4	3.84	0.43	0.53	0.66	0.35	
Settleable Solids	ml/L/hr	grab	1.5	<0.10	0.20	<0.10	<0.10	<0.10	<0.10	
Total Suspended Solids	mg/L	grab	30	28	44	23	67	3.6	24	
Chemical Oxygen Demand	mg/L	grab	70	10	<6.0	<6.0	<6.0	6.8	12	
Oil & Grease	mg/L	grab	10	<5.1	<5.6	<5.4	<5.6	<5.1	<5.2	
ph - Units	SU	grab	6.5-9.0	6.8	7.2	8.09	8.1	6.6	6.96	
Copper, TR	ug/L	grab	26	<20	5.1	<3.0	<3.0	3.8	<3.0	
Iron, TR (BMP 1000 ug/L)	ug/L	grab	<1000	160	1800	460	730	5	230	
Zinc, TR	ug/L	grab	209	32	65	28	64	41	42	